

ADDENDUM NO. #1

Project: East End Rd/Ronda St Water Main Xing
Addendum Issue Date: April 29, 2019
Bid Date: May 2, 2019 @ 2:00 PM (Thursday)
Previous Addenda Issued: None
Issued By: Carey Meyer
City Engineer - City of Homer
Homer, AK 99603
cmeyer@ci.homer.ak.us

Bidders must acknowledge receipt of this addendum prior to the date set for bid opening by one of the following methods:

- (1) By acknowledging receipt of this addendum in the bid submitted (**use addendum acknowledgement form provided in bid documents**).
- (2) By facsimile (fax) or email which will need to include a reference to the project and each of the addendum numbers.

The bid documents require acknowledgement individually of all addenda to the drawings and/or specifications. This is a mandatory requirement and any bid received without acknowledgment of receipt of addenda may cause the bid to be considered non-responsive.

ITEM 1 – Completion Schedule – Revise completion date from August 15 to September 15, 2019



ITEM 2 – Bid Schedule – Replace the bid schedule contained within the bid documents with the one attached.

ITEM 3 – Revised Sheet C01 – Attached is revised plan sheet C01 (clarifying in the profile) transition from trenching to boring at Sta. 38+06.


END ADDENDUM #1

C:\Civil 3D\Projects\2016\28\62417-01\Civil\SC-CU-WA-PP-62417.dwg PLOT DATE 2019-04-08 13:46 SAVED DATE 2019-04-08 13:45 USER: drandersen


- NOTES:**
1. REMOVE EXISTING 12"x6" REDUCER AND CONNECT NEW 12" HDPE LINE TO EXISTING 12" HDPE WATER LINE.
 2. ALL IMPROVEMENTS TO MATCH EXISTING GRADE WHEN FINISHED.
 3. CONTRACTOR TO DETERMINE ACTUAL LIMITS OF ACCESS PITS.
 4. EXISTING 6" WATER LINE WILL BE REMOVED IN ITS ENTIRETY FROM STA. 0+00 TO STA. 0+40.
 5. CONTRACTOR SHALL EXPOSE EXISTING 6" VALVE, CLOSE VALVE, DISCONNECT 6" PIPE FROM VALVE, AND INSTALL BLIND FLANGE ON VALVE. ABANDON REMAINING PIPE IN PLACE.

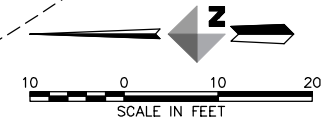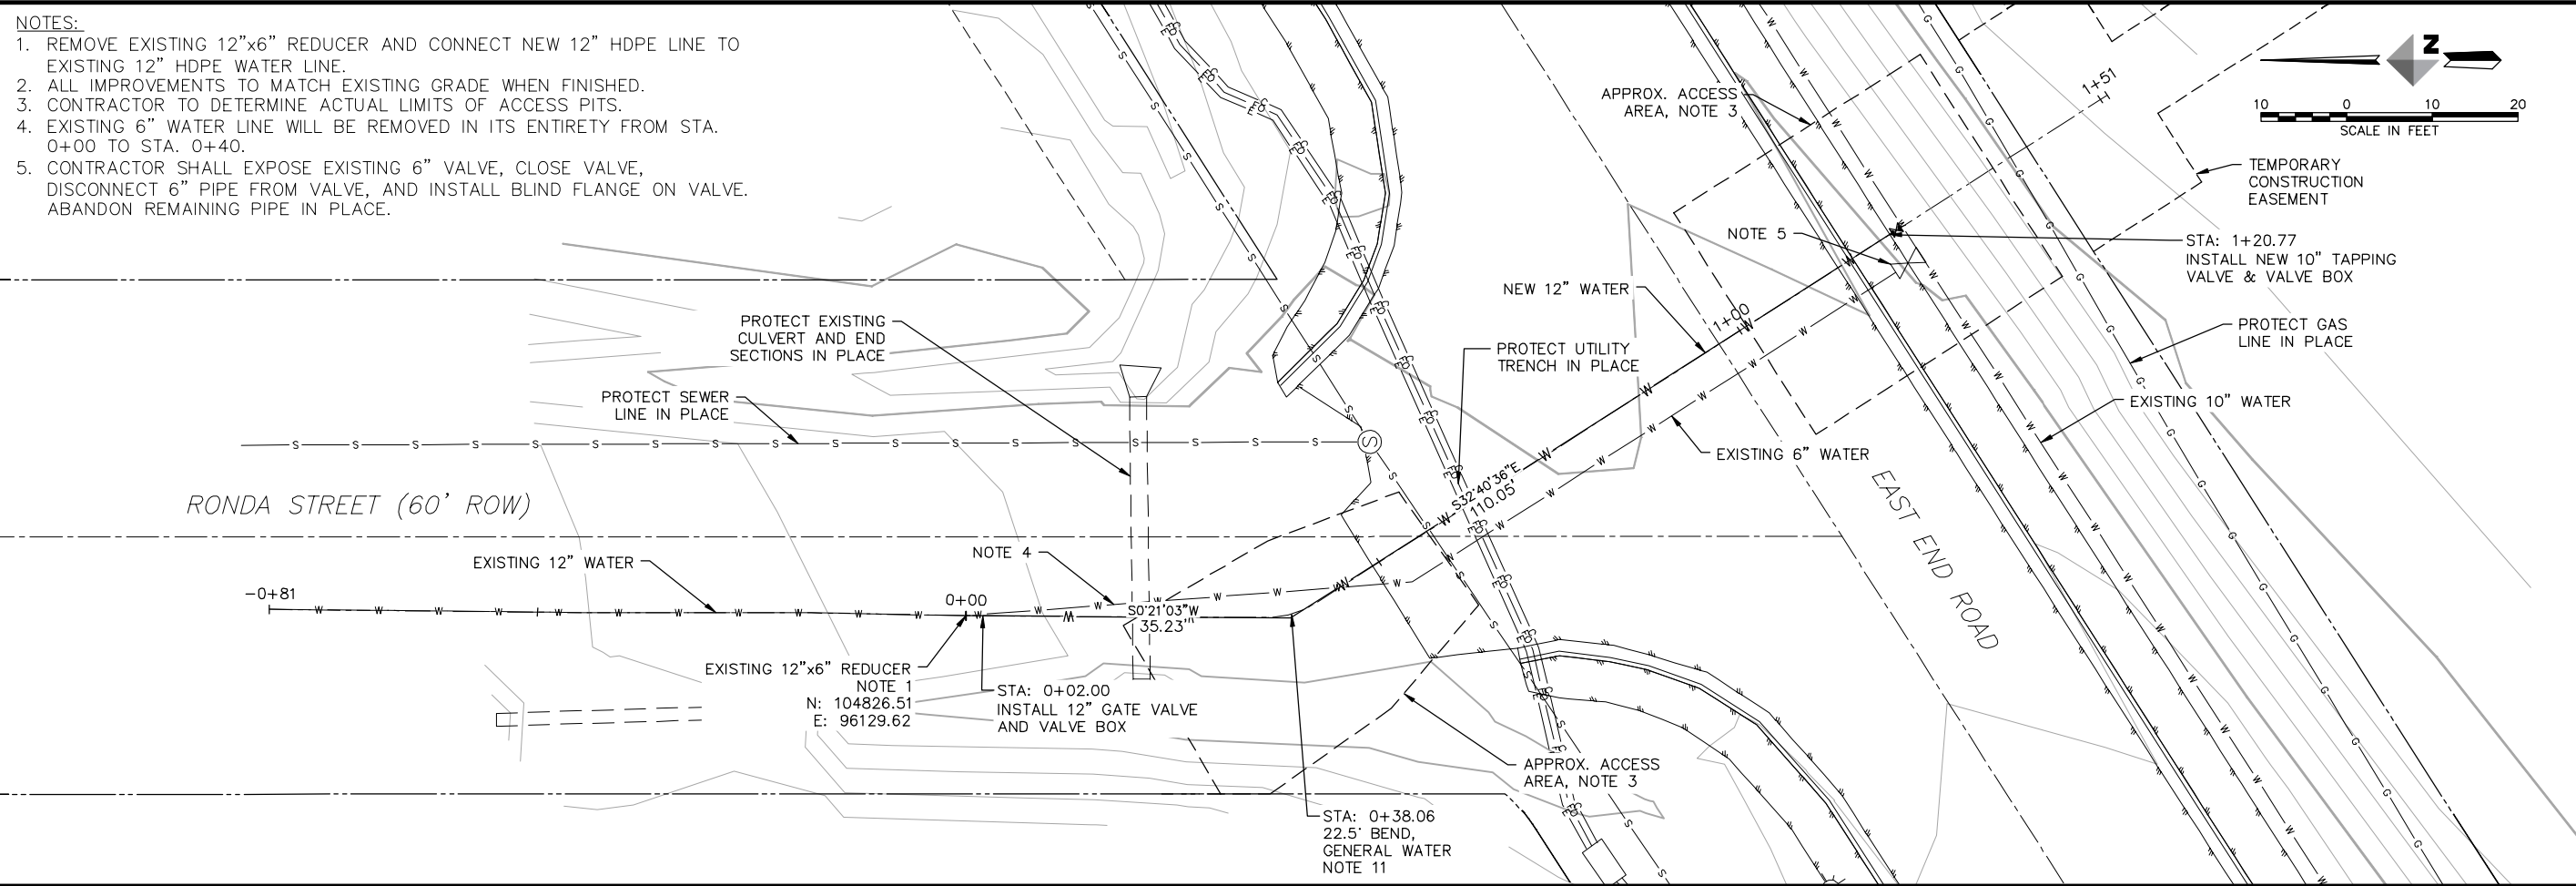

REV	DATE	DESCRIPTION	BY



DOWL
AECI-848
WWW.DOWL.COM
4041 B Street
Anchorage, Alaska 99503
907-562-2000

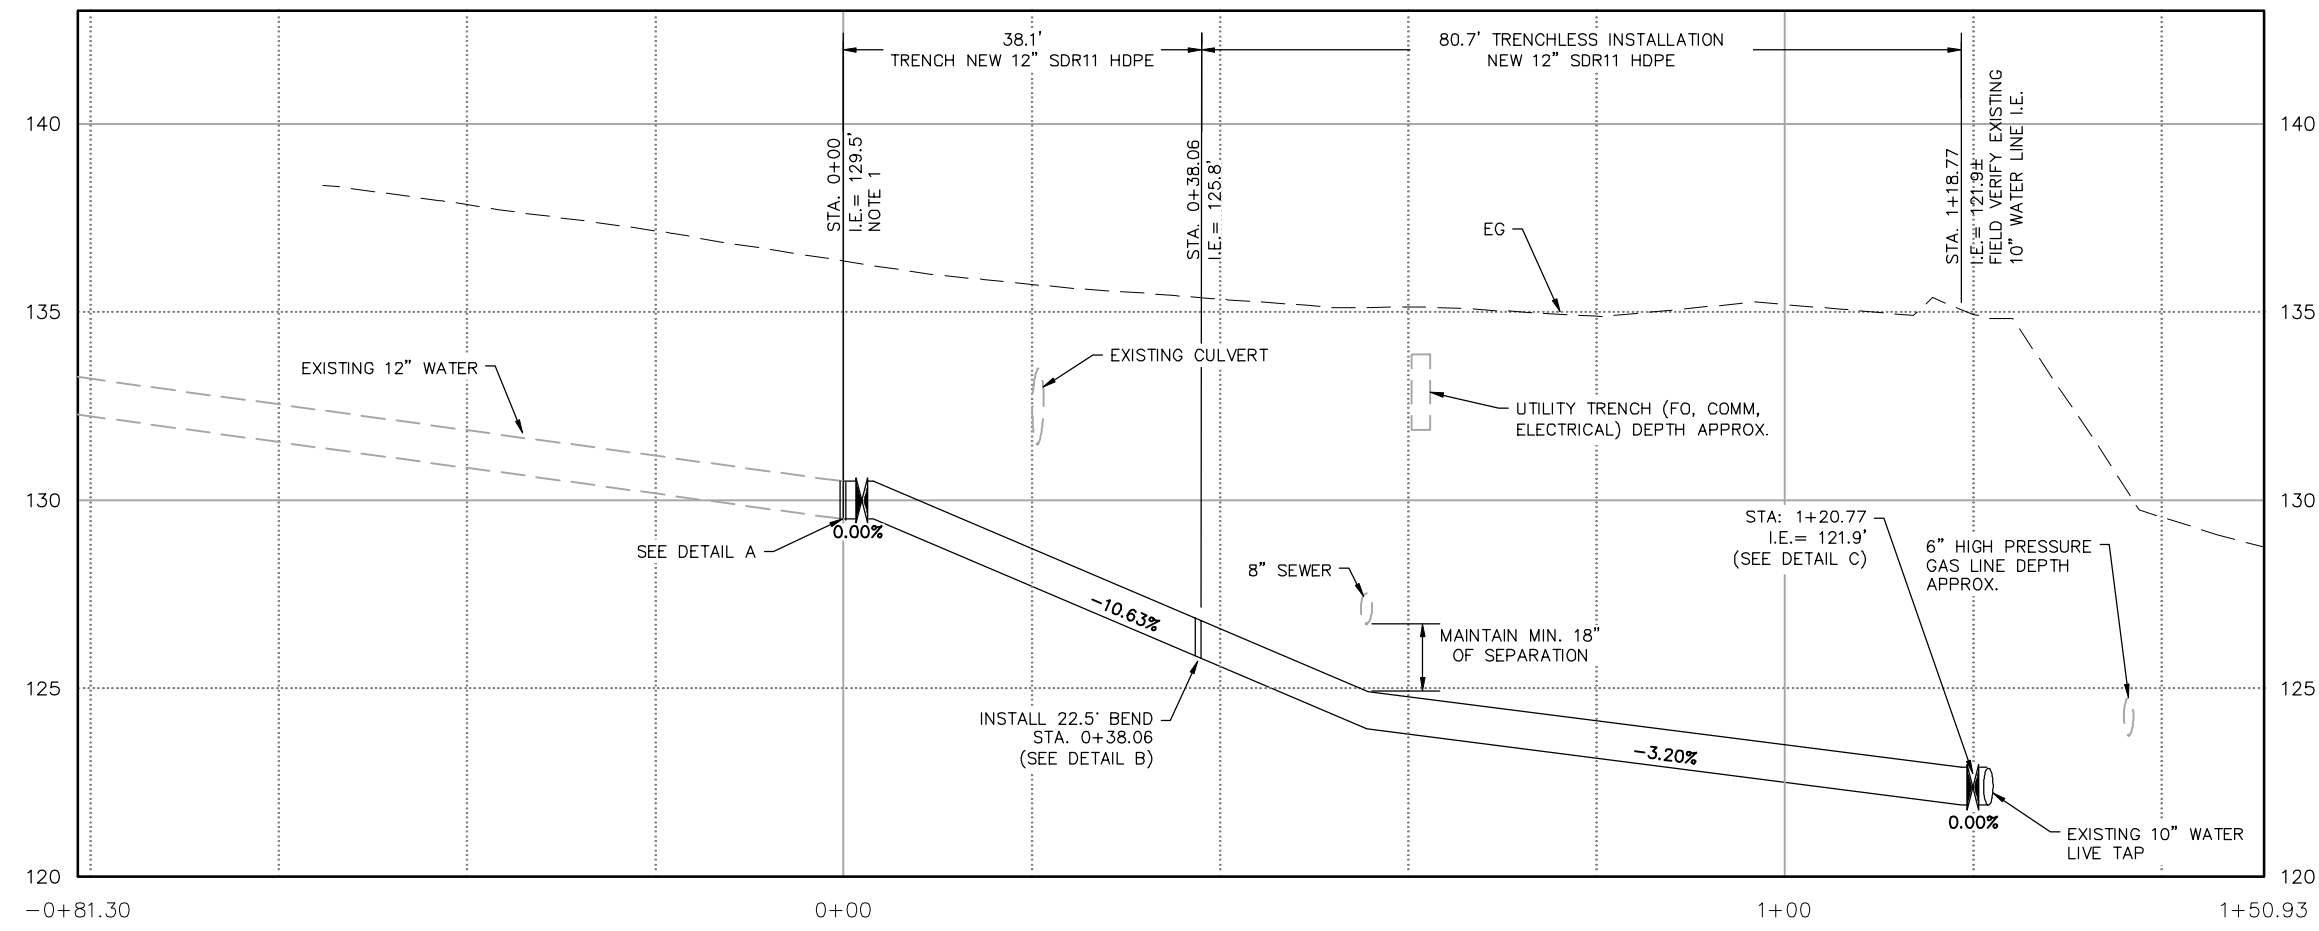

PLAN & PROFILE - RONDA STREET
EAST END ROAD/RONDA STREET WATER MAIN
CROSSING DESIGN
HOMER, ALASKA

PROJECT	1128.62417.01
DATE	2/19/2019
© DOWL 2018	
SHEET	
C01	