



# Bid Package for the Main Street Sidewalk Improvement Project

---

4/4/2022



INVITATION TO BID  
By the City of Homer, Alaska  
For the Main Street Sidewalk Improvement Project

Sealed Bids for construction of the Main Street Sidewalk Improvement Project will be received by the Office of the City Clerk, 491 E. Pioneer Avenue, Homer, Alaska 99603 until **2:00 PM on Tuesday, May 3, 2022**, at which time they will be publicly opened. Bids received after the time fixed for receipt of the Bid shall not be considered. **All bidders must submit a City of Homer Plan Holders Registration form to be on the Plan Holders List to be considered responsive.** Plan holder registration forms and Plan and Specification are available online at <http://www.cityofhomer-ak.gov/rfps>

A pre-bid meeting will be conducted on Monday, April 25, 2022 at 2:00 p.m. at Homer City Hall Cowles Council Chambers and by Zoom meeting, and a site visit will follow.

The project consists of furnishing all labor, materials, equipment, tools, supervision, and other facilities necessary to perform the project in accordance with the plans and specifications. The work includes, but is not limited to the following:

Furnish materials for and install approximately 2,900 feet of asphalt sidewalk along the west side of Main Street, from Pioneer Avenue to Dehel Avenue. This will also involve 2,130 CY of excavation, removal of obstacles as specified in the plans, installation of curb and gutter, installation of varying sizes of CSP culvert sections, reconstruction of driveways, approaches and existing manholes and inlets, construction of new storm sewer manholes, topsoil installation and seeding.

An electronic copy of the Bid Documents and Plan Holder Registration form are available online at <https://www.cityofhomer-ak.gov/rfps>. Paper copies of the Bid Documents may be purchased at the Office of the City Clerk upon payment of \$100 per set (\$150 for priority mail delivery). All fees are non-refundable.

For Bid Plans and Specifications contact:

City Clerk  
491 E. Pioneer Avenue  
Homer, Alaska 99603  
(907) 235-3130


Please direct all questions in writing regarding this project to:

Janette Keiser, PE  
Public Works Director  
City of Homer Public Works Dept.  
3575 Heath Street  
Homer, Alaska 99603  
Email: [jkeiser@ci.homer.ak.us](mailto:jkeiser@ci.homer.ak.us) Phone: (907) 435-3141

The City of Homer reserves the right to accept or reject any or all bids, and to waive irregularities or informalities in the bids.

Dated this 11<sup>th</sup> day of April, 2022.

City of Homer



Robert Dumouchel, City Manager



# CONTRACT

This Contract, made and entered into by and between the City of Homer, Alaska, a Municipal Corporation, hereinafter called the “City” and

---

(Company Name)

Hereinafter called the “Contractor”.

## **I. CONTRACT DOCUMENTS**

The Contractor, in consideration of the sum to be paid by the City agrees to furnish all materials, tools, labor, machinery and appurtenances to perform the work set forth in the Contract documents, including:

- a. Signed copy of the Bid;
- b. Performance Bond;
- c. Payment Bond;
- d. Bid Bond;
- e. The 2011 Homer Standard Construction Specifications;
- f. All Addenda, totaling \_\_\_\_;
- g. The drawings which consist of 25 sheets titled City of Homer Public Works Department Main Street Sidewalk Improvement Project.

Said Contract Documents are fully and completely incorporated as part of the Contract as if the same were fully set forth herein.

In consideration of the performance of the work as set forth in these Contract Documents, the City agrees to pay to the Contractor the amounts specified in the Contract Documents and to make such payments upon the Contractor’s invoicing as approved by the City.

## **II. CONTRACT COMPLETION TIME**

The Contractor agrees to complete the Project, in all respects on or before October 31, 2022.

## **III. CONTRACT AMOUNT**

\$ \_\_\_\_\_

In Numbers

\$ \_\_\_\_\_

In Words

**IV. LIQUIDATED DAMAGES**

Liquidated damages in the amount of **\$350.00** per day will apply to the Contractor's unexcused delay in the Completion of Construction. The liquidated damage amount specified herein shall only apply to damages and expenses the Owner may incur as a result of a delay in placing the facility into use and operation exclusive of third party damages or claims. The liquidated damage amount shall not cover any damages or expenses the Owner may incur as a result of the Contractor's unexcused delay in completing any portion of the entire Project, which delay results in whole or in part in delay, disruption, hindrance, interference, damages or expenses to any third party. The Contractor shall remain liable for the full amount of any such delay damages or expenses suffered by any third party without limitation by any liquidated damage provision set forth in the Contract.

IN WITNESS WHEREOF, we, the parties hereto, each herewith subscribe the same this \_\_\_\_\_ day of \_\_\_\_\_, 2022.

CITY OF HOMER

By: \_\_\_\_\_  
Robert Dumouchel

Title: City Manager

CONTRACTOR

\_\_\_\_\_  
(Contractor)

By: \_\_\_\_\_

Title: \_\_\_\_\_

**PERFORMANCE BOND**

KNOW ALL THESE PRESENTS: That we \_\_\_\_\_  
(Name of Contractor)

\_\_\_\_\_ a \_\_\_\_\_  
(Corporation, Partnership, Individual)

hereinafter called "Principal" and \_\_\_\_\_  
(Surety)

of \_\_\_\_\_, State of \_\_\_\_\_

hereinafter called the "Surety" are held and firmly bound unto the City of Homer, hereinafter called "Owner," in the penal sum of \_\_\_\_\_ dollars (\$\_\_\_\_\_) in lawful money of the United States, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

THE CONDITIONS OF THIS OBLIGATION are such that Whereas, the Principal has or is about to enter into a certain contract with the Owner, a copy of which is hereto attached and made a part hereof for the construction of:

NOW, THEREFORE, if the Principal shall well, truly and faithfully perform its duties, all the undertakings, covenants, terms, conditions, and agreements of said contract during the original term thereof, and any extensions thereof which may be granted by the Owner, with or without notice to the Surety, and if it shall satisfy all claims and demands incurred under such contract, and shall fully indemnify and save harmless the Owner from all costs and damages which it may suffer by reason of failure to do so, and shall reimburse and repay the Owner all outlay and expense which the Owner may incur in making good any default, then this obligations shall be void; otherwise to remain in full force and effect.

PROVIDED, FURTHER, that the said surety, for value received hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the contract or the work to be performed thereunder or the specifications accompanying the same shall in any wise affect it obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the contract or to the work or to the specifications.

PROVIDED, FURTHER, that no final settlement between the Owner and the Principal shall abridge the right of any beneficiary hereunder, whose claim may be unsatisfied.

IN WITNESS WHEREOF, this instrument is executed in five (5) counterparts, each one of which shall be deemed and original, this the \_\_\_\_\_ day of \_\_\_\_\_, 2022.

ATTEST:

\_\_\_\_\_  
(Principal's Corporate Secretary)

\_\_\_\_\_  
(Principal)

Affix CORPORATE SEAL if applicable

\_\_\_\_\_  
(Address-Zip Code)

\_\_\_\_\_  
(Witness as to Principal)

\_\_\_\_\_  
(Address - Zip Code)

\_\_\_\_\_  
(Surety)

ATTEST:

By: \_\_\_\_\_  
(Attorney-in-Fact)

\_\_\_\_\_  
(Surety) Secretary

\_\_\_\_\_  
(Address-Zip Code)

(Affix SURETY'S SEAL)

\_\_\_\_\_  
(Witness as to Surety)

\_\_\_\_\_  
(Address-Zip Code)

Notes:

If Principal is Partnership, all partners must execute bond. The Attorney-in-Fact, who executes this bond on behalf of the surety, must attach a copy of his Power-of-Attorney as evidence of his authority.



## **PAYMENT BOND**

KNOW ALL THESE PRESENTS: That we \_\_\_\_\_  
(Name of Contractor)

\_\_\_\_\_ a \_\_\_\_\_  
(Corporation, Partnership, Individual)

hereinafter called "Principal" and \_\_\_\_\_  
(Surety)

of \_\_\_\_\_, State of \_\_\_\_\_

hereinafter called the "Surety" are held and firmly bound unto the City of Homer,

hereinafter called "Owner," in the penal sum of \_\_\_\_\_

dollars (\$ \_\_\_\_\_) in lawful money of the United States, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

THE CONDITIONS OF THIS OBLIGATIONS are such that Whereas, the Principal has or is about to enter into a certain contract with the Owner, a copy of which is hereto attached and made a part hereof for the construction of:

NOW, THEREFORE, if the Principal shall promptly make payment to all persons, firms, subcontractors and corporations furnishing material for, or performing labor in the prosecution of the work provided for in such contract, and any authorized extension or modification thereof, including all amounts due for material, lubricants, fuels, repairs on machinery, equipment and tools, consumed or used in connection with the construction of such work, and all insurance premiums on said work, and for all labor performed in such work, whether by subcontractor or otherwise, then this obligation shall be void: otherwise to remain in full for and effect.

PROVIDED, FURTHER, that the said Surety, for value received hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the contract or the work to be performed thereunder or the specifications accompanying the same shall in any wise affect it obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the contract or to the work or to the specifications.

PROVIDED, FURTHER, that no final settlement between the Owner and the Principal shall abridge the right of any beneficiary hereunder, whose claim may be unsatisfied.

IN WITNESS WHEREOF, this instrument is executed in five (5) counterparts, each one of which shall be deemed and original, this the \_\_\_\_\_ day of \_\_\_\_\_, 2022.

ATTEST:

\_\_\_\_\_  
(Principal's Corporate Secretary)

\_\_\_\_\_  
(Principal)

Affix CORPORATE SEAL if applicable

\_\_\_\_\_  
(Address-Zip Code)

\_\_\_\_\_  
(Witness as to Principal)

\_\_\_\_\_  
(Address-Zip Code)

\_\_\_\_\_  
(Surety)

ATTEST:

By: \_\_\_\_\_  
(Attorney-in-Fact)

\_\_\_\_\_  
(Surety) Secretary

\_\_\_\_\_  
(Address-Zip Code)

(Affix SURETY'S SEAL)

\_\_\_\_\_  
(Witness as to Surety)

\_\_\_\_\_  
(Address-Zip Code)

Notes:

If Principal is Partnership, all partners must execute bond. The Attorney-in-Fact, who executes this bond on behalf of the Surety, must attach a copy of her Power-of-Attorney as evidence of her authority.

## **BID BOND**

KNOW ALL THESE PRESENTS: That we \_\_\_\_\_  
(Name of Contractor)  
\_\_\_\_\_ a \_\_\_\_\_ hereinafter  
(Corporation, Partnership, Individual)  
called "Principal" and \_\_\_\_\_ of  
(Surety)  
\_\_\_\_\_, State of \_\_\_\_\_ hereinafter called the  
"Surety" are held and firmly bound unto the City of Homer, hereinafter called "Owner," in the penal sum of  
\_\_\_\_\_ dollars (\$ \_\_\_\_\_) in lawful money of the United States, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

THE CONDITIONS OF THIS OBLIGATIONS are such that: Whereas, the Principal has herewith submitted his or its BID for \_\_\_\_\_ said bid, by reference thereto, being hereby made a part hereof.

NOW, THEREFORE, if the Bid submitted by the Principal is accepted and the Contract awarded to the Principal, and if the Principal shall execute the proposed Contract and shall furnish such Performance and Payment Bond as required by the Contract Documents within the time fixed by the documents, then this obligation shall be void: if the Principal shall fail to execute the proposed Contract and furnish the Bond, the Surety hereby agrees to pay the Owner the penal sum as liquidated damages: \_\_\_\_\_

Signed and sealed this \_\_\_\_\_ day of \_\_\_\_\_, 2022

ATTEST:

\_\_\_\_\_  
(Principal's Corporate Secretary)

Affix CORPORATE SEAL if applicable

\_\_\_\_\_  
(Principal)

\_\_\_\_\_

\_\_\_\_\_  
(Address-Zip Code)

\_\_\_\_\_  
(Witness as to Principal)

\_\_\_\_\_  
(Address-Zip Code)

\_\_\_\_\_  
(Surety)

ATTEST:

By: \_\_\_\_\_  
(Attorney-in-Fact)

\_\_\_\_\_  
(Surety) Secretary

(Affix SURETY'S SEAL)

\_\_\_\_\_  
(Address Zip Code)

\_\_\_\_\_  
(Witness as to Surety)

\_\_\_\_\_  
(Address-Zip Code)

**Notes:**

If Principal is Partnership, all partners must execute bond. The Attorney-in-Fact, who executes this bond on behalf of the Surety, must attach a copy of her Power-of-Attorney as evidence of her authority.

# Project Schedule

## Main Street Sidewalk Improvement

Advertise	Homer News	April 14, April 21
	Anchorage Daily News	April, 17
Pre-Bid Site Meet via Zoom Cowles Council Chambers followed immediately by Site Visit		2:00 p.m. Monday, April 25, 2022
Bids Due		2:00 p.m. Tuesday, May 3, 2022
Notice of Intent to Award		May 4, 2022
Council Award		May 9, 2022
Notice to Proceed		May 16, 2022
Pre-Construction Meeting		May 23, 2022
Start Construction		June 1, 2022
Construction Complete		October 31, 2022



**INSTRUCTIONS TO BIDDERS**  
**City of Homer, Alaska**  
**Main Street Sidewalk Improvement**

The City of Homer, Alaska is requesting bids from qualified firms and individuals for the project described herein.

The following subjects are discussed herein to assist you in the preparation of your bid.

- I. Introduction
- II. Scope of Services
- III. General Bidding Requirements
- IV. The Bid Package
- V. Tentative Project Schedule
- VI. Instructions to Bidders
- VII. Prevailing Wages
- VIII. Equal Opportunity Employment Certification

**I. Introduction**

The City of Homer requests bids for the Main Street Sidewalk Improvement Project. The purpose of this project is to construct a sidewalk along the northern part of Main Street from Pioneer Avenue to Dehel Avenue.

All work activity associated with the project shall be completed by October 31, 2022.

**II. Scope of Services**

The proposed work is located within the limits of the City of Homer and is illustrated on the plans entitled City of Homer Public Works Department Main Street Sidewalk Improvement Project.

The project consists of furnishing all labor, materials, equipment, tools, supervision and other facilities necessary for the performance of the work described herein and shown on the project drawings. The work includes, but is not limited to:

- Furnishing and installation of 154 tons of asphalt sidewalk that will be placed along an approximately 2,900 foot section of Main Street from Pioneer Avenue to Dehel Avenue.
- Furnishing and installation of 2,927 feet of curb and gutter, including 9 curb ramps.
- Removal of pavement (2,474 SY), existing sidewalk (43 SY), culvert pipe (605 LF), curb and gutter (73 LF) and two trees.
- Performing 2,480 CY of unclassified excavation.
- Backfilling with 95 CY of type II classified fill and 3,255 CY of type III classified fill and laying of 470 tons of leveling course.
- Furnishing and installation of 20 CSP culvert sections including 152 LF of 12 inch culvert, 267 LF of 18 inch culvert and 310 LF of 24 inch culvert. This shall include end sections from 18 and 24 inch culverts.
- Installation of new signs and salvaging of existing signs.
- Furnishing and installation of 7 storm sewer manholes, 8 Inlets and reconstruction of 8 existing manholes.

- Reconstruction of 10 driveways and 5 approaches.
- Furnishing and installation of 1,667 SY of topsoil and spread 25 lbs. of seeds.
- Adjustment of 3 fire hydrants, 15 valve boxes and a water manhole.

### **III. General Bidding Requirements**

The work must be performed by a Contractor skilled and regularly engaged in the type of work called for under the Contract. Bidders must have a current contractor's license issued by the State of Alaska. The license must apply to the work described in the Invitation. The City's local bidder preference requirements apply to this contract. State prevailing wage rates will apply.

An electronic copy of Plans and Specifications is available on the City's website <http://www.cityofhomer-ak.gov/rfps> or you may purchase hard copies at the Office of the City Clerk upon payment of \$100 per set (\$150 for overnight delivery). City of Homer Standard Construction Specifications 2011 Edition (containing general contract provisions) may also be downloaded from the city's website. All fees are non-refundable. The City of Homer reserves the right to accept or reject any or all bids, to waive irregularities or informalities in the bids, and to award the contract to the lowest responsive, responsible bidder.

**Performance and Payment bonds** in the amount of 100 percent (100%) of the bid amount are required.

Bids must be submitted on the Bid Form and be received by **2:00 PM on Tuesday, May 3, 2022** at the Office of the City Clerk, City of Homer 491 E. Pioneer Avenue, Homer, Alaska, 99603. **A bid bond is required.** Cashier checks in an amount equal to five percent (5%) of the bid are acceptable. Surety bonds are acceptable.

**A Pre-Bid Meeting will be held at 2:00 p.m. on Monday, April 25, 2022** at the Cowles Council Chamber, City Hall 491 E Pioneer Ave Homer, Alaska 99603. This meeting will be conducted simultaneously via Zoom. Invitations will be distributed to all bidders listed on the Plan Holder's List maintained by the City Clerk's Office.

A Site Visit will be conducted immediately following the meeting.

### **IV. The Bid Package**

**The City of Homer requires a two-part Bid Package, Part A and Part B. Each portion of the Bid Package must be submitted in separate envelopes, which shall be combined into one single Bid Package, marked with the name of the project and the time/date of the bid opening.**

**At the bid opening, Part B is opened first and must be complete or Part A will not be opened and the bid will be rejected.**

**Part A** of the bid contains:

- a. Bid Form
- b. Bid Bond

Part A must be submitted, as part of the Bid Package, in a separate envelope marked Part A.



**Part B** of the bid contains:

- a. Addenda Acknowledgment Form
- b. If signature on the Bid is by an agent, other than an Officer of a Corporation, or of a member of a Co-partnership, a Power of Attorney must be submitted in Part B.
- c. EEO-1 Certification
- d. Equal Employment Opportunity Clause (Provided with the bid package)

Part B must be submitted, as part of the Bid Package, in a separate envelope marked Part B.

**V. Tentative Project Schedule**

- Pre-bid Conference 2:00 p.m. on Monday, April 25, 2022
- Bids Due 2:00 p.m. on Tuesday, May 3, 2022
- Notice of Intent to Award May 4, 2022
- Award by City Council May 9, 2022
- Notice to Proceed May 16, 2022
- Pre-Construction Meeting May 23, 2022
- Start Construction June 1, 2022
- Contract Completion October 31, 2022

**VI. Instructions to Bidders**

The City of Homer intends to award the contract to the lowest responsive, responsible bidder but reserves the right to accept or reject any or all proposals, to waive irregularities or informalities in the bids or bid process, and to award the contract to the bidder that best meets the criteria stated below.

**A. Qualification of Bidders**

It is the intention of the City of Homer to award this contract to the Bidder who furnishes satisfactory evidence they have the requisite experience, ability and sufficient capital, facilities and plant to prosecute the work successfully (and properly) and to complete it within the time allowed in the Contract at the least cost to the City of Homer for dollars spent for value received. Bidders will be required to fill out a questionnaire attesting to their qualifications.

**B. Taxes**

Attention is directed to the requirements of the General Conditions regarding the payment of taxes. All taxes that are lawfully assessed against Owner or Contractor in connection with the work shall be paid by the Contractor. The Bid prices shall include all such taxes.

The City of Homer is exempt from local sales taxes. The Contractor shall not include sales tax markup in his bid. However, in order to recoup sales tax the Contractor might pay at local vendors, the Contractor must secure a Tax Exempt card from the Kenai Peninsula Borough Tax Department.

**C. Familiarization with the Work**

Before submitting its Bid, each prospective Bidder shall familiarize itself with the work, labor conditions and all laws, regulations and other factors affecting performance of the work. Bidders shall carefully correlate their observations with the requirements of the Contract Documents and otherwise satisfy themselves of the expense and difficulties attending performance of the work. The submission of a Bid shall constitute an acknowledgement that the Bidder has thoroughly examined and is familiar with the Contract Documents and the provisions thereof. The failure or neglect of a Bidder to receive or examine any of the Bid Documents shall in no way relieve the bidder from any obligations with the respect to their Bid or to the Contract. Misinterpretation or a reputed lack of knowledge concerning the Bid will not serve as a basis for a claim for additional compensation.

Each Bidder shall visit the site of the work and completely inform themselves relative to construction hazards and procedures, the availability of lands, the character and quantity of surface and subsurface materials and utilities to be encountered, the arrangement and conditions of existing structures and facilities, the procedure necessary for maintenance of uninterrupted operations of existing facilities, the character of construction equipment and facilities needed for performance of the work, and facilities for transportation, handling and storage of materials and equipment. All such factors shall be properly investigated and considered in the preparation of the Bid.

#### **D. Interpretation of Bid Documents**

All questions about the meaning or intent of the Contract Documents shall be submitted to the Office of the Director of Public Works in writing. Replies will be issued by Addenda and delivered to all parties recorded by the City Clerk's Office as having received the Bidding documents. **The City of Homer will not be held responsible for questions received less than (5) calendar days prior to the date of opening of Bids.** Only questions answered by formal written Addenda will be binding. Oral and other interpretations or clarifications will be without legal effect.

**The Bidder shall acknowledge receipt of all Addenda on the Addendum Form, which shall be properly signed by the Bidder and placed in Part B.**

It shall be the Bidder's responsibility to inquire as to addenda issued. **Failure to include the Addenda Form in Part B of the Bid Package shall result in the Bid being rejected as non-responsive.**

#### **E. Bid Bond**

Each Bid shall be accompanied by a Bid Bond duly completed on the suggested form provided by a guaranty company authorized to conduct business in the State of Alaska, along with a General Power of Attorney form, if applicable, for payment to the City in the sum of five percent (5%) of the total amount of the Bid. **Failure to include the Bid Bond in Part A of the Bid Package shall result in the Bid being rejected as non-responsive.**

The amount payable to the City under the Bid Bond or the certified or cashier's check, as the case may be, shall be forfeited to the City in case of a failure or neglect of the Bidder to furnish, execute, and deliver to the City required Performance and Payment Bonds, Evidences of Insurance, necessary forms or material required by the Bid or failure to enter into, execute and deliver to the City the Contract on the form provided therefor, **within ten (10) working days after receipt of "Notice of Intent to Award Contract" by the City that the Contract**

is ready for execution. The "Award of Contract" will be made upon the execution of the Contract by the Bidder and the City.

#### **F. Return of Bid Guarantee**

Within thirty (30) days after the Bids are opened, the City will return the Bid Guarantees accompanying the Bids, which are not to be considered in making the award. The bid Guarantees of the three (3) lowest responsive Bids will be held until the Contract has been fully executed after which time the Guarantees will be returned to the respective Bidders whose Bids the Guarantees accompanied.

#### **G. Contract Time**

The Contract Time is an essential part of the Contract and it will be necessary for each Bidder to satisfy the City of his ability to complete the work within the time set forth in the Bid form. Provisions for delays, liquidated damages, and extensions of time are set forth in the Standard Construction Specifications. Time is of the essence in this contract.

#### **H. Preparation of Bids**

Bids must be submitted on the forms provided by the City and completed in all respects as required by the Bid Documents. Bids shall include all information requested herein, and be manually signed by the Bidder or the Bidder's duly authorized representative, with the Bidder's address and phone number. If the signature is by an agent, other than an Officer of a Corporation, or a member of a Co-partnership, a Power of Attorney must be submitted in Part B of the Bid; otherwise, the Bid will be rejected as non-responsive. **All Bids must be regular in every respect, and no alterations shall be made to the Bid form.**

If erasures or changes appear on the forms, each must be initialed by the person signing the Bid. No oral, telegraphic, electronic or telephone proposals will be considered.

Bid Packages, containing separate envelopes for Part A and Part B of the bid, will be received at the City Clerk's Office located at City Hall 491 East Pioneer Avenue, Homer, Alaska 99603, until the time indicated on the Invitation to Bid. Each Bid shall be submitted enclosed in a sealed, opaque envelope. **The envelope shall have the Bid title and date of Bid opening on the lower left-hand corner of the Bid Package.** The City is not responsible for the premature opening of, or failure to open, a bid not properly addressed and identified.

No consideration will be given by the City to a claim or error unless such claim is made to the City in writing within two (2) hours after the time of Bid opening. Written verification and supporting evidence of the error shall be delivered to the City Clerk within 24 hours of the Bid Opening (not including Saturday, Sunday or legal holidays) to allow consideration of the claim for error. Supporting evidence shall be original documents, including cost breakdown sheets, supplier quotes and other documents used to compute the Bid.

It is the bidder's responsibility to see that Bid Packages are deposited at the time and place set forth for the public opening of Bids. Bids not received by the time will not be considered responsive and shall not be considered.

### **VII. Labor Rates**

#### **State Labor Rates.**

This project is covered by the State of Alaska Title 36 Laborer's and Mechanic's Minimum Rate of Pay (AS 36.05.010 & 36.05.050) Pamphlet No. 600, Issue 44, Effective April 1, 2022. It is the responsibility of the bidder to determine the current rates of pay required and to submit the proper certified payrolls to the State Department of Labor.

## **VIII. Equal Opportunity Employment**

Bidders must submit forms related to Equal Employment Opportunity with their bids, including:

- Equal Employment Opportunity Clause (Provided with the bid package)
- EEO-1 Certification

**BID FORM****Main Street Sidewalk Improvement**

<b>ITEM NO.</b>	<b>SPEC NO.</b>	<b>BID ITEM DESCRIPTION</b>	<b>UNIT</b>	<b>QUAN TITY*</b>	<b>UNIT BID PRICE</b>	<b>TOTAL BID PRICE</b>
1	101	Mobilization & Demobilization	LS	1		
2	102	Construction Survey	LS	1		
3	103	Traffic Control	LS	1		
4	202	Grubbing & Clearing	Acre	1.5		
5	203	Removal of Obstructions	LS	1		
7	204	Unclassified Excavation	CY	2,480		
8	205	Type II Classified Fill	CY	95		
9	205	Type III Classified Fill	CY	3,255		
10	206	Levelling Course	TON	470		
11	220-1	Reconstruct Approach	EA	5		
12	220-2	Reconstruct Driveway	EA	10		
13	302	Curb & Gutter, Type 1	LF	2,927		
14	304	Curb Ramp	EA	9		
15	401	HMA, Type II; Class A	TON	270		
16	404	Install Asphalt Sidewalk	TON	154		
17	512	Adjust Manhole Ring	EA	1		
18	515-1	Reconstruct Existing Manhole	EA	8		
19	515-2	Inlet, Type A	EA	8		
20	607	Adjust Valve Box	EA	15		

21	609	Adjust Fire Hydrant	EA	3		
22	702	Geotextile Fabric	SY	1,900		
23	707	Standard Signs	EA	6		
24	707	Salvage Sign	EA	6		
25	708	Seeding	LB	25		
26	710	Topsoil	SY	1,667		
27	711	SWPPP Implementation	LS	1		
28	712	Reconstruct Fence	LF	40		
29	802	Furnish & Install CSP 12 Inch	LF	152		
30	802	Furnish & Install CSP 18 Inch	LF	267		
31	802	Furnish & Install CSP 24 Inch	LF	310		
32	802	Furnish & Install CSP 18 Inch End Section	EA	4		
33	802	Furnish & Install CSP 24 Inch End Section	EA	1		
34	804	Storm Drain Manhole	EA	7		

**Grand Total All Bid Items: \$**\_\_\_\_\_

Name of Bidding Company\_\_\_\_\_

Address of Bidding Company\_\_\_\_\_

Signature of Company Representative \_\_\_\_\_ Date \_\_\_\_\_

Printed Name of Company Representative\_\_\_\_\_

Phone#/Email\_\_\_\_\_

\*The quantities given are the basic bid and the additive alternative combined as shown on sheets C1 and C2 of the plans.

## **SPECIAL PROVISIONS**

### **Main Street Sidewalk Improvement**

The construction contract for this project will be administered in accordance with the General Provisions of the City's Standard Construction Specifications (2011).

### **MODIFICATIONS TO GENERAL PROVISIONS**

#### **SP - 1: Section 10.04 – Add New Article 4.6 – Scope of Work**

The Work included under this Contract consists of furnishing all labor, materials, equipment, supervision, and other facilities necessary to successfully complete the Work set forth in the drawings, specifications, and the terms of the Contract, including, but not limited to the following work:

- Furnishing and installation of 154 tons of asphalt sidewalk that will be placed along an approximately 2,900 foot section of Main Street from Pioneer Avenue to Dehel Avenue.
- Furnishing and installation of 2,927 feet of curb and gutter, including 9 curb ramps.
- Removal of pavement (2,474 SY), existing sidewalk (43 SY), culvert pipe (605 LF), curb and gutter (73 LF) and two trees.
- Performing 2,480 CY of unclassified excavation.
- Backfilling with 95 CY of type II classified fill and 3,255 CY of type III classified fill and laying of 470 tons of leveling course.
- Furnishing and installation of 20 CSP culvert sections including 152 LF of 12 inch culvert, 267 LF of 18 inch culvert and 310 LF of 24 inch culvert. This shall include end sections from 18 and 24 inch culverts.
- Installation of new signs and salvaging of existing signs.
- Furnishing and installation of 7 storm sewer manholes, 8 Inlets and reconstruction of 8 existing manholes.
- Reconstruction of 10 driveways and 5 approaches.
- Reconstruction of 40 LF of fence.
- Furnishing and installation of 1,667 SY of topsoil and spread 25 lbs. of seeds.
- Adjustment of 3 fire hydrants, 15 valve boxes and a water manhole.
- Work required for SWPPP Implementation.
- Traffic Control.

The quantities given are the basic bid and the additive alternative combined as shown on sheets C1 and C2 of the plans.

#### **SP – 2 Article 5.12 – Temporary Erosion Control During Construction**

Add the following language:

“The City has prepared a Storm Water Pollution Prevention Plan (SWPPP), which will be included in the bid package. The Contractor is required to implement the Best Management Practices in the SWPPP and otherwise comply with the terms of the SWPPP. Compensation will be paid under Bid Item #20, SWPPP Implementation.”

**SP - 3: Article 5.19 - Easement and Rights-of-way**

Add the following language:

“The Contractor will be provided access to a laydown area for material storage, job shack, and other uses. The location of this area will be shown in the site map.”

**SP - 4: Article 5.25 - Unusual Work Hours**

Add the following sentence:

“The noise level from work completed before 8:00 AM and after 8:00 PM cannot exceed 75 db at a distance of 50 feet.”

**MODIFICATIONS TO STANDARD SPECIFICATIONS**

**DIVISION 100 GENERAL DIVISION**

**SP - 5: Modify Subsection 102.1 General**

Add the following paragraph:

“The Contractor shall submit all survey data with each pay application; Field Books with sketches, professionally scaled plan set redlines, electronic survey coordinates. These items shall be submitted in entirety within 10 days of the project completion. In addition, the as-built information shall also be in NAD 83 datum, the City of Homer will provide the coordinate system at the time of contract award.”

**DIVISION 200 EARTHWORK**

**SP - 6: Add Section 220 Driveways**

**220.1 General**

Construct residential or commercial driveways at the locations shown on the plans.



**220.2 Material**

Use materials that conform to the standards of the main roadway.

**220.3 Construction**

Construct driveways to the dimensions shown on the plans.

**220.4 Method of Measurement**

Driveways shall be measured as units complete in place.

**220.5 Basis of Payment**

The accepted quantities of reconstructed driveways and reconstructed approaches shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
220-1	Reconstruct Approach	EA
<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
220-2	Reconstruct Driveway	EA

**DIVISION 300 PORTLAND CEMENT CONCRETE**

**SP - 7: Add Section 304 Curb Ramps**

**304.1 General**

This work shall consist of the construction of curb ramps in conformance with the plans.

**304.2 Material**

The Portland Cement concrete and all other materials used in construction of curb ramps must conform to *Division 300 – Standard Construction Specifications for Portland Cement Concrete – Subsection 301.3 Material*. Concrete mix for curb ramps shall conform to requirements for the Class AA-3.

**304.3 Construction**

Construct curb ramps according to the details and the locations shown on the Plans. Follow the construction requirements of Subsection 303.3. Give the exposed concrete surface a coarse broom finish. Install detectable warnings.

Measure curb ramp slopes with a 24-inch electronic level. Calibrate and operate the level according to the manufacturer's instructions.

**304.4 Method of Measurement**

Curb ramps shall be measured as units complete in place.

**304.5 Basis of Payment**

The accepted quantity of curb ramps shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
304	Curb Ramp	EA

**DIVISION 400 ASPHALT CONCRETE PAVEMENT**

**SP - 8: Add Section 404 Asphalt Sidewalks**

**404.1 General**

This work shall consist of the construction of asphalt sidewalks in conformance with the plans.

**404.2 Material**

- A. Bed Course Material:** Crushed stone or crushed gravel, consisting of sound, tough, durable pebbles or rock fragments of uniform quality. Free from clay balls, vegetable matter, or other deleterious matters. Meet Table 404.2.1:

**Table 404.2.1: Aggregate Properties for Base and Surface Course**

<b>PROPERTY</b>	<b>BASE COURSE</b>	<b>SURFACE COURSE</b>	<b>TEST METHOD</b>
L.A. Wear, %	50, max.	45, max.	AASHTO T 96

Degradation Value	45, min.	45, min.	ATM 313
Fracture, %	70, min.	70, min., 1 Face	ATM 305
Liquid Limit	---	35, max.	ATM 204
Plastic Index	6, max.	10, max	ATM 205
Sodium Sulfate Loss	9, max. (5 cycles)	9, max. (5 cycles)	AASHTO T 104

**B. Asphalt Binder:** Meet AASHTO M320 for the specified performance grade. Use PG 52-28 if no grade is specified.

**C. Aggregate, Type II or III:** Process and crush aggregate that is free from clay balls, organic matter, other deleterious material, and not coated with dirt or other finely divided mineral matter. Aggregate used must consist of sound, tough, durable rock of uniform quality.

Remove all natural fines passing a No. 4 sieve before crushing aggregates for Type IV mixes.

Coarse Aggregate. Aggregate retained on the No. 4 Sieve.

Meet Table 404.2.2:

**Table 404.2.2: Coarse Aggregate Quality for HMA**

Description	Specification	Type II, Class A	Type I, Type II Class B, Type III	Type IV	Type V	Type SP
L.A. Wear, % max.	AASHTO T96	45	45	45	45	45
Degradation Value, min.	ATM 313	30	30	30	30	30
Sodium Sulfate Loss, % max. (5 cycles)	AASHTO T104	9	9	9	9	9
Fracture, % min.	ATM 305	90, 2 face	80, 1 face	90, 2 face	98, 2 face	90, 2 face
Flat-Elongated Pieces, % max. 1:5	ATM 306	8	8	8	8	8
Absorption, % max.	ATM 308	2.0	2.0	2.0	2.0	2.0
Nordic Abrasion, % max.	ATM 312	---	---	---	8.0	8.0

Fine Aggregate. Aggregate passing the No. 4 sieve. Fine aggregate shall meet the quality requirements of AASHTO M29, including S1.1, Sulfate Soundness.

Fine aggregate for Type II, Class A mix shall not contain more than 20 % natural fines (blend sand and mineral filler) added to the crushed aggregate, and shall not exhibit rut depth larger than 6.0 mm as determined by ATM 419.

Fine aggregate for Type IV mixes:

- Do not blend natural sand
- Shall be non-plastic as determined by ATM 205
- Shall have a minimum uncompacted void content (Fine Aggregate Angularity) determined by AASHTO T304, Method A, of 45%

**Table 404.2.3: Broad Band Gradations for Not Mix Asphalt Aggregate**  
Percent Passing by Weight

Sieve	Gradation					
	Type I	Type II	Type III	Type IV	Type V	Type SP
<b>1 inch</b>	100					
<b>¾ inch</b>	80-90	100			100	100
<b>½ inch</b>	60-84	75-90	100	100	65-90	90-100
<b>3/8 inch</b>	48-78	60-84	80-90	80-95	55-80	74-90
<b>No. 4</b>	28-63	33-70	44-81	55-70	40-60	42-54
<b>No. 8</b>	15-55	19-56	26-70	35-50	≤ 45	25-35
<b>No. 16</b>	9-44	10-44	16-59	20-40	≤ 35	---
<b>No. 30</b>	6-34	7-34	9-49	15-30	≤ 25	---
<b>No. 50</b>	5-24	5-24	6-36	10-24	≤ 20	---
<b>No. 100</b>	4-16	4-16	4-22	5-15	≤ 12	---
<b>No. 200</b>	4-7	4-7	4-7	4-7	4-7	2-10

- D. Mix design Requirements (ATM 417):**  
 Marshall Stability, lb., min. 1000  
 Percent Voids, Total Mix 2-5  
 Compaction, Blows/side 50

**404.3 Construction**

Place bed course material in layers. Compact it according to Subsection 401.3.

Place asphalt material on the compacted bed course in one or more courses as indicated on the Plans. Compact it uniformly to the required depth. Use a power roller of

an acceptable type and weight. In areas inaccessible to the roller, use other approved methods.

**404.4 Method of Measurement**

Asphalt sidewalk shall be measured as TONS in place.

**404.5 Basis of Payment**

The accepted quantity of asphalt sidewalk shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
404	Asphalt Sidewalk	TON

**DIVISION 500 SEWER SYSTEMS**

**SP – 9: Add Section 515 Reconstruct Manholes and Inlets**

**515.1 General**

This work shall consist of the reconstruction of existing manholes and the construction of new inlets in accordance with the plans.

**515.2 Material**

All materials used in the reconstruction of existing manholes or the construction of inlets must conform to *Division 500 – Standard Construction Specifications for Sewer Systems – Subsection 503.2 Material*.

**515.3 Construction**

Install inlets consisting of a precast concrete catch basin box, risers, metal frame and grate as shown on the Plans. Grout pipes into place.

Use full mortar joints no more than 1/2 inch wide.

Fit each pipe section flush on the inside of the structure wall and to project far enough outside to connect properly with the next pipe section. Fit masonry neatly and tightly around the pipe. Construct invert channels in all manholes used for sanitary or combined sanitary

and storm sewers. Construct channels to be smooth and semicircular to conform to the inside of the adjacent sewer sections. Make changes in flow direction along a smooth curve with as large a radius as the manhole size permits. Make gradual and even changes in channel size and grade.

Form invert channels by using any of the following methods:

1. Directly in manhole concrete base
2. Built up with brick and mortar
3. Laying half tile in concrete
4. Breaking out the top one-half of full sections of pipe, laid through the manhole, after the surrounding concrete has hardened

Reconstruct or replace components of existing manhole or manhole top section by using one or more of the following methods:

1. Bring the manhole frame and cover to grade if you remove the cone for lowering.
2. Raise the manhole frame and cover more than 12 inches.
3. Reconstruct a portion of the manhole with no change in line or grade.
4. Tap one or more additional pipes into an existing manhole.
5. Rotate the manhole cone to align the lid to the shoulder, lane line, or middle of driving lane.
6. Rotate the manhole cone to align the inlet casting to the curb line.
7. Align the access stairs by rotating the barrel sections or install new steps.

Reconstruct the manhole or manhole top section to the required elevation so that it conforms to plan details. Complete this work according to the requirements for new construction. Reuse material only if the Engineer approves.

Do not impede existing sewer flow during construction.

#### **515.4 Method of Measurement**

Reconstructed manholes and inlets shall be measured as units complete in place.

#### **515.5 Basis of Payment**

The accepted quantities of reconstructed manholes and inlets shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
-----------------	--------------------	-------------

515-1	Reconstruct Existing Manhole	EA
<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
515-2	Inlet, Type ( )	EA

**DIVISION 600 WATER SYSTEMS**

**SP - 10: Add Section 609 Adjust Existing Fire Hydrant**

**609.1 General**

This work shall consist of adjustment of fire hydrants in accordance with the plans.

**609.2 Construction**

Tighten stuffing boxes and inspect the hydrants in opened and closed positions to make sure that all parts are in working condition.

Adjust existing fire hydrants for grade, using barrel extensions according to the hydrant manufacturer's recommendations.

**609.3 Method of Measurement**

Adjust fire hydrants shall be measured as units complete in place.

**609.4 Basis of Payment**

The accepted quantity of adjusted fire hydrants shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
609	Adjust Fire Hydrant	EA

**DIVISION 700 MISCELANEOUS CONSTRUCTION**

**SP - 11: Add Section 711 SWPPP Implementation**

**711.1 General**

This work shall consist of the construction and maintenance of BMPs in accordance with the SWPPP and the performance of all other work required by the SWPPP.

**711.2 Method of Measurement**

SWPPP Implementation shall be measured as a lump sum.

**711.3 Basis of Payment**

The accepted quantity of SWPPP Implementation shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
711	SWPPP Implementation	LS

**SP - 12: Add Section 712 Reconstruct Fence**

**712.1 General**

This work shall consist of reconstruction of existing fences.

**712.2 Method of Measurement**

Reconstruct Fence shall be measured as units complete in place.

**712.3 Basis of Payment**

The accepted quantity of reconstructed fence shall be paid at the contract unit price, complete and in place.

Payment will be made under:

<u>Pay Item</u>	<u>Description</u>	<u>Unit</u>
712	Reconstruct Fence	EA



- Joint Reporting Committee
- Equal Employment Opportunity Commission
  - Office of Federal Contract Compliance Programs (Labor)

# EQUAL EMPLOYMENT OPPORTUNITY

## EMPLOYER INFORMATION REPORT EEO-1

Standard Form 100  
REV. 01/2006

O.M.B. No. 3045-0007  
EXPIRES 01/2009  
100-214

### Section A—TYPE OF REPORT

Refer to instructions for number and types of reports to be filed.

1. Indicate by marking in the appropriate box the type of reporting unit for which this copy of the form is submitted (MARK ONLY ONE BOX).

(1)  Single-establishment Employer Report

Multi-establishment Employer:

(2)  Consolidated Report (Required)

(3)  Headquarters Unit Report (Required)

(4)  Individual Establishment Report (submit one for each establishment with 50 or more employees)

(5)  Special Report

2. Total number of reports being filed by this Company (Answer on Consolidated Report only) \_\_\_\_\_

### Section B—COMPANY IDENTIFICATION (To be answered by all employers)

1. Parent Company

OFFICE  
USE  
ONLY

a. Name of parent company (owns or controls establishment in item 2) omit if same as label

a.

Address (Number and street)

b.

City or town

State

ZIP code

c.

2. Establishment for which this report is filed. (Omit if same as label)

a. Name of establishment

d.

Address (Number and street)

City or Town

County

State

ZIP code

e.

b. Employer identification No. (IRS 9-DIGIT TAX NUMBER)

f.

c. Was an EEO-1 report filed for this establishment last year?  Yes  No

### Section C—EMPLOYERS WHO ARE REQUIRED TO FILE (To be answered by all employers)

Yes  No 1. Does the entire company have at least 100 employees in the payroll period for which you are reporting?

Yes  No 2. Is your company affiliated through common ownership and/or centralized management with other entities in an enterprise with a total employment of 100 or more?

Yes  No 3. Does the company or any of its establishments (a) have 50 or more employees AND (b) is not exempt as provided by 41 CFR 60-1.5, AND either (1) is a prime government contractor or first-tier subcontractor, and has a contract, subcontract, or purchase order amounting to \$50,000 or more, or (2) serves as a depository of Government funds in any amount or is a financial institution which is an issuing and paying agent for U.S. Savings Bonds and Savings Notes?

If the response to question C-3 is yes, please enter your Dun and Bradstreet identification number (if you have one):

NOTE: If the answer is yes to questions 1, 2, or 3, complete the entire form, otherwise skip to Section G.

**Section D - EMPLOYMENT DATA**

Employment at this establishment - Report all permanent full- and part-time employees including apprentices and on-the-job trainees unless specifically excluded as set forth in the instructions. Enter the appropriate figures on all lines and in all columns. Blank spaces will be considered as zeros.

Job Categories	Number of Employees (Report employees in only one category)														Total Col A-N
	Race/Ethnicity														
	Hispanic or Latino		Not-Hispanic or Latino							Female					
	Male	Female	White	Black or African American	Native Hawaiian or Other Pacific Islander	Asian	American Indian or Alaska Native	Two or more races	White	Black or African American	Native Hawaiian or Other Pacific Islander	Asian	American Indian or Alaska Native	Two or more races	
A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	
Executive/Senior Level Officials and Managers	1.1														
First/Mid-Level Officials and Managers	1.2														
Professionals	2														
Technicians	3														
Sales Workers	4														
Administrative Support Workers	5														
Craft Workers	6														
Operatives	7														
Laborers and Helpers	8														
Service Workers	9														
TOTAL	10														
PREVIOUS YEAR TOTAL	11														

1. Date(s) of payroll period used: \_\_\_\_\_ (Omit on the Consolidated Report.)

**Section E - ESTABLISHMENT INFORMATION (Omit on the Consolidated Report.)**

1. What is the major activity of this establishment? (Be specific, i.e., manufacturing steel castings, retail grocer, wholesale plumbing supplies, title insurance, etc. Include the specific type of product or type of service provided, as well as the principal business or industrial activity.)

**Section F - REMARKS**

Use this item to give any identification data appearing on the last EEO-1 report which differs from that given above, explain major changes in composition of reporting units and other pertinent information.

**Section G - CERTIFICATION**

Check 1  All reports are accurate and were prepared in accordance with the instructions. (Check on Consolidated Report only.)  
 Check 2  This report is accurate and was prepared in accordance with the instructions.

Name of Certifying Official	Title	Signature	Date
Name of person to contact regarding this report	Title	Address (Number and Street)	
City and State	Zip Code	Telephone No. (including Area Code and Extension)	Email Address

All reports and information obtained from individual reports will be kept confidential as required by Section 705(e) of Title VII. WILLFULLY FALSE STATEMENTS ON THIS REPORT ARE PUNISHABLE BY LAW, U.S. CODE, TITLE 18, SECTION 1001

## **EQUAL EMPLOYMENT OPPORTUNITY CLAUSE**

During the performance of this contract, the contractor agrees to comply with OFCC Regulations 40 CFR 60.1.4 (1) through (7) as follows:

1. The contractor will not discriminate against any employee or applicant for employment because of race, color, religion, sex or national origin. The contractor will take affirmative action to ensure that applicants are employed, and that employees are treated during employment without regard to their race, color, religion, sex, or national origin. Such action shall include, but not be limited to the following: Employment, upgrading, demotion, or transfer, recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided by the contracting officer setting forth the provisions of this nondiscrimination clause.

2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, color, religion, sex, or national origin.

1. The contractor will send to each labor union or representative of workers with whom he has a collective bargaining agreement or other contract or understanding, a notice to be provided by the agency contracting officer, advising the labor union or workers' representative of the contractor's commitments under Section 202 of Executive Order 11246 of September 24, 1965 and shall post copies of the notice in conspicuous places available to employees and applicants for employment.

2. The contractor will comply with all provisions of executive order 11246 of September 24, 1965 and of the rules, regulations, and relevant orders of the Secretary of Labor.

3. The contractor will furnish all information and reports required by Executive Order 11246 of September 24, 1965 and by the rules, regulations, and orders of the secretary of labor, or pursuant thereto, and will permit access of his books, records, and accounts by the contracting agency and the secretary of Labor for purposes of investigation to ascertain compliance with such rules, regulations, and orders.

4. In the event of the contractor's noncompliance with the nondiscrimination clauses of this contract or with any such rules, regulations or orders, this contract may be canceled, terminated or suspended in whole or in part and the contractor may be declared ineligible for further government contracts in accordance with procedures authorized in executive order 11246 of September 24, 1965 and such other sanctions may be imposed and remedies invoked as provided in executive order 11246 of September 24, 1965 or by rule, regulation or order of the Secretary of Labor as otherwise provided by law.

5. The contractor will include the provisions of paragraphs (1) through (7) in every subcontract or purchase order unless exempted by rules, regulations, or orders of the Secretary of Labor issued pursuant to section 204 of Executive Order 11246 of September 24, 1965 so that such provisions will be binding upon each subcontractor or vendor. The contractor will take such action with respect to any subcontract or purchase order as the contracting agency may direct as a means of enforcing such provisions including sanctions for noncompliance: Provided, however that in the event the contractor becomes involved in, or is threatened with litigation with a subcontractor or vendor as a result of such direction by the contracting agency, the contractor may request the United States to enter into such litigation to protect the interest of the United States.

\_\_\_\_\_  
(Signature)

\_\_\_\_\_  
(Title)

\_\_\_\_\_  
(Date)

This form (2 pages) must be included with the Bid Part B, or the Bid will be considered non-responsive.

ADDENDA ACKNOWLEDGMENT

Project Name: \_\_\_\_\_

I hereby acknowledge addenda numbers:

_____	_____
_____	_____
_____	_____

Name of Firm: \_\_\_\_\_

Signature of Bidder: \_\_\_\_\_

Date: \_\_\_\_\_

**This Acknowledgement must be included in the Bid/Proposal for the project if any Addenda are issued or the Bid/Proposal could be considered non-responsive.**



**CONTRACTOR'S QUESTIONNAIRE  
NOTICE TO CONTRACTORS**

Prior to Award, this questionnaire shall be completely filled out for the project upon which a bid is submitted.

**A. FINANCIAL**

1. Have you ever failed to complete a contract on account of insufficient resources?  
\_\_\_\_\_

2. Have you made sufficient arrangements to finance the work? \_\_\_\_\_

If so, with whom and for what amount? \_\_\_\_\_  
\_\_\_\_\_

If so, with what company? \_\_\_\_\_

**B. EQUIPMENT**

1. Set forth below the equipment which you have available for the work, which you propose to do. This equipment should be listed in detail (General statements will not be accepted).

NO.	ITEMS	TYPE	SIZE/CAPACITY	PRESENT VALUE

2. Do you thoroughly understand that in case the contract is awarded to you, you may be required to use any or all of the equipment listed on the work covered by this contract?  
\_\_\_\_\_

3. Do you propose to purchase any equipment for use on this project should the contract be awarded to you? If so, state type, quantity and approximate cost.  
\_\_\_\_\_  
\_\_\_\_\_

4. Do you propose to rent any equipment for this work? \_\_\_\_\_  
If so, state type, quantity, and reason for renting. \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

5. Have you made contracts or received firm offers for all necessary materials with the prices used in preparing your proposal? \_\_\_\_\_

6. Do you intend to plan to subcontract any of the work? \_\_\_\_\_  
If so, what types or portions of the work. \_\_\_\_\_  
\_\_\_\_\_

Approximate value \$ \_\_\_\_\_ Percent of total bid \_\_\_\_\_

**C. EXPERIENCE**

1. How many years has your organization been in business as a general contractor under your present business name? \_\_\_\_\_

2. How many years of experience in construction work has your organization had:

a) As a General Contractor \_\_\_\_\_.

b) As a Subcontractor \_\_\_\_\_.

3. List previous contracts you have completed of a similar nature to this proposed contract:

a) \_\_\_\_\_

b) \_\_\_\_\_

c) \_\_\_\_\_

d) \_\_\_\_\_

e) \_\_\_\_\_

4. List projects which you currently have under contract or expect to have under contract during the life of this contract:

a) \_\_\_\_\_

b) \_\_\_\_\_

c) \_\_\_\_\_

Use additional sheets as necessary.

5. List your staff you plan to use on this project and the position they will fill for this project (include managerial and clerical personnel that will provide support services).

**STAFF MEMBER**

**POSITION**

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Signature: \_\_\_\_\_

Title: \_\_\_\_\_



A photograph of a construction site. In the foreground, a worker in a white hard hat and orange safety vest is on a scissor lift, working on a wall of dark grey panels. Another worker in a red hard hat and orange safety vest is visible on a higher level of the building. The background shows a blue building and a green mountain.

# MINIMUM RATES OF PAY For Laborers and Mechanics

Effective April 1, 2022

Issue 44

PAMPHLET No. 600

Title 36. Public Contracts

AS 36.05

DEPARTMENT OF LABOR  
AND WORKFORCE DEVELOPMENT  
Wage and Hour

- This page intentionally left blank -



April 1, 2022

**TO ALL CONTRACTING AGENCIES:**

At the Alaska Department of Labor and Workforce Development, our goal is putting Alaskans to work. This pamphlet is designed to help contractors awarded public construction contracts understand the most significant laws of the State of Alaska pertaining to prevailing wage.

This pamphlet identifies current prevailing wage rates for public construction contracts (any construction projects awarded for the State of Alaska or its political subdivisions, such as local governments and certain non-profit organizations). Because these rates may change in a subsequent determination, please be sure you are using the appropriate rates. The rates published in this edition become effective April 1, 2022.

The prevailing wage rates contained in this pamphlet are applicable to public construction projects with a final bid date of April 11, 2022, or later. As the law now provides, these rates will remain stable during the life of a contract or for 24 calendar months, whichever is shorter. **The 24-month period begins on the date the prime contract is awarded.** Upon expiration of the initial 24-month period, the latest wage rates issued by the department shall become effective for a subsequent 24-month period or until the original contract is completed, whichever occurs first. This process shall be repeated until the original contract is completed.

The term "original contract" means the signed contract that resulted from the original bid and any amendments, including changes of work scope, additions, extensions, change orders, and other instruments agreed to by the parties that have not been subject to subsequent open bid procedures.

If a higher federal rate is required due to partial federal funding or other federal participation, the higher rate must be paid.

For additional copies of this pamphlet go to: <http://labor.state.ak.us/lss/pamp600.htm>

For questions regarding prevailing wage or employment preference requirements, please contact the nearest Wage and Hour office. These offices are listed on Page x.

Sincerely,

A handwritten signature in black ink that reads "Tamika L. Ledbetter".

Dr. Tamika L. Ledbetter  
Commissioner

- This page intentionally left blank -

# Table of Contents

## Excerpts from Alaska Law

Sec. 36.05.005. Applicability.....	iv
Sec. 36.05.010. Wage rates on public construction. ....	iv
Sec. 36.05.040. Filing schedule of employees, wages paid and other information .....	iv
Sec. 36.05.045. Notice of work and completion; withholding of payment .....	iv
Sec. 36.05.060. Penalty for violation of this chapter .....	v
Sec. 36.05.070. Wage rates in specifications and contracts for public works .....	v
Sec. 36.05.080. Failure to pay agreed wages.....	v
Sec. 36.05.090. Payment of wages from withheld payments and listing contractors who violate contracts .....	v
Sec. 36.05.900. Definition.. .....	vi

## Excerpts from Alaska Administrative Code

8 AAC 30.051. Purpose .....	vi
8 AAC 30.052. Board and lodging; remote sites .....	vi
8 AAC 30.054. Per diem instead of board and lodging .....	vi
8 AAC 30.056. Alternative arrangement.....	vii
8 AAC 30.900. General definitions (selected excerpts).....	vii

## Additional Information

Per Diem .....	vii
Laborer Classification Clarification.....	viii
Apprentice Rates.....	viii
Fringe Benefit Plans.....	viii
Special Prevailing Wage Rate Determination.....	ix
Alaska Employment Preference Information.....	ix
Labor Standards and Safety Notice Requests .....	x
Debarment List .....	x

**Wage Rates** ..... Pages 1-26

**Shipyard Rate Addendum**.....Pages 28

**Note to Readers:** The statutes and administrative regulations listed in this publication were taken from the official codes, as of the effective date of the publication. However, there may be errors or omissions that have not been identified and changes that occurred after the publication was printed. This publication is intended as an informational guide only and is not intended to serve as a precise statement of the statutes and regulations of the State of Alaska. To be certain of current laws and regulations, please refer to the official codes.

## EXCERPTS FROM ALASKA LAW

### **Sec. 36.05.005. Applicability.**

This chapter applies only to a public construction contract that exceeds \$25,000.

### **Sec. 36.05.010. Wage rates on public construction.**

A contractor or subcontractor who performs work on a public construction contract in the state shall pay not less than the current prevailing rate of wages for work of a similar nature in the region in which the work is done. The current prevailing rate of wages is that contained in the latest determination of prevailing rate of wages issued by the Department of Labor and Workforce Development at least 10 days before the final date for submission of bids for the contract. The rate shall remain in effect for the life of the contract or for 24 calendar months, whichever is shorter. At the end of the initial 24-month period, if new wage determinations have been issued by the department, the latest wage determination shall become effective for the next 24-month period or until the contract is completed, whichever occurs first. This process shall be repeated until the contract is completed.

### **Sec. 36.05.040. Filing schedule of employees, wages paid, and other information.**

All contractors or subcontractors who perform work on a public construction contract for the state or for a political subdivision of the state shall, before the Friday of every second week, file with the Department of Labor and Workforce Development a sworn affidavit for the previous reporting period, setting out in detail the number of persons employed, wages paid, job classification of each employee, hours worked each day and week, and other information on a form provided by the Department of Labor and Workforce Development.

### **Sec. 36.05.045. Notice of work and completion; withholding of payment.**

- (a) Before commencing work on a public construction contract, the person entering into the contract with a contracting agency shall designate a primary contractor for purposes of this section. Before work commences, the primary contractor shall file a notice of work with the Department of Labor and Workforce Development. The notice of work must list work to be performed under the public construction contract by each contractor who will perform any portion of work on the contract and the contract price being paid to each contractor. The primary contractor shall pay all filing fees for each contractor performing work on the contract, including a filing fee based on the contract price being paid for work performed by the primary contractor's employees. The filing fee payable shall be the sum of all fees calculated for each contractor. The filing fee shall be one percent of each contractor's contract price. The total filing fee payable by the primary contractor under this subsection may not exceed \$5,000. In this subsection, "contractor" means an employer who is using employees to perform work on the public construction contract under the contract or a subcontract.
- (b) Upon completion of all work on the public construction contract, the primary contractor shall file with the Department of Labor and Workforce Development a notice of completion together with payment of any additional filing fees owed due to increased contract amounts. Within 30 days after the department's receipt of the primary contractor's notice of completion, the department shall inform the contracting agency of the amount, if any, to be withheld from the final payment.
- (c) A contracting agency
  - (1) may release final payment of a public construction contract to the extent that the agency has received verification from the Department of Labor and Workforce Development that
    - (A) the primary contractor has complied with (a) and (b) of this section;
    - (B) the Department of Labor and Workforce Development is not conducting an investigation under this title; and
    - (C) the Department of Labor and Workforce Development has not issued a notice of a violation of this chapter to the primary contractor or any other contractors working on the public construction contract; and

- (2) shall withhold from the final payment an amount sufficient to pay the department's estimate of what may be needed to compensate the employees of any contractors under investigation on this construction contract, and any unpaid filing fees.
- (d) The notice and filing fee required under (a) of this section may be filed after work has begun if
  - (1) The public construction contract is for work undertaken in immediate response to an emergency; and
  - (2) The notice and fees are filed not later than 14 days after the work has begun.
- (e) A false statement made on a notice required by this section is punishable under AS 11.56.210.

**Sec. 36.05.060. Penalty for violation of this chapter.**

A contractor who violates this chapter is guilty of a misdemeanor and upon conviction is punishable by a fine of not less than \$100 nor more than \$1,000, or by imprisonment for not less than 10 days nor more than 90 days, or by both. Each day a violation exists constitutes a separate offense.

**Sec. 36.05.070. Wage rates in specifications and contracts for public works.**

- (a) The advertised specifications for a public construction contract that requires or involves the employment of mechanics, laborers, or field surveyors must contain a provision stating the minimum wages to be paid various classes of laborers, mechanics, or field surveyors and that the rate of wages shall be adjusted to the wage rate under AS 36.05.010.
- (b) Repealed by §17 ch 142 SLA 1972.
- (c) A public construction contract under (a) of this section must contain provisions that
  - (1) the contractor or subcontractors of the contractor shall pay all employees unconditionally and not less than once a week;
  - (2) wages may not be less than those stated in the advertised specifications, regardless of the contractual relationship between the contractor or subcontractors and laborers, mechanics, or field surveyors;
  - (3) the scale of wages to be paid shall be posted by the contractor in a prominent and easily accessible place at the site of the work;
  - (4) the state or a political subdivision shall withhold so much of the accrued payments as is necessary to pay to laborers, mechanics, or field surveyors employed by the contractor or subcontractors the difference between
    - (A) the rates of wages required by the contract to be paid laborers, mechanics, or field surveyors on the work; and
    - (B) the rates of wages in fact received by laborers, mechanics, or field surveyors.

**Sec. 36.05.080. Failure to pay agreed wages.**

Every contract within the scope of AS 36.05.070 shall contain a provision that if it is found that a laborer, mechanic, or field surveyor employed by the contractor or subcontractor has been or is being paid a rate of wages less than the rate of wages required by the contract to be paid, the state or its political subdivision may, by written notice to the contractor, terminate the contractor's right to proceed with the work or the part of the work for which there is a failure to pay the required wages and to prosecute the work to completion by contract or otherwise, and the contractor and the contractor's sureties are liable to the state or its political subdivision for excess costs for completing the work.

**Sec. 36.05.090. Payment of wages from withheld payments and listing contractors who violate contracts.**

- (a) The state disbursing officer in the case of a state public construction contract and the local fiscal officer in the case of a political subdivision public construction contract shall pay directly to laborers, mechanics, or field surveyors from accrued payments withheld under the terms of the contract the wages due laborers, mechanics, or field surveyors under AS 36.05.070.
- (b) The state disbursing officer or the local fiscal officer shall distribute to all departments of the state government and to all political subdivisions of the state a list giving the names of persons who have disregarded their obligations to employees. A person appearing on this list and a firm, corporation, partnership, or association in which the person has an interest may not work as a contractor or

subcontractor on a public construction contract for the state or a political subdivision of the state until three years after the date of publication of the list. If the accrued payments withheld under the contract are insufficient to reimburse all the laborers, mechanics, or field surveyors with respect to whom there has been a failure to pay the wages required under AS 36.05.070, the laborers, mechanics, or field surveyors have the right of action or intervention or both against the contractor and the contractor's sureties conferred by law upon persons furnishing labor or materials, and in the proceedings it is not a defense that the laborers, mechanics, or field surveyors accepted or agreed to accept less than the required rate of wages or voluntarily made refunds.

**Sec. 36.05.900. Definition.**

In this chapter, "contracting agency" means the state or a political subdivision of the state that has entered into a public construction contract with a contractor.

**EXCERPTS FROM ALASKA ADMINISTRATIVE CODE**

\*\*\***Notice:** Regulations relating to board and lodging and per diem went into effect on November 25, 2018. The new regulations are excerpted here\*\*\*

**8 AAC 30.051. Purpose.** The purpose of 8 AAC 30.052 – 8 AAC 30.056 is to ensure that wages paid to laborers, mechanics, and field surveyors do not fall below the prevailing rate of pay.

**8 AAC 30.052. Board and lodging; remote sites.** (a) A contractor on a public construction project located 65 or more road miles from the international airport closest to the project area in either Fairbanks, Juneau, or Anchorage, or that is inaccessible by road in a two-wheel drive vehicle, shall provide adequate board and lodging to each laborer, mechanic, or field surveyor while the person is employed on the project. If commercial lodging facilities are not available, the contractor shall provide temporary lodging facilities. Lodging facilities must comply with all applicable state and federal laws. For a highway project, the location of the project is measured from the midpoint of the project.

(b) A contractor is not required to provide board and lodging:

(1) to a laborer, mechanic, or field surveyor who is a domiciled resident of the project area; or

(2) on a laborer, mechanic, or field surveyor's scheduled days off, when the person can reasonably travel between the project and the person's permanent residence; for the purposes of this paragraph, "scheduled day off" means a day in which a person does not perform work on-site, is not required to remain at or near the job location for the benefit of the contractor, and is informed of the day off at least seven days before the day off.

(c) Upon a contractor's written request, the commissioner may waive the requirements of (a) of this section where:

(1) the project is inaccessible by road in a two-wheel drive vehicle, but the laborer, mechanic, or field surveyor can reasonably travel between the project and the person's permanent residence within one hour; or

(2) a laborer, mechanic, or field surveyor is not a domiciled resident of the project area, but has established permanent residence, with the intent to remain indefinitely, within 65 road miles of the project, or for a highway project, the mid-point of the project.

**8 AAC 30.054. Per diem instead of board and lodging.** (a) A contractor may pay a laborer, mechanic, or field surveyor per diem instead of providing board and lodging, when the following conditions are met:

(1) the department determines that per diem instead of board and lodging is an established practice for the work classification; the department shall publish and periodically revise its determinations in the pamphlet *Laborers and Mechanics Minimum Rates of Pay*;

(2) the contractor pays each laborer, mechanic, or field surveyor the appropriate per diem rate as published and periodically revised in the pamphlet *Laborers and Mechanics Minimum Rates of Pay*; and



(3) the contractor pays the per diem to each laborer, mechanic, or field surveyor on the same day that wages are paid.

(b) A contractor may not pay per diem instead of board and lodging on a highway project located

- (1) west of Livengood on the Elliot Highway, AK-2;
- (2) on the Dalton Highway, AK-11;
- (3) north of milepost 20 on the Taylor Highway, AK-5;
- (4) east of Chicken on the Top of the World Highway; or
- (5) south of Tetlin Junction to the Alaska-Canada border on the Alaska Highway, AK-2.

**8 AAC 30.056. Alternative arrangement.** Upon a contractor’s written request, the commissioner may approve an alternative board and lodging or per diem arrangement, provided

- (1) the arrangement does not reduce the laborer, mechanic, or field surveyor’s wages below the prevailing wage rate; and
- (2) the laborer, mechanic, or field surveyor voluntarily enters into and signs the written arrangement; a labor organization representing laborers, mechanics, or field surveyors may enter into the written agreement on their behalf.

**8 AAC 30.900. General definitions** (selected excerpts only):

In this chapter and in AS 36

(22) “domiciled resident” means a person living within 65 road miles of a public construction project, or in the case of a highway project, the mid-point of the project, for at least 12 consecutive months prior to the award of the public construction project;

(23) “employed on the project” means the time period from the date the laborer, mechanic, or field surveyor first reports on-site to the project through the final date the person reports on-site to the project.

## **ADDITIONAL INFORMATION**

### **PER DIEM**


**Notice:** New regulations relating to board and lodging and per diem went into effect on November 25, 2018. The regulations provide a comprehensive set of requirements for the provision of board and lodging or per diem for workers on remote projects. Please refer to Alaska Administrative Code 8 AAC Chapter 30 and read the chapter carefully.

The Alaska Department of Labor and Workforce Development has determined that per diem is an established work practice for certain work classifications. These classifications are indicated throughout the Pamphlet by an asterisk (\*) under the classification title. If all of the conditions of 8 AAC 30.054 are met, an employer may pay workers in these classifications per diem instead of providing board and lodging on a remote project.

**Per Diem Rate:** As of May 1<sup>st</sup>, 2019, the minimum per diem rate is \$100.00 per day, or part thereof, the worker is employed on the project. In the event that a contractor provides lodging facilities, but no meals, the department will accept a payment of \$48 per day for meals to meet the per diem requirements.

### LABORER CLASSIFICATION CLARIFICATION

The laborer rates categorized in class code S1201-S1206 apply in one area of Alaska; the area that is south of N63 latitude and west of W138 Longitude. The laborer rates categorized in class code N1201-N1206 apply in two areas of Alaska; the Alaska areas north of N63 latitude and east of W138 longitude. The following graphic representations should assist with clarifying the applicable wage rate categories:

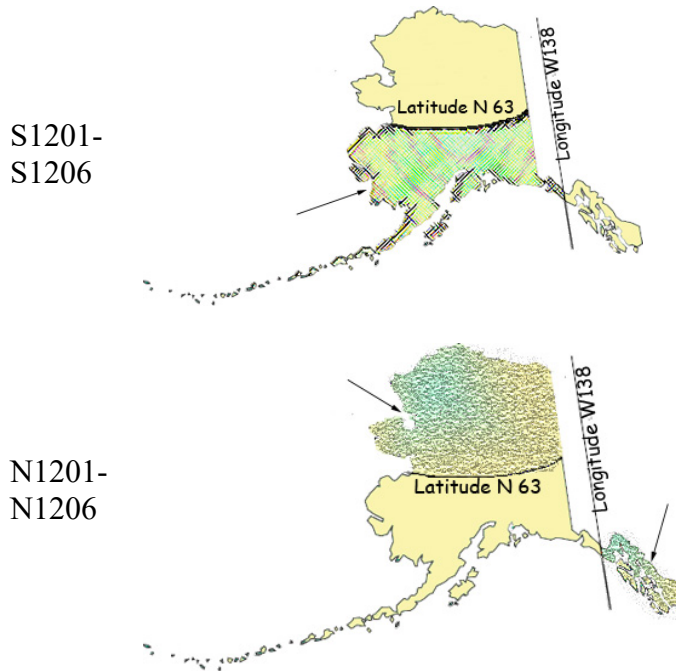

### APPRENTICE RATES

Apprentice rates at less than the minimum prevailing rates may be paid to apprentices according to an apprentice program which has been registered and approved by the Commissioner of the Alaska Department of Labor and Workforce Development in writing or according to a bona fide apprenticeship program registered with the U.S. Department of Labor, Office of Apprenticeship Training. **Any employee listed on a payroll at an apprentice wage rate who is not registered as above shall be paid the journeyman prevailing minimum wage in that work classification.** Wage rates are based on prevailing crew makeup practices in Alaska and apply to work performed regardless of either the quality of the work performed by the employee or the titles or classifications which may be assigned to individual employees.

### FRINGE BENEFIT PLANS

Contractors/subcontractors may compensate fringe benefits to their employees in any one of three methods. The fringe benefits may be paid into a union trust fund, into an approved benefit plan, or paid directly on the paycheck as gross wages.

Where fringe benefits are paid into approved plans, funds, or programs including union trust funds, the payments must be contributed at least monthly. If contractors submit their own payroll forms and are paying fringe benefits into approved plans, funds, or programs, the employer's certification must include, in addition to those requirements of 8 AAC 30.020(c), a statement that fringe benefit payments have been or will be paid at least monthly. Contractors who pay fringe benefits to a plan must ensure the plan is one approved by the Internal Revenue Service and that the plan meets the requirements of 8 AAC 30.025 (eff. 3/2/08) in order for payments to be credited toward the prevailing wage obligation.

**SPECIAL PREVAILING WAGE RATE DETERMINATION**

Special prevailing wage rate determinations may be requested for special projects or a special worker classification if the work to be performed does not conform to traditional public construction for which a prevailing wage rate has been established under 8 AAC 30.050(a) of this section. Requests for special wage rate determinations must be in writing and filed with the Commissioner at least 30 days before the award of the contract. An applicant for a special wage rate determination shall have the responsibility to support the necessity for the special rate. An application for a special wage rate determination filed under this section must contain:

- (1) a specification of the contract or project on which the special rates will apply and a description of the work to be performed;
- (2) a brief narrative explaining why special wage rates are necessary;
- (3) the job class or classes involved;
- (4) the special wage rates the applicant is requesting, including survey or other relevant wage data to support the requested rates;
- (5) the approximate number of employees who would be affected; and
- (6) any other information which might be helpful in determining if special wage rates are appropriate.

Requests made pursuant to the above should be addressed to:

Director  
Alaska Department of Labor and Workforce Development  
Labor Standards and Safety Division  
Wage and Hour  
P.O. Box 111149  
Juneau, AK 99811-1149

-or-

Email: [statewide.wagehour@alaska.gov](mailto:statewide.wagehour@alaska.gov)

**EMPLOYMENT PREFERENCE INFORMATION**

In October 2019, the Alaska Attorney General issued a formal opinion stating that the Alaska Statutes 36.10.150 of the State’s 90% Employment Preference law, also known as the Alaska Resident Hire law, violates both the U.S. and Alaska Constitutions. As a result, the state has stopped all enforcement activity.

A copy of the Attorney General opinion is found here:

[http://law.alaska.gov/pdf/opinions/opinions\\_2019/19-005\\_AK-hire.pdf](http://law.alaska.gov/pdf/opinions/opinions_2019/19-005_AK-hire.pdf)

**Alaska Department of Labor and Workforce Development  
Labor Standards and Safety Division  
Wage and Hour**

Web site: <http://labor.state.ak.us/lss/pamp600.htm>

**Anchorage**

1251 Muldoon Road, Suite 113  
Anchorage, Alaska 99504-2098  
Phone: (907) 269-4900

Email:  
statewide.wagehour@alaska.gov

**Juneau**

PO Box 111149  
Juneau, Alaska 99811  
Phone: (907) 465-4842

Email:  
statewide.wagehour@alaska.gov

**Fairbanks**

Regional State Office Building  
675 7<sup>th</sup> Ave., Station J-1  
Fairbanks, Alaska 99701-4593  
Phone: (907) 451-2886

Email:  
statewide.wagehour@alaska.gov

**LABOR STANDARDS AND SAFETY NOTICE REQUESTS**

If you would like to receive Wage and Hour or Mechanical Inspection **regulation notices** or **publications information**, they are available via electronic mail, by signing up in the GovDelivery System, <https://public.govdelivery.com/accounts/AKDOL/subscriber/new> and selecting topics *LSS – Wage and Hour – Forms and Publications*, *LSS – Mechanical Inspection Regulations*, or *LSS – Wage and Hour Regulations*.

*Publications* are also available online at <http://labor.alaska.gov/lss/home.htm>

**DEBARMENT LIST**

**AS 36.05.090(b)** states that “the state disbursing officer or the local fiscal officer shall distribute to all departments of the state government and to all political subdivisions of the state a list giving the names of persons who have disregarded their obligations to employees.”

A person appearing on the following debarment list and a firm, corporation, partnership, or association in which the person has an interest may not work as a contractor or subcontractor on a public construction contract for the state or a political subdivision of the state for three years from the date of debarment.

Company Name

Debarment Expires

No companies are currently debarred.

# Laborers' & Mechanics' Minimum Rates of Pay

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other Benefits	THR
------------	--	-----	-----	-----	-----	----------------	-----

## Boilermakers

\*See per diem note on last page

<b>A0101</b>	Boilermaker (journeyman)	46.97	8.57	18.08	1.90	VAC 4.25 SAF 0.34	80.11
--------------	--------------------------	-------	------	-------	------	----------------------	-------

## Bricklayers & Blocklayers

\*See per diem note on last page

<b>A0201</b>	Blocklayer	42.01	9.00	10.20	0.62	L&M 0.20	62.03
--------------	------------	-------	------	-------	------	----------	-------

Bricklayer  
Marble or Stone Mason  
Refractory Worker (Firebrick, Plastic, Castable, and Gunitite Refractory Applications)  
Terrazzo Worker  
Tile Setter

<b>A0202</b>	Tuck Pointer Caulker	42.01	9.00	10.20	0.62	L&M 0.20	62.03
--------------	----------------------	-------	------	-------	------	----------	-------

Cleaner (PCC)

<b>A0203</b>	Marble & Tile Finisher	35.84	9.00	10.20	0.62	L&M 0.20	55.86
--------------	------------------------	-------	------	-------	------	----------	-------

Terrazzo Finisher

<b>A0204</b>	Torginal Applicator	35.84	9.00	10.20	0.62	L&M 0.20	55.86
--------------	---------------------	-------	------	-------	------	----------	-------

## Carpenters, Region I (North of 63 latitude)

\*See per diem note on last page

<b>N0301</b>	Carpenter (journeyman)	42.34	10.08	15.23	1.75	L&M 0.20 SAF 0.20	69.80
--------------	------------------------	-------	-------	-------	------	----------------------	-------

Lather/Drywall/Acoustical

## Carpenters, Region II (South of N63 latitude)

\*See per diem note on last page

<b>S0301</b>	Carpenter (journeyman)	42.34	10.08	15.77	1.75	L&M 0.20 SAF 0.20	70.34
--------------	------------------------	-------	-------	-------	------	----------------------	-------

Lather/Drywall/Acoustical

## Cement Masons

\*See per diem note on last page

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Cement Masons**  
 \*See per diem note on last page

<b>A0401</b>	Group I, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
--------------	---------------------	-------	------	-------	------	--	------------------------	-------

- Application of Sealing Compound
- Application of Underlayment
- Building, General
- Cement Finisher
- Cement Mason (journeyman)
- Concrete
- Concrete Paving
- Concrete Polishing
- Concrete Repair
- Curb & Gutter, Sidewalk
- Curing of All Concrete
- General Concrete Pour Tender
- Grouting & Caulking of Tilt-Up Panels
- Grouting of All Plates
- Patching Concrete
- Screed Pin Setter
- Screeder or Rodder
- Spackling/Skim Coating

<b>A0402</b>	Group II, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
--------------	----------------------	-------	------	-------	------	--	------------------------	-------

- Form Setter

<b>A0403</b>	Group III, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
--------------	-----------------------	-------	------	-------	------	--	------------------------	-------

- Concrete Saw Cutter Operator (All Control Joints and Self-powered)
- Curb & Gutter Machine
- Floor Grinder
- Pneumatic Power Tools
- Power Chipping & Bushing
- Sand Blasting Architectural Finish
- Screed & Rodding Machine Operator
- Troweling Machine Operator (all concrete surfaces)

<b>A0404</b>	Group IV, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
--------------	----------------------	-------	------	-------	------	--	------------------------	-------

- Acoustical or Imitation Acoustical Finish
- Application of All Composition Mastic
- Application of All Epoxy Material
- Application of All Plastic Material
- Finish Colored Concrete
- Gunite Nozzleman
- Hand Powered Grinder

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Cement Masons**  
\*See per diem note on last page

<b>A0404</b>	Group IV, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
	Preparing, scratching and browsing of all ceilings and walls, finished with terrazo or tile							
	Tunnel Worker							

<b>A0405</b>	Group V, including:	40.13	8.70	11.80	1.43		<b>L&amp;M</b> 0.10	62.16
	Casting and finishing							
	EIFS Systems							
	Finishing of all interior and exterior plastering							
	Fireproofing (Pryocrete, Cafco, Albi-Clad, sprayed fiberglass)							
	Gypsum, Portland Cement							
	Kindred material and products							
	Operation and control of all types of plastering machines, including power tools and floats, used by the industry							
	Overcoating and maintenance of interior/exterior plaster surfaces							
	Plasterer							
	Veneer plastering process (Rapid Plaster, U.S.G. "Imperial Systems", and Pabcoat Systems")							
	Venetian plaster and color-integrated Italian/Middle-Eastern line plaster							

**Culinary Workers**

<b>A0501</b>	Baker/Cook	28.37	7.31	7.56			<b>LEG</b>	43.24
<b>A0503</b>	General Helper	25.07	7.31	7.56			<b>LEG</b>	39.94
	Housekeeper							
	Janitor							
	Kitchen Helper							
<b>A0504</b>	Head Cook	28.97	7.31	7.56			<b>LEG</b>	43.84
<b>A0505</b>	Head Housekeeper	25.45	7.31	7.56			<b>LEG</b>	40.32
	Head Kitchen Help							

**Dredgemen**  
\*See per diem note on last page

<b>A0601</b>	Assistant Engineer	42.76	11.05	13.75	1.00		<b>L&amp;M</b> 0.10	0.05	68.71
	Craneman								

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	L&M	Other Benefits	THR
<b>Dredgemen</b>								
*See per diem note on last page								
<b>A0601</b>	Assistant Engineer	42.76	11.05	13.75	1.00	0.10	0.05	68.71
	Electrical Generator Operator (primary pump/power barge/dredge)							
	Engineer							
	Welder							
<b>A0602</b>	Assistant Mate (deckhand)	41.60	11.05	13.75	1.00	0.10	0.05	67.55
<b>A0603</b>	Fireman	42.04	11.05	13.75	1.00	0.10	0.05	67.99
<b>A0605</b>	Leverman Clamshell	45.29	11.05	13.75	1.00	0.10	0.05	71.24
<b>A0606</b>	Leverman Hydraulic	43.53	11.05	13.75	1.00	0.10	0.05	69.48
<b>A0607</b>	Mate & Boatman	42.76	11.05	13.75	1.00	0.10	0.05	68.71
<b>A0608</b>	Oiler (dredge)	42.04	11.05	13.75	1.00	0.10	0.05	67.99
<b>Electricians</b>								
*See per diem note on last page								
<b>A0701</b>	Inside Cable Splicer	42.77	14.23	13.92	0.95	0.20	0.15	72.22
<b>A0702</b>	Inside Journeyman Wireman, including:	42.44	14.23	14.16	0.95	0.20	0.15	72.13
	Technicians (including use of drones in electrical construction)							
<b>A0703</b>	Power Cable Splicer	63.04	14.23	19.08	0.95	0.25	0.15	97.70
<b>A0704</b>	Tele Com Cable Splicer	50.53	14.23	17.17	0.95	0.20	0.15	83.23
<b>A0705</b>	Power Journeyman Lineman, including:	61.29	14.23	19.03	0.95	0.25	0.15	95.90
	Power Equipment Operator							
	Technician (including use of drones in electrical construction)							
<b>A0706</b>	Tele Com Journeyman Lineman, including:	48.78	14.23	17.11	0.95	0.20	0.15	81.42
	Technician (including use of drones in telecommunications construction)							
	Tele Com Equipment Operator							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation



Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Electricians**  
\*See per diem note on last page

<b>A0707</b>	Straight Line Installer - Repairman	48.78	14.23	17.11	0.95	<b>L&amp;M</b>	<b>LEG</b>	81.42
<b>A0708</b>	Powderman	59.29	14.23	18.97	0.95	<b>L&amp;M</b>	<b>LEG</b>	93.84
<b>A0710</b>	Material Handler	26.57	13.92	5.80	0.15	<b>L&amp;M</b>	<b>LEG</b>	46.74
<b>A0712</b>	Tree Trimmer Groundman	29.12	14.23	13.35	0.15	<b>L&amp;M</b>	<b>LEG</b>	57.15
<b>A0713</b>	Journeyman Tree Trimmer	38.05	14.23	13.62	0.15	<b>L&amp;M</b>	<b>LEG</b>	66.35
<b>A0714</b>	Vegetation Control Sprayer	41.60	14.23	13.73	0.15	<b>L&amp;M</b>	<b>LEG</b>	70.01
<b>A0715</b>	Inside Journeyman Communications CO/PBX	41.02	14.23	13.87	0.95	<b>L&amp;M</b>	<b>LEG</b>	70.42

**Elevator Workers**  
\*See per diem note on last page

<b>A0802</b>	Elevator Constructor	44.21	16.02	20.21	0.65	<b>L&amp;M</b>	<b>VAC</b>	86.59
<b>A0803</b>	Elevator Constructor Mechanic	63.16	16.02	20.21	0.65	<b>L&amp;M</b>	<b>VAC</b>	107.65

**Heat & Frost Insulators/Asbestos Workers**  
\*See per diem note on last page

<b>A0902</b>	Asbestos Abatement-Mechanical Systems	39.50	9.24	11.12	1.20	<b>IAF</b>	<b>LML</b>	61.25
<b>A0903</b>	Asbestos Abatement/General Demolition All Systems	39.50	9.24	11.12	1.20	<b>IAF</b>	<b>LML</b>	61.25
<b>A0904</b>	Insulator, Group II	39.50	9.24	11.12	1.20	<b>IAF</b>	<b>LML</b>	61.25
<b>A0905</b>	Fire Stop	39.50	9.24	11.12	1.20	<b>IAF</b>	<b>LML</b>	61.25

**IronWorkers**  
\*See per diem note on last page

<b>A1101</b>	Ironworkers, including:	40.82	9.51	24.28	0.76	<b>L&amp;M</b>	<b>IAF</b>	75.81
--------------	-------------------------	-------	------	-------	------	----------------	------------	-------

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**IronWorkers**  
 \*See per diem note on last page

						L&M	IAF	
<b>A1101</b>	Ironworkers, including:	40.82	9.51	24.28	0.76	0.20	0.24	75.81
	Bender Operators							
	Bridge & Structural							
	Hangar Doors							
	Hollow Metal Doors							
	Industrial Doors							
	Machinery Mover							
	Ornamental							
	Reinforcing							
	Rigger							
	Sheeter							
	Signalman							
	Stage Rigger							
	Toxic Haz-Mat Work							
	Welder							

						L&M	IAF	
<b>A1102</b>	Helicopter	41.82	9.51	24.28	0.76	0.20	0.24	76.81
	Helicopter (used for rigging and setting)							
	Tower (energy producing windmill type towers to include nacelle and blades)							

						L&M	IAF	
<b>A1103</b>	Fence/Barrier Installer	37.32	9.51	24.28	0.76	0.20	0.24	72.31

						L&M	IAF	
<b>A1104</b>	Guard Rail Layout Man	38.06	9.51	24.28	0.76	0.20	0.24	73.05

						L&M	IAF	
<b>A1105</b>	Guard Rail Installer	38.32	9.51	24.28	0.76	0.20	0.24	73.31

**Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**  
 \*See per diem note on last page

						L&M	LEG	
<b>N1201</b>	Group I, including:	33.00	8.95	21.16	1.40	0.20	0.20	64.91
	Asphalt Worker (shovelman, plant crew)							
	Brush Cutter							
	Camp Maintenance Laborer							
	Carpenter Tender or Helper							
	Choke Setter, Hook Tender, Rigger, Signalman							
	Concrete Labor (curb & gutter, chute handler, curing, grouting, screeding)							
	Crusher Plant Laborer							
	Demolition Laborer							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**  
 \*See per diem note on last page

						<b>L&amp;M</b>	<b>LEG</b>	
<b>N1201</b>	Group I, including:	33.00	8.95	21.16	1.40	0.20	0.20	64.91
	Ditch Digger							
	Dumpman							
	Environmental Laborer (hazard/toxic waste, oil spill)							
	Fence Installer							
	Fire Watch Laborer							
	Flagman							
	Form Stripper							
	General Laborer							
	Guardrail Laborer, Bridge Rail Installer							
	Hydro-seeder Nozzleman							
	Laborer, Building							
	Landscaper or Planter							
	Laying of Mortarless Decorative Block (retaining walls, flowered decorative block 4 feet or less - highway or landscape work)							
	Material Handler							
	Pneumatic or Power Tools							
	Portable or Chemical Toilet Serviceman							
	Pump Man or Mixer Man							
	Railroad Track Laborer							
	Sandblast, Pot Tender							
	Saw Tender							
	Slurry Work							
	Steam Cleaner Operator							
	Steam Point or Water Jet Operator							
	Storm Water Pollution Protection Plan Worker (SWPPP Worker - erosion and sediment control Laborer)							
	Tank Cleaning							
	Utiliwalk & Utilidor Laborer							
	Watchman (construction projects)							
	Window Cleaner							

						<b>L&amp;M</b>	<b>LEG</b>	
<b>N1202</b>	Group II, including:	34.00	8.95	21.16	1.40	0.20	0.20	65.91
	Burning & Cutting Torch							
	Cement or Lime Dumper or Handler (sack or bulk)							
	Certified Erosion Sediment Control Lead (CESCL Laborer)							
	Choker Splicer							
	Chucktender (wagon, air-track & hydraulic drills)							
	Concrete Laborer (power buggy, concrete saws, pumpcrete nozzleman, vibratorman)							
	Culvert Pipe Laborer							
	Cured Inplace Pipelayer							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**

\*See per diem note on last page

<b>N1202</b>	Group II, including:	34.00	8.95	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	65.91
--------------	----------------------	-------	------	-------	------	----------------	------------	-------

- Environmental Laborer (asbestos, marine work)
- Floor Preparation, Core Drilling
- Foam Gun or Foam Machine Operator
- Green Cutter (dam work)
- Gunite Operator
- Hod Carrier
- Jackhammer/Chipping Gun or Pavement Breaker
- Laser Instrument Operator
- Laying of Mortarless Decorative Block (retaining walls, flowered decorative block over 4 feet - highway or landscape work)
- Mason Tender & Mud Mixer (sewer work)
- Pilot Car
- Pipelayer Helper
- Plasterer, Bricklayer & Cement Finisher Tender
- Powderman Helper
- Power Saw Operator
- Railroad Switch Layout Laborer
- Sandblaster
- Scaffold Building & Erecting
- Sewer Caulker
- Sewer Plant Maintenance Man
- Thermal Plastic Applicator
- Timber Faller, Chainsaw Operator, Filer
- Timberman

<b>N1203</b>	Group III, including:	34.90	8.95	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	66.81
--------------	-----------------------	-------	------	-------	------	----------------	------------	-------

- Bit Grinder
- Camera/Tool/Video Operator
- Guardrail Machine Operator
- High Rigger & Tree Topper
- High Scaler
- Multiplate
- Plastic Welding
- Slurry Seal Squeegee Man
- Traffic Control Supervisor
- Welding Certified (in connection with laborer's work)

<b>N1204</b>	Group IIIA	38.18	8.95	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	70.09
--------------	------------	-------	------	-------	------	----------------	------------	-------

- Asphalt Raker, Asphalt Belly Dump Lay Down
- Drill Doctor (in the field)

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**  
 \*See per diem note on last page

<b>N1204</b>	Group IIIA	38.18	8.95	21.16	1.40	L&M	LEG	70.09
--------------	------------	-------	------	-------	------	-----	-----	-------

- Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)
- Pioneer Drilling & Drilling Off Tugger (all type drills)
- Pipelayers
- Powderman (Employee Possessor)
- Storm Water Pollution Protection Plan Specialist (SWPPP Specialist)
- Traffic Control Supervisor, DOT Qualified

<b>N1205</b>	Group IV	22.57	8.95	21.16	1.40	L&M	LEG	54.48
--------------	----------	-------	------	-------	------	-----	-----	-------

- Final Building Cleanup
- Permanent Yard Worker

<b>N1206</b>	Group IIIB	41.97	6.24	21.16	1.40	L&M	LEG	71.17
--------------	------------	-------	------	-------	------	-----	-----	-------

- Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)(over 5,000 hours)
- Federal Powderman (Responsible Person in Charge)
- Grade Checking (setting or transferring of grade marks, line and grade, GPS, drones)
- Pioneer Drilling & Drilling Off Tugger (all type drills)(over 5,000 hours)
- Stake Hopper

**Laborers (The area that is south of N63 latitude and west of W138 longitude)**  
 \*See per diem note on last page

<b>S1201</b>	Group I, including:	33.00	8.95	21.16	1.40	L&M	LEG	64.91
--------------	---------------------	-------	------	-------	------	-----	-----	-------

- Asphalt Worker (shovelman, plant crew)
- Brush Cutter
- Camp Maintenance Laborer
- Carpenter Tender or Helper
- Choke Setter, Hook Tender, Rigger, Signalman
- Concrete Labor (curb & gutter, chute handler, curing, grouting, screeding)
- Crusher Plant Laborer
- Demolition Laborer
- Ditch Digger
- Dumpman
- Environmental Laborer (hazard/toxic waste, oil spill)
- Fence Installer
- Fire Watch Laborer
- Flagman

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Laborers (The area that is south of N63 latitude and west of W138 longitude)**

\*See per diem note on last page

						<b>L&amp;M</b>	<b>LEG</b>	
<b>S1201</b>	Group I, including:	33.00	8.95	21.16	1.40	0.20	0.20	64.91

- Form Stripper
- General Laborer
- Guardrail Laborer, Bridge Rail Installer
- Hydro-seeder Nozzleman
- Laborer, Building
- Landscaper or Planter
- Laying of Mortarless Decorative Block (retaining walls, flowered decorative block 4 feet or less - highway or landscape work)
- Material Handler
- Pneumatic or Power Tools
- Portable or Chemical Toilet Serviceman
- Pump Man or Mixer Man
- Railroad Track Laborer
- Sandblast, Pot Tender
- Saw Tender
- Slurry Work
- Steam Cleaner Operator
- Steam Point or Water Jet Operator
- Storm Water Pollution Protection Plan Worker (SWPPP Worker - erosion and sediment control Laborer)
- Tank Cleaning
- Utiliwalk & Utilidor Laborer
- Watchman (construction projects)
- Window Cleaner

						<b>L&amp;M</b>	<b>LEG</b>	
<b>S1202</b>	Group II, including:	34.00	8.95	21.16	1.40	0.20	0.20	65.91

- Burning & Cutting Torch
- Cement or Lime Dumper or Handler (sack or bulk)
- Certified Erosion Sediment Control Lead (CESCL Laborer)
- Choker Splicer
- Chucktender (wagon, air-track & hydraulic drills)
- Concrete Laborer (power buggy, concrete saws, pumpcrete nozzleman, vibratorman)
- Culvert Pipe Laborer
- Cured Inplace Pipelayer
- Environmental Laborer (asbestos, marine work)
- Floor Preparation, Core Drilling
- Foam Gun or Foam Machine Operator
- Green Cutter (dam work)
- Gunite Operator
- Hod Carrier

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Laborers (The area that is south of N63 latitude and west of W138 longitude)**

\*See per diem note on last page

						<b>L&amp;M</b>	<b>LEG</b>	
<b>S1202</b>	Group II, including:	34.00	8.95	21.16	1.40	0.20	0.20	65.91

- Jackhammer/Chipping Gun or Pavement Breaker
- Laser Instrument Operator
- Laying of Mortarless Decorative Block (retaining walls, flowered decorative block over 4 feet - highway or landscape work)
- Mason Tender & Mud Mixer (sewer work)
- Pilot Car
- Pipelayer Helper
- Plasterer, Bricklayer & Cement Finisher Tender
- Powderman Helper
- Power Saw Operator
- Railroad Switch Layout Laborer
- Sandblaster
- Scaffold Building & Erecting
- Sewer Caulker
- Sewer Plant Maintenance Man
- Thermal Plastic Applicator
- Timber Faller, Chainsaw Operator, Filer
- Timberman

						<b>L&amp;M</b>	<b>LEG</b>	
<b>S1203</b>	Group III, including:	34.90	8.95	21.16	1.40	0.20	0.20	66.81

- Bit Grinder
- Camera/Tool/Video Operator
- Guardrail Machine Operator
- High Rigger & Tree Topper
- High Scaler
- Multiplate
- Plastic Welding
- Slurry Seal Squeegee Man
- Traffic Control Supervisor
- Welding Certified (in connection with laborer's work)

						<b>L&amp;M</b>	<b>LEG</b>	
<b>S1204</b>	Group IIIA	38.18	8.95	21.16	1.40	0.20	0.20	70.09

- Asphalt Raker, Asphalt Belly Dump Lay Down
- Drill Doctor (in the field)
- Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)
- Pioneer Drilling & Drilling Off Tugger (all type drills)
- Pipelayers
- Powderman (Employee Possessor)
- Storm Water Pollution Protection Plan Specialist (SWPPP Specialist)

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Laborers (The area that is south of N63 latitude and west of W138 longitude)**

\*See per diem note on last page

<b>S1204</b>	Group IIIA	38.18	8.95	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	70.09
	Traffic Control Supervisor, DOT Qualified					0.20	0.20	
<b>S1205</b>	Group IV	22.57	8.95	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	54.48
	Final Building Cleanup Permanent Yard Worker					0.20	0.20	
<b>S1206</b>	Group IIIB	41.97	6.24	21.16	1.40	<b>L&amp;M</b>	<b>LEG</b>	71.17
	Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)(over 5,000 hours) Federal Powderman (Responsible Person in Charge) Grade Checking (setting or transferring of grade marks, line and grade, GPS, drones) Pioneer Drilling & Drilling Off Tugger (all type drills)(over 5,000 hours) Stake Hopper					0.20	0.20	

**Millwrights**

\*See per diem note on last page

<b>A1251</b>	Millwright (journeyman)	44.00	10.08	12.28	1.10	<b>L&amp;M</b>		67.91
						0.40	0.05	
<b>A1252</b>	Millwright Welder	45.00	10.08	12.28	1.10	<b>L&amp;M</b>		68.91
						0.40	0.05	

**Painters, Region I (North of N63 latitude)**

\*See per diem note on last page

<b>N1301</b>	Group I, including:	34.25	8.85	15.10	1.08	<b>L&amp;M</b>		59.35
	Brush General Painter Hand Taping Hazardous Material Handler Lead-Based Paint Abatement Roll					0.07		
<b>N1302</b>	Group II, including:	34.77	8.85	15.10	1.08	<b>L&amp;M</b>		59.87
	Bridge Painter Epoxy Applicator General Drywall Finisher Hand/Spray Texturing Industrial Coatings Specialist					0.07		

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation



**Painters, Region I (North of N63 latitude)**  
 \*See per diem note on last page

<b>N1302</b>	Group II, including:	34.77	8.85	15.10	1.08		<b>L&amp;M</b> 0.07	59.87
	Machine/Automatic Taping							
	Pot Tender							
	Sandblasting							
	Specialty Painter							
	Spray							
	Structural Steel Painter							
	Wallpaper/Vinyl Hanger							

<b>N1304</b>	Group IV, including:	41.16	8.85	18.21	1.05		0.05	69.32
	Glazier							
	Storefront/Automatic Door Mechanic							

<b>N1305</b>	Group V, including:	39.86	8.85	5.00	1.10		0.10	54.91
	Carpet Installer							
	Floor Coverer							
	Heat Weld/Cove Base							
	Linoleum/Soft Tile Installer							

<b>N1306</b>	Group VI, including:	48.17	9.90	5.00	1.10		0.10	64.27
	Traffic Control Striper							

**Painters, Region II (South of N63 latitude)**  
 \*See per diem note on last page

<b>S1301</b>	Group I, including :	31.39	8.85	15.95	1.08		<b>L&amp;M</b> 0.07	57.34
	Brush							
	General Painter							
	Hand Taping							
	Hazardous Material Handler							
	Lead-Based Paint Abatement							
	Roll							
	Spray							

<b>S1302</b>	Group II, including :	32.64	8.85	15.95	1.08		<b>L&amp;M</b> 0.07	58.59
	General Drywall Finisher							
	Hand/Spray Texturing							
	Machine/Automatic Taping							
	Wallpaper/Vinyl Hanger							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Painters, Region II (South of N63 latitude)**

\*See per diem note on last page

<b>S1303</b>	Group III, including :	32.74	8.85	15.95	1.08		<b>L&amp;M</b> 0.07	58.69
	Bridge Painter							
	Epoxy Applicator							
	Industrial Coatings Specialist							
	Pot Tender							
	Sandblasting							
	Specialty Painter							
	Structural Steel Painter							
<b>S1304</b>	Group IV, including:	41.37	8.85	17.25	1.08		<b>L&amp;M</b> 0.07	68.62
	Glazier							
	Storefront/Automatic Door Mechanic							
<b>S1305</b>	Group V, including:	39.86	8.85	5.00	1.10		<b>L&amp;M</b> 0.10	54.91
	Carpet Installer							
	Floor Coverer							
	Heat Weld/Cove Base							
	Linoleum/Soft Tile Installer							
<b>S1306</b>	Group VI, including:	48.17	9.90	5.00	1.10		0.10	64.27
	Traffic Control Striper							

**Piledrivers**

\*See per diem note on last page

<b>A1401</b>	Piledriver	42.34	10.08	15.23	1.75		<b>L&amp;M</b> 0.20	<b>IAF</b> 0.20	69.80
	Assistant Dive Tender								
	Carpenter/Piledriver								
	Rigger								
	Sheet Stabber								
	Skiff Operator								
<b>A1402</b>	Piledriver-Welder/Toxic Worker	43.34	10.08	15.23	1.75		<b>L&amp;M</b> 0.20	<b>IAF</b> 0.20	70.80
<b>A1403</b>	Remotely Operated Vehicle Pilot/Technician	46.65	10.08	15.23	1.75		<b>L&amp;M</b> 0.20	<b>IAF</b> 0.20	74.11
	Single Atmosphere Suit, Bell or Submersible Pilot								
<b>A1404</b>	Diver (working) **See note on last page	86.45	10.08	15.23	1.75		<b>L&amp;M</b> 0.20	<b>IAF</b> 0.20	113.91

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Piledrivers**  
\*See per diem note on last page

<b>A1405</b>	Diver (standby) **See note on last page	46.65	10.08	15.23	1.75	L&M	IAF	74.11
<b>A1406</b>	Dive Tender **See note on last page	45.65	10.08	15.23	1.75	L&M	IAF	73.11
<b>A1407</b>	Welder (American Welding Society, Certified Welding Inspector)	47.90	10.08	15.23	1.75	L&M	IAF	75.36

**Plumbers, Region I (North of N63 latitude)**  
\*See per diem note on last page

<b>N1501</b>	Journeyman Pipefitter	42.91	11.75	17.45	1.50	L&M	S&L	74.26
	Plumber							
	Welder							

**Plumbers, Region II (South of N63 latitude)**  
\*See per diem note on last page

<b>S1501</b>	Journeyman Pipefitter	41.00	11.38	15.27	1.55	L&M		69.40
	Plumber							
	Welder							

**Plumbers, Region IIA (1st Judicial District)**  
\*See per diem note on last page

<b>X1501</b>	Journeyman Pipefitter	40.82	13.37	11.75	2.50	L&M		68.68
	Plumber							
	Welder							

**Power Equipment Operators**  
\*See per diem note on last page

<b>A1601</b>	Group I, including:	43.53	11.05	13.75	1.00	L&M		69.48
	Asphalt Roller: Breakdown, Intermediate, and Finish							
	Back Filler							
	Barrier Machine (Zipper)							
	Belcrete with Power Pack & similar conveyors							
	Bending Machine							
	Boat Coxswain							
	Bulldozer							
	Cableways, Highlines & Cablecars							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Power Equipment Operators**

\*See per diem note on last page

	<b>L&amp;M</b>						
<b>A1601</b> Group I, including:	43.53	11.05	13.75	1.00	0.10	0.05	69.48
Cleaning Machine							
Coating Machine							
Concrete Hydro Blaster							
Cranes (45 tons & under or 150 feet of boom & under (including jib & attachments))							
(a) Hydralifts or Transporters, (all track or truck type)							
(b) Derricks							
(c) Overhead							
Crushers							
Deck Winches, Double Drum							
Ditching or Trenching Machine (16 inch or over)							
Drag Scraper, Yarder, and similar types							
Drilling Machines, Core, Cable, Rotary and Exploration							
Finishing Machine Operator, Concrete Paving, Laser Screed, Sidewalk, Curb & Gutter Machine							
Grade Checker and/or Line and Grade including Drone							
Helicopters							
Hover Craft, Flex Craft, Loadmaster, Air Cushion, All-Terrain Vehicle, Rollagon, Bargecable, Nodwell, & Snow Cat							
Hydro Ax, Feller Buncher & similar							
Hydro Excavation (Vac-Truck and Similar)							
Loaders (2 1/2 yards through 5 yards, including all attachments):							
(a) Forklifts (with telescopic boom & swing attachment)							
(b) Front End & Overhead, (2-1/2 yards through 5 yards)							
(c) Loaders, (with forks or pipe clamp)							
(d) Loaders, (elevating belt type, Euclid & similar types)							
Material Transfer Vehicle (Elevating Grader, Pickup Machine, and similar types)							
Mechanic, Welder, Bodyman, Electrical, Camp & Maintenance Engineer							
Micro Tunneling Machine							
Mixers: Mobile type with hoist combination							
Motor Patrol Grader							
Mucking Machine: Mole, Tunnel Drill, Horizontal/Directional Drill Operator and/or Shield							
Off-Road Hauler (including Articulating and Haul Trucks)							
Operator on Dredges							
Piledriver Engineer, L.B. Foster, Puller or similar paving breaker							
Plant Operator (Asphalt & Concrete)							
Power Plant, Turbine Operator 200 k.w & over (power plants or combination of power units over 300 k.w.)							
Remote Controlled Equipment							
Scraper (through 40 yards)							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

<b>Power Equipment Operators</b>								
*See per diem note on last page								

		L&M						
<b>A1601</b>	Group I, including:	43.53	11.05	13.75	1.00	0.10	0.05	69.48
	Service Oiler/Service Engineer							
	Shot Blast Machine							
	Shovels, Backhoes, Excavators with all attachments, and Gradealls (3 yards & under)							
	Sideboom (under 45 tons)							
	Sub Grader (Gurries & similar types)							
	Tack Tractor							
	Truck Mounted Concrete Pump, Conveyor/Tele-belt, & Creter							
	Wate Kote Machine							

		L&M						
<b>A1602</b>	Group IA, including:	45.29	11.05	13.75	1.00	0.10	0.05	71.24
	Camera/Tool/Video Operator (Slipline)							
	Certified Welder, Electrical Mechanic, Camp Maintenance Engineer, Mechanic (over 10,000 hours)							
	Cranes (over 45 tons or 150 feet including jib & attachments)							
	(a) Clamshells & Draglines (over 3 yards)							
	(b) Tower Cranes							
	Licensed Water/Waste Water Treatment Operator							
	Loaders (over 5 yards)							
	Motor Patrol Grader, Dozer, Grade Tractor (finish: when finishing to final grade and/or to hubs, or for asphalt)							
	Power Plants (1000 k.w. & over)							
	Profiler, Reclaimer, and Roto-Mill							
	Quad							
	Scrapers (over 40 yards)							
	Screed							
	Shovels, Backhoes, Excavators with all attachments (over 3 yards)							
	Sidebooms (over 45 tons)							
	Slip Form Paver, C.M.I. & similar types							
	Topside (Asphalt Paver, Slurry machine, Spreaders, and similar types)							

		L&M						
<b>A1603</b>	Group II, including:	42.76	11.05	13.75	1.00	0.10	0.05	68.71
	Boiler - Fireman							
	Cement Hogs & Concrete Pump Operator							
	Conveyors (except those listed in Group I)							
	Hoists on Steel Erection, Towermobiles & Air Tuggers							
	Horizontal/Directional Drill Locator							
	Locomotives, Rod & Geared Engines							
	Mixers							
	Screening, Washing Plant							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Power Equipment Operators**  
 \*See per diem note on last page

		<b>L&amp;M</b>						
<b>A1603</b>	Group II, including:	42.76	11.05	13.75	1.00	0.10	0.05	68.71
	Sideboom (cradling rock drill, regardless of size)							
	Skidder							
	Trenching Machines (under 16 inches)							
	Water/Waste Water Treatment Operator							

		<b>L&amp;M</b>						
<b>A1604</b>	Group III, including:	42.04	11.05	13.75	1.00	0.10	0.05	67.99
	"A" Frame Trucks, Deck Winches							
	Bombardier (tack or tow rig)							
	Boring Machine							
	Brooms, Power (sweeper, elevator, vacuum, or similar)							
	Bump Cutter							
	Compressor							
	Farm Tractor							
	Forklift, Industrial Type							
	Gin Truck or Winch Truck (with poles when used for hoisting)							
	Hoists, Air Tuggers, Elevators							
	Loaders:							
	(a) Elevating-Athey, Barber Greene & similar types							
	(b) Forklifts or Lumber Carrier (on construction job sites)							
	(c) Forklifts, (with tower)							
	(d) Overhead & Front End, (under 2-1/2 yards)							
	Locomotives: Dinkey (air, steam, gas & electric) Speeders							
	Mechanics, Light Duty							
	Oil, Blower Distribution							
	Posthole Digger, Mechanical							
	Pot Fireman (power agitated)							
	Power Plant, Turbine Operator, (under 200 k.w.)							
	Pumps, Water							
	Roller (other than Asphalt)							
	Saws, Concrete							
	Skid Hustler							
	Skid Steer (with all attachments)							
	Stake Hopper							
	Straightening Machine							
	Tow Tractor							

		<b>L&amp;M</b>						
<b>A1605</b>	Group IV, including:	35.83	11.05	13.75	1.00	0.10	0.05	61.78
	Crane Assistant Engineer/Rig Oiler							
	Drill Helper							
	Parts & Equipment Coordinator							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Power Equipment Operators**  
 \*See per diem note on last page

<b>A1605</b>	Group IV, including:	35.83	11.05	13.75	1.00	<b>L&amp;M</b>		61.78
	Spotter					0.10	0.05	
	Steam Cleaner							
	Swamper (on trenching machines or shovel type equipment)							

**Roofers**  
 \*See per diem note on last page

<b>A1701</b>	Roofer & Waterproofer	44.62	13.75	3.91	0.81	<b>L&amp;M</b>		63.25
						0.10	0.06	

<b>A1702</b>	Roofer Material Handler	31.23	13.75	3.91	0.81	<b>L&amp;M</b>		49.86
						0.10	0.06	

**Sheet Metal Workers, Region I (North of N63 latitude)**  
 \*See per diem note on last page

<b>N1801</b>	Sheet Metal Journeyman	49.04	11.85	14.61	1.80	<b>L&amp;M</b>		77.42
	Air Balancing and duct cleaning of HVAC systems							
	Brazing, soldering or welding of metals							
	Demolition of sheet metal HVAC systems							
	Fabrication and installation of exterior wall sheathing, siding, metal roofing, flashing, decking and architectural sheet metal work							
	Fabrication and installation of heating, ventilation and air conditioning ducts and equipment							
	Fabrication and installation of louvers and hoods							
	Fabrication and installation of sheet metal lagging							
	Fabrication and installation of stainless steel commercial or industrial food service equipment							
	Manufacture, fabrication assembly, installation and alteration of all ferrous and nonferrous metal work							
	Metal lavatory partitions							
	Preparation of drawings taken from architectural and engineering plans required for fabrication and erection of sheet metal work							
	Sheet Metal shelving							
	Sheet Metal venting, chimneys and breaching							
	Skylight installation							

**Sheet Metal Workers, Region II (South of N63 latitude)**  
 \*See per diem note on last page

<b>S1801</b>	Sheet Metal Journeyman	43.75	11.85	14.39	1.68	<b>L&amp;M</b>		72.10
						0.43		

Air Balancing and duct cleaning of HVAC systems

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other Benefits	THR
------------	--	-----	-----	-----	-----	----------------	-----

**Sheet Metal Workers, Region II (South of N63 latitude)**

\*See per diem note on last page

							L&M	
<b>S1801</b>	Sheet Metal Journeyman	43.75	11.85	14.39	1.68	0.43		72.10
	Brazing, soldering or welding of metals							
	Demolition of sheet metal HVAC systems							
	Fabrication and installation of exterior wall sheathing, siding, metal roofing, flashing, decking and architectural sheet metal work							
	Fabrication and installation of heating, ventilation and air conditioning ducts and equipment							
	Fabrication and installation of louvers and hoods							
	Fabrication and installation of sheet metal lagging							
	Fabrication and installation of stainless steel commercial or industrial food service equipment							
	Manufacture, fabrication assembly, installation and alteration of all ferrous and nonferrous metal work							
	Metal lavatory partitions							
	Preparation of drawings taken from architectural and engineering plans required for fabrication and erection of sheet metal work							
	Sheet Metal shelving							
	Sheet Metal venting, chimneys and breaching							
	Skylight installation							

**Sprinkler Fitters**

\*See per diem note on last page

							L&M	
<b>A1901</b>	Sprinkler Fitter	49.10	10.55	18.15	0.52	0.25		78.57

**Surveyors**

\*See per diem note on last page

							L&M	
<b>A2001</b>	Chief of Parties	46.16	12.23	13.64	1.15	0.10		73.28
<b>A2002</b>	Party Chief	44.57	12.23	13.64	1.15	0.10		71.69
<b>A2003</b>	Line & Grade Technician/Office Technician/GPS, Drones	43.97	12.23	13.64	1.15	0.10		71.09
<b>A2004</b>	Associate Party Chief (including Instrument Person & Head Chain Person)/Stake Hop/Grademan	41.85	12.23	13.64	1.15	0.10		68.97
<b>A2006</b>	Chain Person (for crews with more than 2 people)	37.51	12.23	13.64	1.15	0.10		64.63

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation



**Truck Drivers**  
 \*See per diem note on last page

<b>A2101</b>	Group I, including:	42.94	12.23	13.64	1.15		<b>L&amp;M</b> 0.10	70.06
--------------	---------------------	-------	-------	-------	------	--	------------------------	-------

- Air/Sea Traffic Controllers
- Ambulance/Fire Truck Driver (EMT certified)
- Boat Coxswain
- Captains & Pilots (air & water)
- Deltas, Commanders, Rollagons, & similar equipment (when pulling sleds, trailers or similar equipment)
- Dump Trucks (including rockbuggy, side dump, belly dump, & trucks with pups) over 40 yards up to & including 60 yards
- Helicopter Transporter
- Liquid Vac Truck/Super Vac Truck
- Material Coordinator or Purchasing Agent
- Ready-mix (over 12 yards up to & including 15 yards) (over 15 yards to be negotiated)
- Semi with Double Box Mixer
- Tireman, Heavy Duty/Fueler
- Water Wagon (250 Bbls and above)

<b>A2102</b>	Group 1A including:	44.21	12.23	13.64	1.15		<b>L&amp;M</b> 0.10	71.33
--------------	---------------------	-------	-------	-------	------	--	------------------------	-------

- Dump Trucks (including rockbuggy, side dump, belly dump & trucks with pups) over 60 yards up to & including 100 yards (over 100 yards to be negotiated)
- Jeeps (driver under load)
- Lowboys, including tractor attached trailers & jeeps, up to & including 12 axles (over 12 axles or 150 tons to be negotiated)

<b>A2103</b>	Group II, including:	41.68	12.23	13.64	1.15		<b>L&amp;M</b> 0.10	68.80
--------------	----------------------	-------	-------	-------	------	--	------------------------	-------

- All Deltas, Commanders, Rollagons, & similar equipment
- Batch Trucks (8 yards & up)
- Batch Trucks (up to & including 7 yards)
- Boom Truck/Knuckle Truck (over 5 tons)
- Cacasco Truck/Heat Stress Truck
- Construction and Material Safety Technician
- Dump Trucks (including rockbuggy, side dump, belly dump, & trucks with pups) over 20 yards up to & including 40 yards
- Gin Pole Truck, Winch Truck, Wrecker (truck mounted "A" frame manufactured rating over 5 tons)
- Mechanics
- Oil Distributor Driver
- Partsman
- Ready-mix (up to & including 12 yards)
- Stringing Truck

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Truck Drivers**

\*See per diem note on last page

<b>A2103</b>	Group II, including:	41.68	12.23	13.64	1.15	<b>L&amp;M</b> 0.10	68.80
	Turn-O-Wagon or DW-10 (not self loading)						
<b>A2104</b>	Group III, including:	40.86	12.23	13.64	1.15	<b>L&amp;M</b> 0.10	67.98
	Boom Truck/Knuckle Truck (up to & including 5 tons)						
	Dump Trucks (including rockbuggy, side dump, belly dump, & trucks with pups) over 10 yards up to & including 20 yards						
	Expeditor (electrical & pipefitting materials)						
	Gin Pole Truck, Winch Truck, Wrecker (truck mounted "A" frame manufactured rating 5 tons & under)						
	Greaser - Shop						
	Semi or Truck & Trailer						
	Thermal Plastic Layout Technician						
	Traffic Control Technician						
	Trucks/Jeeps (push or pull)						
<b>A2105</b>	Group IV, including:	40.28	12.23	13.64	1.15	<b>L&amp;M</b> 0.10	67.40
	Air Cushion or similar type vehicle						
	All Terrain Vehicle						
	Buggymobile						
	Bull Lift & Fork Lift, Fork Lift with Power Boom & Swing Attachment (over 5 tons)						
	Bus Operator (over 30 passengers)						
	Cement Spreader, Dry						
	Combination Truck-Fuel & Grease						
	Compactor (when pulled by rubber tired equipment)						
	Dump Trucks (including rockbuggy, side dump, belly dump, & trucks with pups) up to & including 10 yards						
	Dumpster						
	Expeditor (general)						
	Fire Truck/Ambulance Driver						
	Flat Beds, Dual Rear Axle						
	Foam Distributor Truck Dual Axle						
	Front End Loader with Fork						
	Grease Truck						
	Hydro Seeder, Dual Axle						
	Hyster Operators (handling bulk aggregate)						
	Loadmaster (air & water operations)						
	Lumber Carrier						
	Ready-mix, (up to & including 7 yards)						
	Rigger (air/water/oilfield)						
	Tireman, Light Duty						

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Truck Drivers**  
 \*See per diem note on last page

						L&M	
<b>A2105</b>	Group IV, including:	40.28	12.23	13.64	1.15	0.10	67.40
	Track Truck Equipment						
	Truck Vacuum Sweeper						
	Warehouseperson						
	Water Truck (Below 250 Bbls)						
	Water Truck (straight)						
	Water Wagon, Semi						

						L&M	
<b>A2106</b>	Group V, including:	39.52	12.23	13.64	1.15	0.10	66.64
	Buffer Truck						
	Bull Lifts & Fork Lifts, Fork Lifts with Power Boom & Swing Attachments (up to & including 5 tons)						
	Bus Operator (up to 30 passengers)						
	Farm Type Rubber Tired Tractor (when material handling or pulling wagons on a construction project)						
	Flat Beds, Single Rear Axle						
	Foam Distributor Truck Single Axle						
	Fuel Handler (station/bulk attendant)						
	Gear/Supply Truck						
	Gravel Spreader Box Operator on Truck						
	Hydro Seeders, Single axle						
	Pickups (pilot cars & all light-duty vehicles)						
	Rigger/Swamper						
	Tack Truck						
	Team Drivers (horses, mules, & similar equipment)						

**Tunnel Workers, Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**  
 \*See per diem note on last page

						L&M	LEG	
<b>N2201</b>	Group I, including:	36.30	8.95	21.16	1.40	0.20	0.20	68.21
	Brakeman							
	Mucker							
	Nipper							
	Storm Water Pollution Protection Plan Worker (SWPPP Worker - erosion and sediment control Laborer)							
	Topman & Bull Gang							
	Tunnel Track Laborer							

						L&M	LEG	
<b>N2202</b>	Group II, including:	37.40	8.95	21.16	1.40	0.20	0.20	69.31
	Burning & Cutting Torch							
	Certified Erosion Sediment Control Lead (CESCL Laborer)							

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Tunnel Workers, Laborers (The Alaska areas north of N63 latitude and east of W138 longitude)**  
 \*See per diem note on last page

<b>N2202</b> Group II, including:	37.40	8.95	21.16	1.40		<b>L&amp;M</b>	<b>LEG</b>	69.31
						0.20	0.20	

- Concrete Laborer
- Floor Preparation, Core Drilling
- Jackhammer/Chipping Gun or Pavement Breaker
- Laser Instrument Operator
- Nozzlemen, Pumpcrete or Shotcrete
- Pipelayer Helper

<b>N2203</b> Group III, including:	38.39	8.95	21.16	1.40		<b>L&amp;M</b>	<b>LEG</b>	70.30
						0.20	0.20	

- Miner
- Retimberman

<b>N2204</b> Group IIIA, including:	42.00	8.95	21.16	1.40		<b>L&amp;M</b>	<b>LEG</b>	73.91
						0.20	0.20	

- Asphalt Raker, Asphalt Belly Dump Lay Down
- Drill Doctor (in the field)
- Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)
- Pioneer Drilling & Drilling Off Tugger (all type drills)
- Pipelayer
- Powderman (Employee Possessor)
- Storm Water Pollution Protection Plan Specialist (SWPPP Specialist)
- Traffic Control Supervisor, DOT Qualified

<b>N2206</b> Group IIIB, including:	46.17	6.24	21.16	1.40		<b>L&amp;M</b>	<b>LEG</b>	75.37
						0.20	0.20	

- Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)(over 5,000 hours)
- Federal Powderman (Responsible Person in Charge)
- Grade Checking (setting or transferring of grade marks, line and grade, GPS, drones)
- Pioneer Drilling & Drilling Off Tugger (all type drills)(over 5,000 hours)
- Stake Hopper

**Tunnel Workers, Laborers (The area that is south of N63 latitude and west of W138 longitude)**  
 \*See per diem note on last page

<b>S2201</b> Group I, including:	36.30	8.95	21.16	1.40		<b>L&amp;M</b>	<b>LEG</b>	68.21
						0.20	0.20	

- Brakeman
- Mucker
- Nipper
- Storm Water Pollution Protection Plan Worker (SWPPP Worker - erosion and sediment control Laborer)

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

**Tunnel Workers, Laborers (The area that is south of N63 latitude and west of W138 longitude)**  
 \*See per diem note on last page

<b>S2201</b>	Group I, including:	36.30	8.95	21.16	1.40	0.20	0.20	68.21
	Topman & Bull Gang							
	Tunnel Track Laborer							

<b>S2202</b>	Group II, including:	37.40	8.95	21.16	1.40	0.20	0.20	69.31
	Burning & Cutting Torch							
	Certified Erosion Sediment Control Lead (CESCL Laborer)							
	Concrete Laborer							
	Floor Preparation, Core Drilling							
	Jackhammer/Chipping Gun or Pavement Breaker							
	Laser Instrument Operator							
	Nozzlemen, Pumpcrete or Shotcrete							
	Pipelayer Helper							

<b>S2203</b>	Group III, including:	38.39	8.95	21.16	1.40	0.20	0.20	70.30
	Miner							
	Retimberman							

<b>S2204</b>	Group IIIA, including:	42.00	8.95	21.16	1.40	0.20	0.20	73.91
	Asphalt Raker, Asphalt Belly Dump Lay Down							
	Drill Doctor (in the field)							
	Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)							
	Pioneer Drilling & Drilling Off Tugger (all type drills)							
	Pipelayer							
	Powderman (Employee Possessor)							
	Storm Water Pollution Protection Plan Specialist (SWPPP Specialist)							
	Traffic Control Supervisor, DOT Qualified							

<b>S2206</b>	Group IIIB, including:	46.17	6.24	21.16	1.40	0.20	0.20	75.37
	Driller (including, but not limited to wagon drills, air-track drills, hydraulic drills)(over 5,000 hours)							
	Federal Powderman (Responsible Person in Charge)							
	Grade Checking (setting or transferring of grade marks, line and grade, GPS, drones)							
	Pioneer Drilling & Drilling Off Tugger (all type drills)(over 5,000 hours)							
	Stake Hopper							

**Tunnel Workers, Power Equipment Operators**  
 \*See per diem note on last page

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

Class Code	Classification of Laborers & Mechanics	BHR	H&W	PEN	TRN	Other	Benefits	THR
------------	--	-----	-----	-----	-----	-------	----------	-----

**Tunnel Workers, Power Equipment Operators**

\*See per diem note on last page

<b>A2207</b>	Group I	47.88	11.05	13.75	1.00	L&M	0.10	0.05	73.83
<b>A2208</b>	Group IA	49.82	11.05	13.75	1.00	L&M	0.10	0.05	75.77
<b>A2209</b>	Group II	47.04	11.05	13.75	1.00	L&M	0.10	0.05	72.99
<b>A2210</b>	Group III	46.24	11.05	13.75	1.00	L&M	0.10	0.05	72.19
<b>A2211</b>	Group IV	39.41	11.05	13.75	1.00	L&M	0.10	0.05	65.36

\* Per diem is an established practice for this classification. This means that per diem is an allowable alternative to board and lodging if all criteria are met. See 8 AAC 30.051-08 AAC 30.056, and the per diem information on page vii of this Pamphlet.

\*\* Work in combination of classifications: Employees working in any combination of classifications within the diving crew (working diver, standby diver, and tender) in a shift are paid in the classification with the highest rate for a minimum of 8 hours per shift.

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation

- This page intentionally left blank -

### Shipyards Rates Addendum

This Addendum was developed to address the specialized industry of shipbuilding/repair in Alaska, as it relates to public works. For the purposes of providing rates for shipyard work the Department is adopting Shipyards rates from the state of Washington ( King County ). These rates only apply to work done in shipbuilding/repair in Alaska, under a public contract. This addendum will be updated two times a year to coincide with the corresponding Issue of *Laborers and Mechanics MINIMUM RATES OF PAY*.

Class Code	BHR H&W PEN TRN Other Benefits	THR
<b>Shipyards Workers</b> *See total hourly(THR) note below		
A2300	Ship Building/Repair Boilermaker	47.45
A2305	Ship Building/Repair Carpenter	47.35
A2310	Ship Building/Repair Crane Operator	45.06
A2315	Ship Building/Repair Electrician	48.92
A2320	Ship Building/Repair Heat & Frost Insulator	82.02
A2325	Ship Building/Repair Laborer	47.35
A2330	Ship Building/Repair Mechanist	47.35
A2335	Ship Building/Repair Operating Engineer	45.06
A2340	Ship Building/Repair Painter	47.35
A2345	Ship Building/Repair Pipefitter	47.35
A2350	Ship Building/Repair Rigger	47.45
A2355	Ship Building/Repair Sheet Metal	47.35
A2360	Ship Building/Repair Shipwright	47.35
A2365	Ship Building/Repair Warehouse	45.06

\*The THR includes the base hourly rate (BHR) and fringe benefits. Employers must pay a BHR and fringe benefit package that adds up to the THR. Fringe benefits included in the THR can be paid to employees in three ways; paid into a union trust fund, into an approved benefit plan, or paid directly on the paycheck as gross wages.

Wage benefits key: BHR=basic hourly rate; H&W=health and welfare; IAF=industry advancement fund; LEG=legal fund; L&M=labor/management fund; PEN=pension fund; SAF=safety; SUI=supplemental unemployment insurance; S&L=SUI & LEG combined; TRN=training; THR=total hourly rate; VAC=vacation



# Storm Water Pollution Prevention Plan For

Main Street Sidewalk Improvement  
Main St., Pioneer Ave. to Dehel Ave.  
Homer, AK, 99603

[Insert Project Site Telephone Number \(if applicable\)](#)

## Operator(s)

[Insert Contractor Company Name](#)

[Insert Name](#)

[Insert Address](#)

[Insert City, State, Zip Code](#)

[Insert Telephone Number](#)

[Insert Fax/Email](#)

City of Homer

[Insert On-Site Project Engineer Name](#)

3575 Heath St.

Homer, AK, 99603

[Insert Telephone Number](#)

[Insert Fax/Email](#)

## SWPPP Contact(s)

[Insert Contractor Company Name](#)

[Insert Name](#)

[Insert Address](#)

[Insert City, State, Zip Code](#)

[Insert Telephone Number](#)

[Insert Fax/Email](#)

## SWPPP Preparation Date

[MM / DD / YYYY](#)

*Estimated Project Dates*

**Start of Construction**

**Completion of Construction**

[MM / DD / YYYY](#)

[MM / DD / YYYY](#)

**Contractor APDES Permit Authorization Number:** [Enter Permit Authorization Number](#)

**City of Homer APDES Permit Authorization Number:** [Enter Permit Authorization Number](#)

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

*(Intentionally left blank)*

# Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

## TABLE OF CONTENTS

1.0	PERMITTEE (5.3.1) .....	7
1.1	Operator(s)/Contractor(s) .....	7
1.2	Subcontractors .....	7
2.0	STORM WATER CONTACTS (5.3.2) .....	8
3.0	PROJECT INFORMATION (5.3.3) .....	9
3.1	Project Information .....	9
3.2	Project Site Specific Conditions (5.3.3).....	9
4.0	NATURE OF CONSTRUCTION ACTIVITY (5.3.4) .....	10
4.1	Scope of Work .....	10
4.2	Project Function (5.3.4.1) .....	10
4.3	Support Activities (As Applicable) .....	10
4.4	Sequence and Timing of Soil-disturbing Activities (5.3.4.2) .....	11
4.5	Size of property and total area expected to be disturbed (5.3.4.3).....	11
4.6	Identification of All Potential Pollutant Sources (5.3.4.5) .....	12
5.0	SITE MAPS (5.3.5) .....	13
6.0	DISCHARGES .....	13
6.1	Locations of Other Industrial Storm Water Discharges (5.3.8) .....	14
6.2	Allowable Non-Storm Water Discharges (1.4.3; 4.3.7; 5.3.9) .....	14
7.0	DOCUMENTATION OF PERMIT ELIGIBILITY RELATED TO TOTAL MAXIMUM DAILY LOADS (3.2, 5.6).....	14
7.1	Identify Receiving Waters (5.3.3.3) .....	14
7.2	Identify TMDLs (5.6.1) .....	14
8.0	DOCUMENTATION OF PERMIT ELIGIBILITY RELATED TO ENDANGERED SPECIES (3.3, 5.7).....	15
8.1	Information on Endangered or Threatened Species or Critical Habitat (5.7.1) .....	15
9.0	APPLICABLE FEDERAL, STATE, TRIBAL, OR LOCAL REQUIREMENTS (4.15).....	15
10.0	CONTROL MEASURES/BEST MANAGEMENT PRACTICES (4.0; 5.3.6) .....	16
10.1	Minimize Amount of Soil Exposed During Construction Activity (4.2.2).....	17
10.2	Maintain Natural Buffer Areas (4.2.3).....	17
10.3	Control Storm Water Discharges and Flow Rates (4.2.5) .....	18
10.3.1	Protect Steep Slopes (4.2.6) .....	19
10.4	Storm Water Inlet Protection Measures (4.3.1).....	19
10.5	Water Body Protection Measures (4.3.2).....	20
10.6	Down-Slope Sediment Controls (4.3.3) .....	20
10.7	Stabilized Construction Vehicle Access and Exit Points (4.3.4) .....	22
10.8	Dust Generation and Track-Out from Vehicles (4.3.5 and 4.3.6).....	22
10.9	Soil Management (4.3.7) .....	23

# Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

10.10	Authorized Non-Storm Water Discharges (4.3.8).....	23
10.11	Sediment Basins (4.3.9) .....	23
10.12	Dewatering (4.4).....	23
10.13	Soil Stabilization (4.5, 5.3.6.3) .....	24
10.14	Treatment Chemicals (4.6; 5.3.6.4) .....	24
10.15	Treatment Chemicals (4.6.1) .....	<b>Error! Bookmark not defined.</b>
10.15.1	Treatment Chemical Use Procedures (4.6.2).....	<b>Error! Bookmark not defined.</b>
10.15.2	Application of Treatment Chemicals (4.6.3).....	<b>Error! Bookmark not defined.</b>
10.16	Active Treatment System Information or cationic treatment chemicals (4.6.7).....	25
10.17	Good Housekeeping Measures (4.8) .....	25
10.17.1	Washing of Equipment and Vehicles (4.8.1) .....	<b>Error! Bookmark not defined.</b>
10.17.2	Fueling and Maintenance Areas (4.8.2).....	25
10.17.3	Staging and Material Storage Areas (4.8.3).....	25
10.17.4	Washout of Applicators/Containers Used for Paint, Concrete, and Other Materials (4.8.4) .....	25
10.17.5	Fertilizer or Pesticide Use (4.8.5).....	26
10.18	Spill Notification (4.9) .....	26
10.19	Construction and Waste Materials (4.8.6, 5.3.7) .....	28
11.0	INSPECTIONS (5.4; 6.0) .....	28
11.1	Inspection Schedules (5.4.1.2; 6.1; 6.2).....	28
11.2	Inspection Form or Checklist (5.4.1.3; 6.7).....	28
11.3	Corrective Action Procedures (5.4.1.4; 8.0) .....	28
11.4	Inspection recordkeeping (5.4.2) .....	29
12.0	MONITORING PLAN (If Applicable) (5.5; 7.0) .....	29
12.1	Determination of Need for Monitoring Plan .....	29
12.2	Monitoring Plan Development .....	<b>Error! Bookmark not defined.</b>
12.3	Monitoring Considerations.....	<b>Error! Bookmark not defined.</b>
13.0	POST-AUTHORIZATION RECORDS (5.8) .....	29
13.1	Additional Documentation Requirements (5.8.2) .....	30
13.1.1	Records of Employee Training (4.14; 5.8.2.7) .....	30
14.0	MAINTAINING AN UPDATED SWPPP (5.9).....	30
14.1	Log of SWPPP Modifications (5.9.2) .....	31
14.2	Deadlines for SWPPP Modifications (5.9.3) .....	31
15.0	ADDITIONAL SWPPP REQUIREMENTS (5.10).....	31
15.1	Retention of SWPPP (5.10.1).....	31
15.2	Main Entrance Signage (5.10.2).....	31
15.3	Availability of SWPPP (5.10.3) .....	31
15.4	Signature and Certification (5.10.4) .....	31
15.5	Submittal of a Modification to NOI (2.7).....	32

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDICES

- A. Site Maps and Drawings
- B. BMP Details
- C. Project Schedule
- D. Supporting Documentation:
  - TMDLs
  - Endangered Species
  - Other Permits or Requirements
- E. Delegations of Authority, Contractor/Subcontractor Certifications
- F. Permit Conditions:
  - Copy of Signed Notice of Intent
  - Copy of Letter from ADEC Authorizing Coverage, with ADEC NOI Tracking Number
  - Copy of Notice of Termination
  - Copy of 2021 Construction General Permit
- G. Grading and Stabilization Records
- H. Monitoring Plan (If Applicable) and Reports
- I. Training Records
- J. Corrective Action Log
- K. Inspection Records
- L. SWPPP Amendment Log

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

*(Intentionally left blank)*

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

### 1.0 PERMITTEE (5.3.1)

#### 1.1 Operator(s)/Contractor(s)

Operator Information			
Organization: <a href="#">Enter Text</a>	Name: <a href="#">Enter Text</a>	Title: <a href="#">Enter Text</a>	
Phone: <a href="#">Enter Text</a>	Fax (optional): <a href="#">Enter Text</a>	Email: <a href="#">Enter Text</a>	
Mailing Address:	Street (PO Box): <a href="#">Enter Text</a>		
	City: <a href="#">Enter Text</a>	State: <a href="#">Enter Text</a>	Zip: <a href="#">Enter Text</a>
Area of Control	Day-to-day operational control of those activities at a site which are necessary to ensure compliance with a SWPPP or other permit conditions.		

Owner/Operator Information			
Organization: City of Homer, Public Works Department	Name: Janette "Jan" Keiser	Title: Director of Public Works	
Phone: 206-714-8955	Fax (optional): 907-235-3145	Email: JKeiser@ci.homer.ak.us	
Mailing Address:	Street (PO Box): 3575 Heath St.		
	City: Homer	State: AK	Zip: 99603
Area of Control	Operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications.		

#### 1.2 Subcontractors

Subcontractor Information			
Organization: <a href="#">Enter Text</a>	Name: <a href="#">Enter Text</a>	Title: <a href="#">Enter Text</a>	
Phone: <a href="#">Enter Text</a>	Fax (optional): <a href="#">Enter Text</a>	Email: <a href="#">Enter Text</a>	
Mailing Address:	Street (PO Box): <a href="#">Enter Text</a>		
	City: <a href="#">Enter Text</a>	State: <a href="#">Enter Text</a>	Zip: <a href="#">Enter Text</a>
Area of Control	<a href="#">Insert Area of Control (if more than one operator at site)</a>		

[Repeat as necessary to include all subcontractors.](#)

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

### 2.0 STORM WATER CONTACTS (5.3.2)

Identify the qualified persons responsible for the following required positions (note: a small project may have all these responsibilities carried out by one person):

- Storm Water Lead (5.3.2); person updating the SWPPP (5.3.2.2); Person(s) Conducting Inspections (5.3.2.3); Person(s) Conducting Monitoring (if applicable, 5.3.2.4), and Person(s) Operating Active Treatment System (if applicable, 5.3.2.5).
- Document that the named individuals are Qualified Persons as described in CGP Appendix C. Include documentation of qualifications in Appendix E of the SWPPP.

<u>Qualified Personnel</u>	<u>Responsibility</u>
<b>Storm Water Lead</b> Company Name Address City, State, Zip Code Telephone # Fax/Email	Authority to stop and/or modify construction activities as necessary to comply with the SWPPP and the terms and conditions of the permit.
<b>SWPPP Preparer</b> HDL Engineering Consultants, LLC Owen Means 3335 Arctic Blvd. Anchorage, AK, 99503 907-564-2143 omeans@hdlalaska.com	Possess the skills to assess conditions at the construction site that could impact storm water quality. Familiar with Part 5 as a means to implement the permit.
<b>Storm Water Inspector</b> Company Name Address City, State, Zip Code Telephone # Fax/Email	Assess conditions at the construction site that could impact storm water quality. Assess the effectiveness of any erosion and sediment control measures selected to control the quality of storm water discharge, and familiar with Part 6 as a means to ensure compliance with the permit.
<b>Monitoring Person (If Applicable)</b> Company Name Address City, State, Zip Code Telephone # Fax/Email	Knowledgeable in the principles and practices of water quality monitoring who is familiar with Part 7 and the monitoring plan for the site and how to conduct water quality sampling, testing, and reporting.
<b>Active Treatment System Operator (If Applicable)</b> Company Name Address City, State, Zip Code Telephone # Fax/Email	Knowledgeable in the principles and practices of treatment systems that employs chemical coagulation, chemical flocculation or electrocoagulation to aid in the treatment of storm water runoff. Familiar with Part 4.5 as a means to implement and comply with the permit.



### 3.0 PROJECT INFORMATION (5.3.3)

#### 3.1 Project Information

Project Name: <a href="#">Main Street Sidewalk Improvement</a>			
Location Address:	Street: <a href="#">Main Street, Pioneer Avenue to Dehel Avenue</a>		Borough or similar government subdivision: <a href="#">Kenai Peninsula Borough</a>
	City: <a href="#">Homer</a>		State: <a href="#">Alaska</a> Zip: <a href="#">99603</a>
	Latitude (decimal degree, 5 places): <a href="#">59.64947°</a>		Longitude (decimal degree, 5 places): <a href="#">-151.54423°</a>
	Determined By: <input type="checkbox"/> GPS <input type="checkbox"/> Web Map: <a href="#">Enter Text</a> <input type="checkbox"/> USGS Topo Map, Scale: <a href="#">Enter Text</a> <input checked="" type="checkbox"/> Other: <a href="#">Google Earth</a>		

#### 3.2 Project Site Specific Conditions (5.3.3)

**Mean annual precipitation based on nearest weather stations (inches):**

Nearest Weather Station with recent climate data: [Homer AP, Alaska \(503665\)](#)

Average annual precipitation: [24.5 Inches](#)

**Soil Type(s) and Slopes** (*describe soil type(s) and current slopes; note any changes due to grading or fill activities*):

There will be minor changes to slopes due to grading activities. The following mapped soil types are dominant the project area:

- **Beluga silt loam, 4 to 8 percent slopes.** Poorly drained, no frequency of flooding or ponding. Moderately decomposed plant material, silt loam, and silty clay loam. Runoff Class: very high. 27.6 percent of construction site. Hydrologic Soil Group D.
- **Beluga-Mutnala complex, 0 to 8 percent slopes.** Poorly drained, no frequency of flooding or ponding. Moderately decomposed plant material, silt loam, and silty clay loam. Runoff Class: very high. 25.0 percent of construction site. Hydrologic Soil Group D.
- **Beluga-Smokey Bay complex, 8 to 15 percent slopes.** Poorly drained, no frequency of flooding or ponding. Moderately decomposed plant material, silt loam, and silty clay loam. Runoff Class: very high. 10.1 percent of construction site. Hydrologic Soil Group D.
- **Mutnala silt loam, 8 to 15 percent slopes.** Well drained, no frequency of flooding or ponding. Moderately decomposed plant material, silt loam, and gravelly silt loam. Runoff Class: medium. 18.1 percent of construction site. Hydrologic Soil Group B.
- **Starichkof peat, 0 to 4 percent slopes.** Very poorly drained, no frequency of flooding, and occasional frequency of ponding. Peat and stratified mucky peat to silt loam to ashy sand. Runoff Class: very high. 18.6 percent of construction site. Hydrologic Soil Group D.

**Landscape Topography:** The overall landscape topography within the project area is sloping moderately from north to south. Main Street increases in elevation from Pioneer Avenue (elevation 150 feet) to Dehel Avenue (elevation 390 feet).

# Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

**Drainage Patterns** (describe current drainage patterns and note any changes due to grading or fill activities): The terrain generally drains from north to south toward Kachemak Bay. Water sheet flows off the roadway and collects in existing roadside ditches or vegetated lowlands. Runoff is transported via ditches, culverts, and storm drains that eventually discharge to Kachemak Bay. There will be minor changes to existing drainage patterns resulting from storm drain improvements.

**Approximate Growing Season:** The project is located within the Cook Inlet Ecoregion, with an approximate growing season lasting 128 days from May 8th to October 5th (Source: Regional Supplement to the Corps of Engineers Wetlands Delineation Manual: Alaska Region (Version 2.0), page 51, Table 5).

**Type of Existing Vegetation:** Vegetation in the project area outside the existing road footprint consists of grass-vegetated lawns and ornamental trees and shrubs, spruce forest, or dense shrub thicket.

**Historic site contamination evident from existing site features and known past usage of the site:** Proposed work is not expected to encounter hazardous materials. According to the ADEC contaminated sites mapper, there are no contaminated sites located in the vicinity of the proposed project area.

## 4.0 NATURE OF CONSTRUCTION ACTIVITY (5.3.4)

### 4.1 Scope of Work

*Describe the general scope of work for the project, major phases of construction, etc.*

The project includes the following work:

- Construct sidewalk, curb, and gutter on the west side of the roadway
- Install new storm drain collection lines and storm drain inlets and tie into the existing storm drain system.
- Replace failing culverts
- Improve drainage ditches
- Reconstruct driveways and approaches

### 4.2 Project Function (5.3.4.1)

Briefly describe the function of the construction activity (e.g., low-density residential, shopping mall, subdivision, airport, highway, etc.).

The project provides non-motorized transportation and storm drainage improvements.

### 4.3 Support Activities (As Applicable)

Support activities for this project are:

<u>Support Activity</u>	<u>Location</u>	<u>Dedicated</u>	
		<u>Yes</u>	<u>No</u>
Concrete Batch Plant		<input type="checkbox"/>	<input checked="" type="checkbox"/>
Asphalt Batch Plant		<input type="checkbox"/>	<input checked="" type="checkbox"/>
Equipment Staging Yards	A temporary equipment staging area may be required within the project's proposed footprint,	<input checked="" type="checkbox"/>	<input type="checkbox"/>

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

	within the ROW, or on adjacent properties under the responsibility of the contractor.		
Material Storage Areas	A temporary material storage area may be required within the project's proposed footprint, within the ROW, or on adjacent properties under the responsibility of the contractor.	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Excavated Material Disposal Areas		<input type="checkbox"/>	<input checked="" type="checkbox"/>
Borrow Areas		<input type="checkbox"/>	<input checked="" type="checkbox"/>

### 4.4 Sequence and Timing of Soil-disturbing Activities (5.3.4.2)

Briefly describe the intended sequence and timing of activities that disturb soils at the site.

The projects would involve the following sequence of erosion and sediment control activities:

1. Delineate project areas that will be disturbed.
2. Install temporary erosion and sediment control measures, as needed at:
  - a. Site Access Areas.
  - b. Areas where storm water could leave the site.
3. Clear and grub where necessary.
4. Perform drainage improvements, utility improvements, and grading.
5. Mill pavement and remove base course.
6. Install permanent erosion and sediment control features.
7. Construct Base Course and Surface Course.
8. Apply pavement marking.
9. Achieve final stabilization.
10. Remove temporary erosion and sediment control measures.

### 4.5 Size of property and total area expected to be disturbed (5.3.4.3)

- Estimate the area to be disturbed by excavation, grading, or other construction activities, including support activities described in CGP Section 1.4.2.3 (e.g., concrete or asphalt batch plants, equipment staging yards, material storage areas, excavated material disposal areas, and/or borrow areas).
- Calculate the percentage of impervious surface area before and after construction.
- Calculate the run-off coefficients before and after construction.

The following are estimates of the construction site:

Total Project Area:.....	3.5	Acres (ROW to ROW)
Construction-site area to be disturbed: .....	1.5	acres
Percentage impervious area BEFORE construction:.....	50	%
Runoff coefficient BEFORE construction: .....	0.40	
Percentage impervious area AFTER construction: .....	51	%
Runoff coefficient AFTER construction:.....	0.41	

#### 4.6 Identification of All Potential Pollutant Sources (5.3.4.5)

- Identify and list all potential sources of sediment from construction materials and activities which may affect the quality of storm water discharges from the construction site.
- Identify and list all potential sources of pollution, other than sediment, from construction materials and activities which may affect the quality of storm water discharges from the construction site.

##### **Potential sources of sediment to storm water runoff:**

Soils could be eroded and transported off-site via ditches and storm drains during and immediately after grubbing activities, during pavement milling, during repair or improvements to existing storm water drainage facilities, and during regrading activities. Haul routes and access points for material delivery could become sources of sediment from track out. Structural gravel soils exposed by removal of existing asphalt paving or concrete sidewalk are the main source of sediment that could be caused by storm water runoff within the project limits. In isolated areas and on side streets, the full thickness of the asphalt concrete and/or sidewalk will be removed to install storm drain, re-grade curbs and ramps, etc. Topsoil applied to landscaping areas that need to be stabilized is also a source of sediment.

##### **Potential pollutants and sources, other than sediment, to storm water runoff:**

- Vehicle and equipment fluids, including oil, grease, fuel, solvents, and coolants.
- Concrete washout water.
- Demolition materials.
- Best Management Practice (BMP) materials.
- General site litter and waste.
- Raw landscaping materials and waste.

## 5.0 SITE MAPS (5.3.5)

The SWPPP must include a legible site map (or set of maps for large projects) showing the entire site and identifying the following site-specific information:

- North arrow and bar scale
- Property boundaries
- Locations where earth-disturbing activities will occur, noting phasing
- Location of areas that will not be disturbed and natural features to be preserved
- Location of all storm water conveyances including ditches, pipes, and swales
- Locations of storm water inlets and outfalls, with a unique identification code for each outfall
- Locations where storm water and/or authorized non-storm water discharges to waters of the U.S. (including wetlands) or a Municipal Separate Storm Sewer System (MS4).
- Direction of storm water flow and approximate slopes anticipated after grading activities
- Locations where control measures will be or have been installed
- Locations where exposed soils will be or have been stabilized
- Locations where post-construction storm water controls will be or have been installed
- Locations of support activities
- Locations where authorized non-storm water will be used
- Locations and sources of run-on to the site from adjacent property that may contain quantities of pollutants which could be exposed to precipitation.
- Locations of all waters of the U.S. on-site (including significant wetland areas  $\geq 10,000$  ft<sup>2</sup>) and those within 2,500 feet of the site boundary
- Location of existing public water system (PWS) drinking water protection areas (DWPA) for PWS sources (e.g., springs, wells, or surface water intakes) that intersect the boundary of the project area. *(The DWPA's can be found using the interactive web map application, "Alaska DEC Drinking Water Protection Areas" located at <http://dec.alaska.gov/das/GIS/apps.htm>.)*
- Sampling point(s), if applicable
- Areas where final stabilization has been accomplished
- Staging and material storage areas (construction materials, hazardous materials, fuels, etc.)
- Dumpsters
- Porta-potties
- Concrete, paint, or stucco washout areas
- Stabilized construction exits

**Include a general location map in Appendix A of this SWPPP. (5.3.4.4)**

**Include site maps in Appendix A of this SWPPP. (5.3.5)**

## 6.0 DISCHARGES

Subject to compliance with the terms and conditions of the CGP, the permittee is authorized to discharge pollutants in storm water discharges from the site. If the permittee is eligible for coverage under this permit and does not comply with the requirements of this general permit, the permittee may be in violation of this general permit for otherwise eligible discharges.

Instructions:

- Describe and identify the location of any storm water discharge associated with support activities, including discharges from dedicated asphalt and concrete plants covered by this permit (5.3.8).
- Identify all allowable sources of non-storm water discharges to be used at the site (5.3.9).

## 6.1 Locations of Other Industrial Storm Water Discharges (5.3.8)

Not Applicable.

## 6.2 Allowable Non-Storm Water Discharges (1.4.3; 4.3.7; 5.3.9)

Not Applicable.

## 7.0 DOCUMENTATION OF PERMIT ELIGIBILITY RELATED TO TOTAL MAXIMUM DAILY LOADS (3.2, 5.6)

If the permittee is discharging into a water body with an EPA-established or approved Total Maximum Daily Load (TMDL), the permittee must implement measures to ensure the discharge of pollutants from the site is consistent with the assumptions and requirements of the TMDL. Refer to the CGP for additional requirements.

The SWPPP must include documentation supporting a determination of permit eligibility with regard to waters that have a TMDL.

### 7.1 Identify Receiving Waters (5.3.3.3)

Instructions:

- List any water bodies that would receive storm water from the site, including rivers, streams, lakes, coastal waters, and wetlands. Describe each as clearly as possible (e.g., Noyes Slough, a tributary to the Chena River, etc.).
- Indicate location of all water bodies on site map.
- Note any stream crossings, if applicable.
- List storm sewer and/or drainage systems into which storm water from the site could discharge and water body(ies) the system(s) ultimately discharge to.

**Description of receiving waters:** [Surrounding wetlands and Kachemak Bay.](#)

**Description of storm sewer and/or drainage systems:** [Storm water in the project area is collected in a storm drain system that discharges into Kachemak Bay.](#)

### 7.2 Identify TMDLs (5.6.1)

Determine whether the project may discharge into a water body with an EPA-established or approved Total Maximum Load (TMDL) for turbidity or sediment.

Instructions:

- See ADEC web site for a listing of impaired water bodies: <http://dec.alaska.gov/water/water-quality/impaired-waters>.
- Look through all impaired water body categories -- 4a, 4b, and 5.

Is an EPA-established or approved TMDL published for the receiving water(s) listed in Section 7.1?  Yes  No.

## 8.0 DOCUMENTATION OF PERMIT ELIGIBILITY RELATED TO ENDANGERED SPECIES (3.3, 5.7)

The SWPPP must include documentation supporting a determination of permit compliance with regard to the Endangered Species Act.

**Instructions:**

- Determine whether endangered or threatened species or their critical habitats are on or near your site.
- Attach any correspondence for any stage of the project planning between the USFWS, EPA, National Marine Fisheries Service (NMFS), or others and the permittee regarding listed species and critical habitat, including any notification that delays the permittee’s authorization to discharge under this permit (Appendix D).

### 8.1 Information on Endangered or Threatened Species or Critical Habitat (5.7.1)

Are endangered or threatened species and critical habitats on or near the project area?  Yes  No.

**Describe how this determination was made:** [One federally threatened species, the Steller's eider, has a range map that includes the proposed project corridor. The Steller's eider is a federally threatened marine bird that lives in coastal marine waters, except when it goes inland to nest. Nesting locations for the Steller's eider are located in the arctic coastal plain of northern Alaska and Russia; therefore, it is highly unlikely that this species would be encountered within the project area.](#)

Will species or habitat be adversely affected by storm water discharge?  Yes  No.

## 9.0 APPLICABLE FEDERAL, STATE, TRIBAL, OR LOCAL REQUIREMENTS (4.15)

A permittee must ensure storm water control measures implemented at the site are consistent with all applicable federal, state, tribal, or local requirements for soil and erosion control and storm water management.

**Instructions:**

Describe applicable federal, state, tribal, or local requirements, if any.

[The project will comply with all applicable laws and project permits.](#)

## Control Measures

### Instructions:

Describe the Best Management Practices (BMPs) to be implemented to control pollutants in storm water discharges. For each major activity identified:

- Clearly describe appropriate control measures.
- Describe general sequence during the construction process in which the measures will be implemented.
- Describe maintenance and inspection procedures to be undertaken for that specific BMP.
- Include protocols, thresholds, and schedules for cleaning, repairing, and/or replacing damaged or failing BMPs.
- Identify staff responsible for maintaining BMPs. (If your SWPPP is shared by multiple operators, indicate the operator responsible for each BMP.)

Categorize each BMP under one of the following areas of BMP activity as described below:

1. *Minimize disturbed area (preserve native topsoil, phase construction activities) (4.2.2)*
2. *Maintain natural buffer areas (4.2.3)*
3. *Control storm water discharges and flow rates (4.2.5)*
4. *Protect steep slopes (4.2.6)*
5. *Storm drain inlet protection measures (4.3.1)*
6. *Water body protection measures (4.3.2)*
7. *Down-slope sediment controls (4.3.3)*
8. *Stabilized construction vehicle access and exit points (4.3.4)*
9. *Dust generation and track-out from vehicles (4.3.5, 4.3.6)*
10. *Stockpile Management (4.3.7)*
11. *Authorized Non-Storm Water Discharges (4.3.8)*
12. *Sediment basins (4.3.9)*
13. *Dewatering (4.4)*
14. *Soil stabilization (4.5)*
15. *Treatment chemicals/Active treatment Systems (4.6)*
16. *Good housekeeping measures (4.8)*
17. *Any additional BMPs*
  - Note the location of each BMP on your site map(s).
  - Any structural BMPs should have design specifications and details referred to in Appendix B.
  - For more information or ideas on BMPs, see the ADEC Alaska Storm Water Guide: <http://dec.alaska.gov/water/wastewater/stormwater/guidance/>

## 10.0 CONTROL MEASURES/BEST MANAGEMENT PRACTICES (4.0; 5.3.6)

Use this section to describe the types and locations of control measures and BMPs to be installed and maintained in accordance with Section 4.0 of the CGP.

Describe each control measure and BMP, including installation schedule and maintenance, inspection, and removal requirements. You may include a brief description of each BMP in this section and refer to detailed installation, maintenance, inspection, removal requirements, and manufacturer's specifications to be included in Appendix B.

If a control measure or BMP will be used to comply with more than one element of this section, you do not need to repeat the detailed installation, maintenance, inspection, removal requirements, and manufacturer's



## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

information. For each element, identify the control measure or BMP to be used, and refer to the section or Appendix B where the detailed information is presented.

The person(s) identified in Section 2.0 of this SWPPP will be responsible for ensuring compliance with the installation, maintenance, inspection, and removal of these control measures.

### 10.1 Minimize Amount of Soil Exposed During Construction Activity (4.2.2)

**Instructions:**

Describe the areas that will be disturbed with each phase of construction and methods (signs, fences, etc.) you will use to protect those areas that should not be disturbed.

Describe natural features identified and how each will be protected during construction activity.

Describe how topsoil will be preserved.

<b>BMP Description:</b> Site Delineation BMP - 54.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviro/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviro/resources/stormwater.shtml</a> )	
<input type="checkbox"/> <b>Permanent</b> <span style="margin-left: 150px;"><input checked="" type="checkbox"/> <b>Temporary</b></span>	
<b>Installation Schedule:</b>	Before clearing operations begin.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Inspect flagging, fencing, or staking used to ensure correct location and visibility. <u>Maintenance:</u> Replace or repair site delineation (such as fencing, staking, or flagging) as necessary to delineate the site. Repair any damage by equipment or vehicles.
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

### 10.2 Maintain Natural Buffer Areas (4.2.3)

Are stream crossings or waters of the U.S. located within or immediately adjacent to the property?  Yes  No.

If YES, describe the control measures to be implemented to comply with the CGP Section 4.2.3 (e.g., buffer areas, perimeter controls, etc.)

<b>BMP Description:</b> Vegetation Buffer BMP - 38.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviro/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviro/resources/stormwater.shtml</a> )	
<input checked="" type="checkbox"/> <b>Permanent</b> <span style="margin-left: 150px;"><input type="checkbox"/> <b>Temporary</b></span>	
<b>Installation Schedule:</b>	Before clearing operations begin.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Inspect natural existing vegetation buffer areas to ensure that the site delineation to mark the non-disturbance area is in place. Check for damage by equipment and vehicles. Inspect new vegetation buffer areas for the progress of germination and plant growth. Ensure storm water flowing through the area is not forming ponds, rills, or gullies. Inspect for sediment deposition throughout the buffer. <u>Maintenance:</u> Replace or repair site delineation (such as fencing, staking, or flagging) as necessary to delineate the vegetation buffer areas. Repair any damage by equipment or vehicles. Provide additional seed, fertilizer, and water to repair seeded areas damaged by erosion or ponding of water. If sediment is depositing in the buffer install improved erosion control measures upslope of the buffer.
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

### 10.3 Control Storm Water Discharges and Flow Rates (4.2.5)

**Instructions:**

Describe control measures to comply with the CGP (e.g., divert storm water around the site, slow down or contain storm water, use of velocity dissipation devices, installing permanent storm water management controls prior to construction of site improvements to the extent practicable, etc.).

**BMP Description:** Fiber Rolls for Erosion and Sediment Control BMP – 10.01

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

<input type="checkbox"/> Permanent	<input checked="" type="checkbox"/> <b>Temporary</b>
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><b>Inspection:</b> Ensure that the rolls are in contact with the soil and thoroughly entrenched. Look for scouring underneath the rolls. Look for split, torn, unraveling, or slumping fiber rolls. Ensure equipment has not driven over the installed fiber rolls.</p> <p><b>Maintenance:</b> Replace damaged sections of fiber roll. Remove accumulated sediment upslope of the roll before it reaches one-half the distance between the top of the fiber roll and the ground surface. When protecting a water body or storm drain inlet, remove accumulated sediment upslope of the roll when it reaches one-third of the distance between the top of the fiber roll and the ground surface.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

**BMP Description:** Temporary Check Dam (Fiber Roll or Compost Sock) BMP - 31.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

<input type="checkbox"/> Permanent	<input checked="" type="checkbox"/> <b>Temporary</b>
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><b>Inspection:</b> Visually compare upstream and downstream flows to determine relative turbidity levels and effectiveness of check dams. Inspect channel banks for evidence of undermining and erosion. Inspect for dam deterioration and for migration of structural components downstream. Ensure the center of the dam is lower than the edges and that water is not running around the ends.</p> <p><b>Maintenance:</b> Repair bank undercuts. Remove accumulated sediment before it reaches half the height of the dam or one-third of the available storage if protecting a water body or storm drain inlet. Repair undercutting and flow around the edges or, if necessary, reposition the check dam. Install additional dams or other erosion and sediment control measures as needed.</p>
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

<b>BMP Description:</b> Silt Fence BMP – 20.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a> )	
<input type="checkbox"/> <b>Permanent</b>	<input checked="" type="checkbox"/> <b>Temporary</b>
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Inspect fenceline for continuity, collapse, undermined areas, and damage. Do not excavate trenches in permafrost. Inspect fabric for tears, punctures, fraying, weathering, and compromised integrity. Confirm that the fence posts are secure. Ensure the fence is keyed in and that there is no undercutting. Look for evidence of sediment or erosion flow leading off the downhill edge of the fence; this may be an indicator of drainage bypass or fence undermine. Note depth of sediment build up at the fence. Look for signs of inadequate protection of off-site sensitive areas. Check for sediment flowing through the fence. Check for holes in fence where wire ties are used to secure geotextile fabric to the support post.</p> <p><u>Maintenance:</u> Prevent undesirable sedimentation of sensitive areas. Replace damaged fabric. Remedy fence sags as needed. Remove accumulated sediment before it accumulates to one-half the capacity, or one-third of the available storage if protecting a water body or storm drain inlet. Dispose of silt waste in approved manner/location (typically in a non-erosion area). If there is evidence of excessive sedimentation against the silt fence, provide increased erosion control upslope.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

### 10.3.1 Protect Steep Slopes (4.2.6)

Will steep slopes be present at the site during construction?  Yes  No.

### 10.4 Storm Water Inlet Protection Measures (4.3.1)

**Instructions:**

Describe control measures (e.g., filter berms, perimeter controls, temporary diversion dikes, etc.) to be implemented to protect all inlets receiving storm water from the project during the duration of the project.

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

**BMP Description:**

- Storm Drain Inlet Sediment Protection (Area Inlet Fiber Roll or Gravel/Sand Bag Berm) BMP - 25.00
- Storm Drain Inlet Sediment Protection (Curb Inlet Prefabricated Barrier) BMP - 26.00
- Storm Drain Inlet Sediment Protection (Curb Inlet Gravel or Sandbag Berms) BMP - 27.00
- Storm Drain Inlet Sediment Protection (Area Inlet Filter Mat & Filter Fabric) BMP - 28.00
- Storm Drain Inlet Sediment Protection (Area or Curb Inlet Filter Insert) BMP - 29.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

<input type="checkbox"/> Permanent <input checked="" type="checkbox"/> <b>Temporary</b>	
<b>Installation Schedule:</b>	Install when storm drain inlets are operational, prior to pavement disturbing activities, and prior to permanent stabilization of the disturbed area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Check for sediment depth. Cleaning required when sediment has accumulated to one-third the design depth (or less when specified by the manufacturer of prefabricated barriers). Check for undermining or bypassing, such as evidence that sediment is entering the inlet or that run-off is bypassing the barrier and entering the inlet untreated.</p> <p><u>Maintenance:</u> If prefabricated barriers are used, maintain them as specified by the vendor or manufacturer. Correct undermining bypassing failures. Remove accumulated sediment before it reaches one-third of the available storage of the sediment protection device or less when specified by the manufacturer. Remove and dispose of any rock or debris that has accumulated behind the sediment barrier to prevent further clogging. Replace frayed or torn fabric or materials and repair any structural damage as soon as practicable. For Area Inlet Filter Mat and Filter Fabric, sweep top and sides of the mat to remove sediment and debris and remove and replace mat if it becomes clogged.</p>
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

**BMP Description:** Culvert Inlet Protection BMP – 8.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

<input type="checkbox"/> Permanent <input checked="" type="checkbox"/> <b>Temporary</b>	
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Confirm that barriers are in full contact with the soil and that bypass routes are not present. Inspect for sediment accumulation, displacement, and structural damage.</p> <p><u>Maintenance:</u> Remove accumulated sediment before it reaches one-third of the design depth of spillway. Restore structure to its original dimensions and full contact with soil around the inlet as soon as practicable. Repair any structural damage, including replacing damaged sandbags, as soon as practicable.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

### 10.5 Water Body Protection Measures (4.3.2)

Not applicable; there are no water bodies in the immediate vicinity of the project.

### 10.6 Down-Slope Sediment Controls (4.3.3)

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

**BMP Description:** Fiber Rolls for Erosion and Sediment Control BMP – 10.01

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  **Temporary**

<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Ensure that the rolls are in contact with the soil and thoroughly entrenched. Look for scouring underneath the rolls. Look for split, torn, unraveling, or slumping fiber rolls. Ensure equipment has not driven over the installed fiber rolls.</p> <p><u>Maintenance:</u> Replace damaged sections of fiber roll. Remove accumulated sediment upslope of the roll before it reaches one-half the distance between the top of the fiber roll and the ground surface. When protecting a water body or storm drain inlet, remove accumulated sediment upslope of the roll when it reaches one-third of the distance between the top of the fiber roll and the ground surface.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

**BMP Description:** Temporary Check Dam (Fiber Roll or Compost Sock) BMP - 31.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  **Temporary**

<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Visually compare upstream and downstream flows to determine relative turbidity levels and effectiveness of check dams. Inspect channel banks for evidence of undermining and erosion. Inspect for dam deterioration and for migration of structural components downstream. Ensure the center of the dam is lower than the edges and that water is not running around the ends.</p> <p><u>Maintenance:</u> Repair bank undercuts. Remove accumulated sediment before it reaches half the height of the dam or one-third of the available storage if protecting a water body or storm drain inlet. Repair undercutting and flow around the edges or, if necessary, reposition the check dam. Install additional dams or other erosion and sediment control measures as needed.</p>
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

**BMP Description:** Silt Fence BMP – 20.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  **Temporary**

<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Inspect fenceline for continuity, collapse, undermined areas, and damage. Do not excavate trenches in permafrost. Inspect fabric for tears, punctures, fraying, weathering, and compromised integrity. Confirm that the fence posts are secure. Ensure the fence is keyed in and that there is no undercutting. Look for evidence of sediment or erosion flow leading off the downhill edge of the fence; this may be an indicator of drainage bypass or fence undermine. Note depth of sediment build up at the fence. Look for signs of inadequate protection of off-site sensitive areas. Check for sediment flowing through the fence. Check for holes in fence where wire ties are used to secure geotextile fabric to the support post.</p> <p><u>Maintenance:</u> Prevent undesirable sedimentation of sensitive areas. Replace damaged fabric. Remedy fence sags as needed. Remove accumulated sediment before it accumulates to one-half the capacity, or one-third of the available storage if protecting a water body or storm drain inlet. Dispose of silt waste in approved manner/location (typically in a non-erosion area). If there is evidence of excessive sedimentation against the silt fence, provide increased erosion control upslope.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

**BMP Description:** Culvert Inlet Protection BMP – 8.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  Temporary

<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Confirm that barriers are in full contact with the soil and that bypass routes are not present. Inspect for sediment accumulation, displacement, and structural damage.</p> <p><u>Maintenance:</u> Remove accumulated sediment before it reaches one-third of the design depth of spillway. Restore structure to its original dimensions and full contact with soil around the inlet as soon as practicable. Repair any structural damage, including replacing damaged sandbags, as soon as practicable.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

### 10.7 Stabilized Construction Vehicle Access and Exit Points (4.3.4)

**BMP Description:** Stabilized Construction Exit BMP - 23.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  Temporary

<b>Installation Schedule:</b>	Before clearing operations begin.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Inspect stabilized construction exit for sediment accumulation and material displacement. Inspect roadway for sediment track-out. Inspect ditches to ensure no sediment accumulation.</p> <p><u>Maintenance:</u> Maintain each exit in a condition that will prevent tracking of mud or sediment onto public right-of-way. Repair and/or clean out any structures used to trap sediment. Remove all mud and sediment deposited on paved roadways. Add more signs, fencing or barricades when vehicles are exiting the project without using the stabilized construction exit. Install additional stabilized construction exits if needed, yet use signs and barricades to minimize the number of stabilized construction exits. Prevent track-out by using additional BMPs, such as a tire wash.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

### 10.8 Dust Generation and Track-Out from Vehicles (4.3.5 and 4.3.6)

**BMP Description:** Street Sweeping BMP - 55.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

Permanent  Temporary

<b>Installation Schedule:</b>	Implemented as needed. Stabilize roadway to minimize dust generation. Apply protective material. Install barriers to prevent dust from blowing off-site. Establish vegetation as soon as practicable. Sprinkle haul roads with water as needed. Perform street sweeping as needed.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Daily.</p> <p><u>Maintenance:</u> Dust control sprinkling may be required several times per day. Inspect other dust control measures regularly according to schedule set in SWPPP. Repair/replace damaged components and remove sediment build up.</p>
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

### 10.9 Soil Management (4.3.7)

Will soil stockpiles be at the site during construction?  Yes  No.

<b>BMP Description:</b> Fiber Rolls for Erosion and Sediment Control BMP – 10.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a> )	
<input type="checkbox"/> Permanent <input checked="" type="checkbox"/> Temporary	
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Ensure that the rolls are in contact with the soil and thoroughly entrenched. Look for scouring underneath the rolls. Look for split, torn, unraveling, or slumping fiber rolls. Ensure equipment has not driven over the installed fiber rolls. <u>Maintenance:</u> Replace damaged sections of fiber roll. Remove accumulated sediment upslope of the roll before it reaches one-half the distance between the top of the fiber roll and the ground surface. When protecting a water body or storm drain inlet, remove accumulated sediment upslope of the roll when it reaches one-third of the distance between the top of the fiber roll and the ground surface.
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

<b>BMP Description:</b> Plastic Covering BMP – 12.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a> )	
<input type="checkbox"/> Permanent <input checked="" type="checkbox"/> Temporary	
<b>Installation Schedule:</b>	Plastic covering will be installed when the stockpile will not be actively worked on more than 14 days or when there are windy conditions. Plastic covering will be secured either by weighted or trenched method.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Look for unsecured covering or locations of erosion under the covering. <u>Maintenance:</u> Re-secure covering.
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

### 10.10 Authorized Non-Storm Water Discharges (4.3.8)

Describe any measures taken to minimize any non-storm water authorized by this permit.

### 10.11 Sediment Basins (4.3.9)

Will a sediment basin be required during construction?  Yes,  No.

### 10.12 Dewatering (4.4)

Describe dewatering practices to be implemented if water must be removed from an area so construction activity can continue.

Will dewatering be conducted during construction?  Yes,  No.

Will excavation dewatering be conducted within 1,500 feet of a DEC mapped contaminated site found on the following website?  Yes,  No. <http://www.arcgis.com/home/item.html?id=315240bf84aa0b8272ad1cef3cad3>

If yes to above question, review and comply with the DEC Excavation Dewatering General Permit (AKG002000 <http://dec.alaska.gov/water/wastewater/stormwater/dewater-hydrostatic/#dewater>) or most current version, for specific requirements.

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

Describe control measures to be implemented to comply with dewatering discharges authorized either under the CGP or the DEC Excavation Dewatering general permit requirements.

<b>BMP Description:</b> <i>Excavation Dewatering BMP – 9.00</i>	
<b>BMP Manual/Publication:</b> <i>Alaska DOT&amp;PF BMP Guide (<a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a>)</i>	
<input type="checkbox"/> <b>Permanent</b> <input checked="" type="checkbox"/> <b>Temporary</b>	
<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> When pumping, monitor pumps and intake and discharge points. Inspect the conveyance structure for leaks, erosion, or other defects. Inspect the treatment controls for bypass, clogging, and signs of inadequate treatment. Inspect discharge point for erosion or failure of the energy dissipation material. Inspect the equipment area for properly stored fuel and other potentially hazardous substances. <u>Maintenance:</u> Reinforce, repair, or restore any portion of the treatment controls, conveyance system, or energy dissipater.
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

### 10.13 Soil Stabilization (4.5, 5.3.6.3)

<b>BMP Description:</b> <i>Surface Roughening BMP - 30.00</i>	
<b>BMP Manual/Publication:</b> <i>Alaska DOT&amp;PF BMP Guide (<a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a>)</i>	
<input type="checkbox"/> <b>Permanent</b> <input checked="" type="checkbox"/> <b>Temporary</b>	
<b>Installation Schedule:</b>	Install when grading is completed and prior to seeding.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Ensure the area has an adequate depth and coverage of roughening. Inspect the areas according to established schedules as required by the CGP and the SWPPP. <u>Maintenance:</u> Regrade and reseed as soon as practicable if rills or channelization of runoff appear.
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

<b>BMP Description:</b> <i>Permanent Seeding and Soil Amendments BMP – 52.00, 53.00</i>	
<b>BMP Manual/Publication:</b> <i>Alaska DOT&amp;PF BMP Guide (<a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a>)</i>	
<input checked="" type="checkbox"/> <b>Permanent</b> <input type="checkbox"/> <b>Temporary</b>	
<b>Installation Schedule:</b>	Permanent seeding should be considered for any disturbed area where all construction or maintenance activities have ceased or been finalized and is now ready for permanent vegetative cover.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Inspect all seeded areas on a regular basis and after each major storm event to check for areas where corrective measures may have to be made. Indicate which areas need to be reseeded or where other remedial actions are necessary to assure establishment of permanent seeding. <u>Maintenance:</u> Continue monitoring of the site/area until permanent vegetation is established.
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent

### 10.14 Treatment Chemicals (4.6; 5.3.6.4)

Will treatment chemicals be used to control erosion and/or sediment during construction?  Yes,  No.

### 10.15 Treatment Chemicals (4.6.1)

Not Applicable.



### 10.16 Active Treatment System Information or cationic treatment chemicals (4.6.7)

Will an ATS or cationic treatment chemicals be used as a control measure at the site?  Yes,  No.

### 10.17 Good Housekeeping Measures (4.8)

#### 10.17.1 Washing of Equipment and Vehicles (4.8.1)

Will equipment and vehicle washing and/or wheel wash-down be conducted at the site?  Yes,  No.

Vehicles should not be washed in the roadway. If the Contractor creates a staging area, the following BMPs should be adopted for washing activities and incorporated into the SWPPP:

- Designate areas to be used for washing equipment and vehicles and/or wheel wash-down and conduct such activities only in these areas.
- Locate such activities, to the extent practicable, away from storm water conveyance channels, storm drain inlets, and Waters of the U.S.
- Treat all wash water in a sediment basin or use alternative control measures that provide equivalent or better treatment prior to discharge.
- The discharge of soaps and solvents used in equipment and vehicle washing and/or wheel wash-down is strictly prohibited.

#### 10.17.2 Fueling and Maintenance Areas (4.8.2)

Will equipment and vehicle fueling or maintenance be conducted at the site?  Yes,  No.

<b>BMP Description:</b> Vehicle/Equipment Storage, Maintenance and Fueling BMP - 42.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a> )	
<input type="checkbox"/> Permanent <input checked="" type="checkbox"/> Temporary	
<b>Installation Schedule:</b>	Implement upon mobilization of equipment to the site.
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Inspect maintenance, storage, and disposal areas, spill kits, and perimeter controls regularly. Monitor use of BMPs such as drip pans to ensure compliance. <u>Maintenance:</u> Replace or restock spill kit equipment and materials immediately upon use. Repair perimeter control BMPs as needed.
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

#### 10.17.3 Staging and Material Storage Areas (4.8.3)

Designate areas to be used for staging and material storage areas. Locate such activities, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.; and minimize the exposure to precipitation and storm water and vandalism for all chemicals, treatment chemicals, liquid products, petroleum products, and other materials that have the potential to pose a threat to human health or the environment.

#### 10.17.4 Washout of Applicators/Containers Used for Paint, Concrete, and Other Materials (4.8.4)

Will washout areas for trucks, applicators, or containers of concrete, paint, or other materials be used at the site?  Yes,  No.

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: Main Street Sidewalk Improvement

DATE: [Click here to enter a date.](#)

**BMP Description:** Concrete Washout BMP – 6.00

**BMP Manual/Publication:** Alaska DOT&PF BMP Guide (<http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml>)

**Permanent**                       **Temporary**

<b>Installation Schedule:</b>	Installed prior to soil disturbance in the contributing drainage area.
<b>Maintenance and Inspection:</b>	<p><u>Inspection:</u> Inspect and verify that concrete washout BMPs are in place prior to the commencement of concrete work. Determine if the concrete washout is filled to 50 percent capacity. For self-installed containment, inspect the plastic liner to ensure it is securely anchored and intact and inspect the sidewalls for leaks. Ensure the construction doesn't damage the sidewalls. For pre-fabricated containment, inspect the unit for leaks and potential damage. Check to ensure that each washout sign is still secure and visible. If there is evidence that washouts are occurring in locations other than the designated washout: Improve existing signage, install additional signage, increase communication with concrete truck drivers, and provide concrete truck drivers with maps of washout locations with respect to pour locations.</p> <p><u>Maintenance:</u> Clean existing washouts before the washout is 50 percent full. Solidify with bagged grout, vacuum and dispose of liquids in an approved manner, or allow for evaporation (check with the local sanitary sewer authority to determine if there are special disposal requirements for concrete wash water). If necessary, provide an alternate washout during existing washout cleaning. Reline self-installed containers after each leaning, because equipment can damage the liner. Before relining, inspect the containment structure for signs of weakening or damage and make any necessary repairs. Then line the structure with new plastic sheeting, checking that it is free of holes, tears, and other damage. Repair damaged washouts before the next concrete pour. If necessary, provide new washouts until the existing washouts are operational. Contain any spill or discharge of concrete waste materials. Replace or install new signage as needed.</p>
<b>Responsible Staff:</b>	Storm Water Lead/SWPPP Manager & Superintendent

### 10.17.5 Fertilizer or Pesticide Use (4.8.5)

Will fertilizers or pesticides be used at the site?  Yes,  No.

**Material Name:** Insert Text

Fertilizers and pesticides may be applied in a manner and at application rates that will minimize the loss of chemical to storm water runoff. Manufacturers' label requirements for application rates and disposal requirements will be followed.

### 10.18 Spill Notification (4.9)

The following ADEC spill notification guidelines will be followed.

# IT'S THE LAW!

AS 46.03.755, 18 AAC 75.300, 75.325 and 18 AAC 78.200

# REPORT OIL AND HAZARDOUS SUBSTANCE SPILLS


## During Normal Business Hours

call the nearest response team office:

<b>Central Alaska: Anchorage</b>	<b>(907) 269-3063</b> Fax: (907) 269-7648
<b>Northern Alaska: Fairbanks</b>	<b>(907) 451-2121</b> Fax: (907) 451-2362
<b>Southeast Alaska: Juneau</b>	<b>(907) 465-5340</b> Fax: (907) 465-5245
<b>Alaska Pipeline: Fairbanks</b>	<b>(907) 451-2121</b> Fax: (907) 451-2362

## Outside Normal Business Hours

<b>Toll Free</b>	<b>1-800-478-9300</b>
<b>International</b>	<b>1-907-269-0667</b>

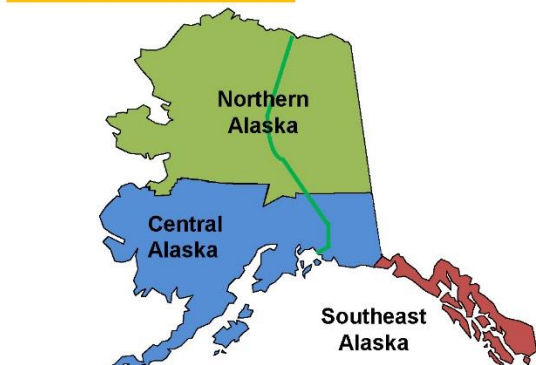

**Alaska Department of  
Environmental Conservation**  
Division of Spill Prevention and Response  
[www.dec.alaska.gov/spar/ppr/spill-  
information/reporting](http://www.dec.alaska.gov/spar/ppr/spill-information/reporting)

## Hazardous Substance

Any hazardous substance spill, other than oil, must be reported immediately.

## Oil - Petroleum Products

### To Water

- ◆ Any amount spilled to water must be reported immediately.

### To Land

- ◆ Spills in **excess of 55 gallons** must be reported immediately.
- ◆ Spills in **excess of 10 gallons, but 55 gallons or less**, must be reported within 48 hours after the person has knowledge of the spill.
- ◆ Spills of **1 to 10 gallons** must be recorded in a spill reporting log submitted to ADEC each month.

### To Impermeable Secondary Containment Areas

- ◆ Any spills in **excess of 55 gallons** must be reported within 48 hours.

### Additional Requirements for Underground Storage Tank Spill Reporting

Regulated Underground Storage Tank (UST) systems are defined at 18 AAC 78.005. Releases at heating oil tanks must be reported.

- You must report a suspected belowground release from a UST system, in any amount, within 24 hours (18 AAC 78.220(c)).
- You must report if your release detection system indicates two consecutive months of invalid or inconclusive results.
- If you observe unusual operating conditions, sudden loss, erratic dispensing (slow flow/no flow) or discharge to soil or water, **report it to the UST Unit:**

**907-269-3055 or 269-7679**

## 10.19 Construction and Waste Materials (4.8.6, 5.3.7)

<b>BMP Description:</b> Sanitary Waste Management BMP – 41.00	
<b>BMP Manual/Publication:</b> Alaska DOT&PF BMP Guide ( <a href="http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml">http://www.dot.state.ak.us/stwddes/desenviron/resources/stormwater.shtml</a> )	
<b>Installation Schedule:</b>	Continuously during construction activities
<b>Maintenance and Inspection:</b>	<u>Inspection:</u> Inspect storage and use areas and identify containers or equipment that could malfunction and cause leaks or spills. Check equipment and containers for leaks, corrosion, support or foundation failure, or other signs of deterioration, and test them for soundness. <u>Maintenance:</u> Immediately repair or replace any that are found to be defective.
<b>Responsible Staff:</b>	SWPPP Manager & Superintendent, Contractor

## 11.0 INSPECTIONS (5.4; 6.0)

### 11.1 Inspection Schedules (5.4.1.2; 6.1; 6.2)

Inspection frequency: [Weekly.](#)

**Justification for reduction in inspection frequency, if applicable:** [Per the ACGP Part 6.2 inspection frequency may be reduced in the following situations:](#)

- [If the entire site is stabilized in accordance with Part 4.5, a permittee may reduce the frequency of inspections to at least once every month and within two business days of the end of a storm event at actively staffed sites that resulted in a discharge from the site;](#)
- [If portions of the site have achieved final stabilization in accordance with Part 4.5 but construction activity remains on other portions of the site, a permittee may suspend inspections for those portions that have achieved final stabilization; however, the permittee must conduct subsequent inspections within two business days of the end of a storm event that results in a discharge from that portion of the site previously considered finally stabilized;](#)
- [If the project is undergoing winter shutdown \(as defined in Appendix C\), implemented control measures with Part 4.12 Winter Considerations, and is documented in accordance with Part 5.3.6.9, a permittee may stop inspections 14 calendar days after the anticipated fall freeze-up and must resume inspections in accordance with Part 6.1 at least 21 calendar days prior to the anticipated spring thaw; or](#)
- [If the entire site has achieved final stabilization \(as defined in Appendix C\) and a NOT has been submitted, no further inspection requirements apply to the site.](#)

**Estimated date of winter shutdown:** [9/28 – 6/3](#)

### 11.2 Inspection Form or Checklist (5.4.1.3; 6.7)

[See Appendix K.](#)

### 11.3 Corrective Action Procedures (5.4.1.4; 8.0)

Describe actions you will take to repair, replace, and maintain BMPs undertaken based on the inspections and maintenance procedures described above. Include a corrective action log, placed below or as an attachment. This log should describe actions taken, date completed, and note the person who completed the work. Actions related to the findings of inspections should reference the specific inspection report.

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

For conditions that are easily remedied (i.e., removal of tracked sediment, maintenance of control measures, or spill clean-up), the permittee must initiate appropriate steps to correct the problem as soon as possible.

If installation of a new control measure is needed or an existing control measure requires significant redesign and reconstruction or replacement, the permittee must install the new or modified measure and make it operational within seven calendar days from the time of discovery of the need for the corrective action, unless infeasible.

### Corrective Action Log

[See Appendix J.](#)

### 11.4 Inspection recordkeeping (5.4.2)

Records will be maintained for a minimum period of at least three (3) years after the permit is terminated.

## 12.0 MONITORING PLAN (If Applicable) (5.5; 7.0)

### 12.1 Determination of Need for Monitoring Plan

Use the information collected and presented in Section 7.0 of this SWPPP to help complete this section.

If storm water discharges from the site into a water body with an EPA-established or approved Total Maximum Load (TMDL) for turbidity or sediment, the water body is considered impaired for turbidity or sediment.

If the receiving water is impaired for turbidity or sediment AND the project disturbance is 20 acres or more, then turbidity must be monitored during duration of disturbance and stabilization.

Instructions:

Answer briefly the following questions and determine whether the project has a monitoring requirement for turbidity.

Is there an EPA-established or approved TMDL for [Kachemak Bay](#)?  Yes,  No.

Is the receiving water listed as impaired for turbidity and/or sediment?  Yes,  No.

## 13.0 POST-AUTHORIZATION RECORDS (5.8)

This section does not have to be filled out but is a list of reminders for the applicant. Refer to CGP 5.8 for additional details.

### Copy of Permit Requirements (5.8.1)

The SWPPP must contain the following documents:

- copy of CGP (5.8.1.1);
- copy or signed and certified NOI form submitted to ADEC (5.8.1.2);

- upon receipt, a copy of letter from ADEC authorizing permit coverage, providing tracking number (5.8.1.3); and

**These documents must be included in Appendix F.**

### **13.1 Additional Documentation Requirements (5.8.2)**

- Dates when grading activities occur (5.8.2.1; insert in Appendix G).
- Dates when construction activities temporarily or permanently cease on a portion of the site (5.8.2.1.3; insert in Appendix G).
- Dates when stabilization measures are initiated (5.8.2.1.4; insert in Appendix G).
- Date of beginning and ending period for winter shutdown (5.8.2.2; insert in Appendix G).
- Copies of inspection reports (5.4.2; 5.8.2.3; insert in Appendix K).
- Copies of monitoring reports, if applicable (5.8.2.4; insert in Appendix H).
- Documentation in support of chemical-treatment processes (4.6; 5.8.2.6; insert in Appendix H).
- Documentation of maintenance and repairs of control measures (5.8.2.8; 8.1; 8.2; insert in Appendix J).
- Documentation of any rainfall monitoring records (6.7.1.3)

#### **13.1.1 Records of Employee Training (4.14; 5.8.2.7)**

Training staff and subcontractors is an effective BMP. Document all training conducted for your staff, those with specific storm water responsibilities (e.g. installing, inspecting, and maintaining BMPs), and subcontractors. Include dates, number of attendees, subjects covered, and length of training.

**Describe Training Conducted:**

**General storm water and BMP awareness training for staff and subcontractors:**

[See Appendix I.](#)

**Detailed training for staff and subcontractors with specific storm water responsibilities:**

[See Appendix I.](#)

**Individual(s) Responsible for Training:**

[Insert Names, Titles, and Contact Numbers here](#)

## **14.0 MAINTAINING AN UPDATED SWPPP (5.9)**

The permittee must modify the SWPPP, including site map(s), in response to any of the following:

- whenever changes are made to construction plans, control measures, good housekeeping measures, monitoring plan (if applicable), or other activities at the site that are no longer accurately reflected in SWPPP (5.9.1.1);
- if inspections of site investigations by staff or by local, state, tribal, or federal officials determine SWPPP modifications are necessary for permit compliance (5.9.1.2); and
- to reflect any revisions to applicable federal, state, tribal, or local laws that affect control measures implemented at the construction site (5.9.1.3).

### **14.1 Log of SWPPP Modifications (5.9.2)**

A permittee must keep a log showing dates, name of person authorizing the change, and a brief summary of changes for all significant SWPPP modifications (e.g., adding new control measures, changes in project design, or significant storm events that cause replacement of control measures). A form to document SWPPP amendments has been placed at the beginning of this template.

### **14.2 Deadlines for SWPPP Modifications (5.9.3)**

Revisions to the SWPPP must be completed within seven days of the inspection that identified the need for a SWPPP modification or within seven days of substantial modifications to the construction plans or changes in site conditions.

## **15.0 ADDITIONAL SWPPP REQUIREMENTS (5.10)**

### **15.1 Retention of SWPPP (5.10.1)**

A copy of the SWPPP (including a copy of the permit), NOI, and acknowledgement letter from ADEC must be retained at the construction site.

### **15.2 Main Entrance Signage (5.10.2)**

A sign or other notice must be posted conspicuously near the main entrance of the site. The sign or notice must include the permit authorization number assigned to the NOI, Operator Contact Name and phone number for obtaining additional construction site information, and location of the SWPPP or name and telephone number of the contact person for scheduling SWPPP viewing times. If the location of the SWPPP or the name and telephone number of the contact person for scheduling SWPPP viewing times has changed (i.e., is different than that submitted to DEC in the NOI), the current location of the SWPPP or name and telephone number of a contact person for scheduling viewing times.

### **15.3 Availability of SWPPP (5.10.3)**

The permittee must keep a current copy of the SWPPP at the site. The SWPPP must be made available to subcontractors, government and tribal agencies, and MS4 operators, upon request.

### **15.4 Signature and Certification (5.10.4)**

The SWPPP must be signed and certified in accordance with the requirements of the CGP Appendix A, Part 1.12. The certification form on page ii of this template meets the requirements of this paragraph.

## 15.5 Submittal of a Modification to NOI (2.7)

Note: A permittee must file an NOI modification form to DEC (see Permit Part 2.3) to update or correct the following information on the original NOI within 30 calendar days of the change:

- Owner/Operator address and contact information;
- Site information;
- Estimated start or end dates;
- Number of acres to be disturbed; or
- SWPPP location and contact information.



## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---


### APPENDIX A – SITE MAPS AND DRAWINGS

NO.	DATE	REVISION	PROJECT DESIGNATION	YEAR	SHEET NO.	TOTAL SHEETS
			160-0782	2021	A1	A5

# CITY OF HOMER PUBLIC WORKS DEPARTMENT

## MAIN STREET SIDEWALK IMPROVEMENT PROJECT NO. 160-0782

FILE: H:\JOBS\17-014-HOMER-ROADS-DRAINAGE-AND-TRAILS-TERM-(HOMER)\TASK-2-MAIN-STREET-(PHASE-1)-SIDEWALK-DESIGN\CAD-DRAWINGS\17014\_02\_A01.DWG  
 DATE/TIME: 4/17/2021 12:45 PM [LAYOUT] A1  
 DESIGNED [ ] CHECKED [ ] DRAFTED [ ]

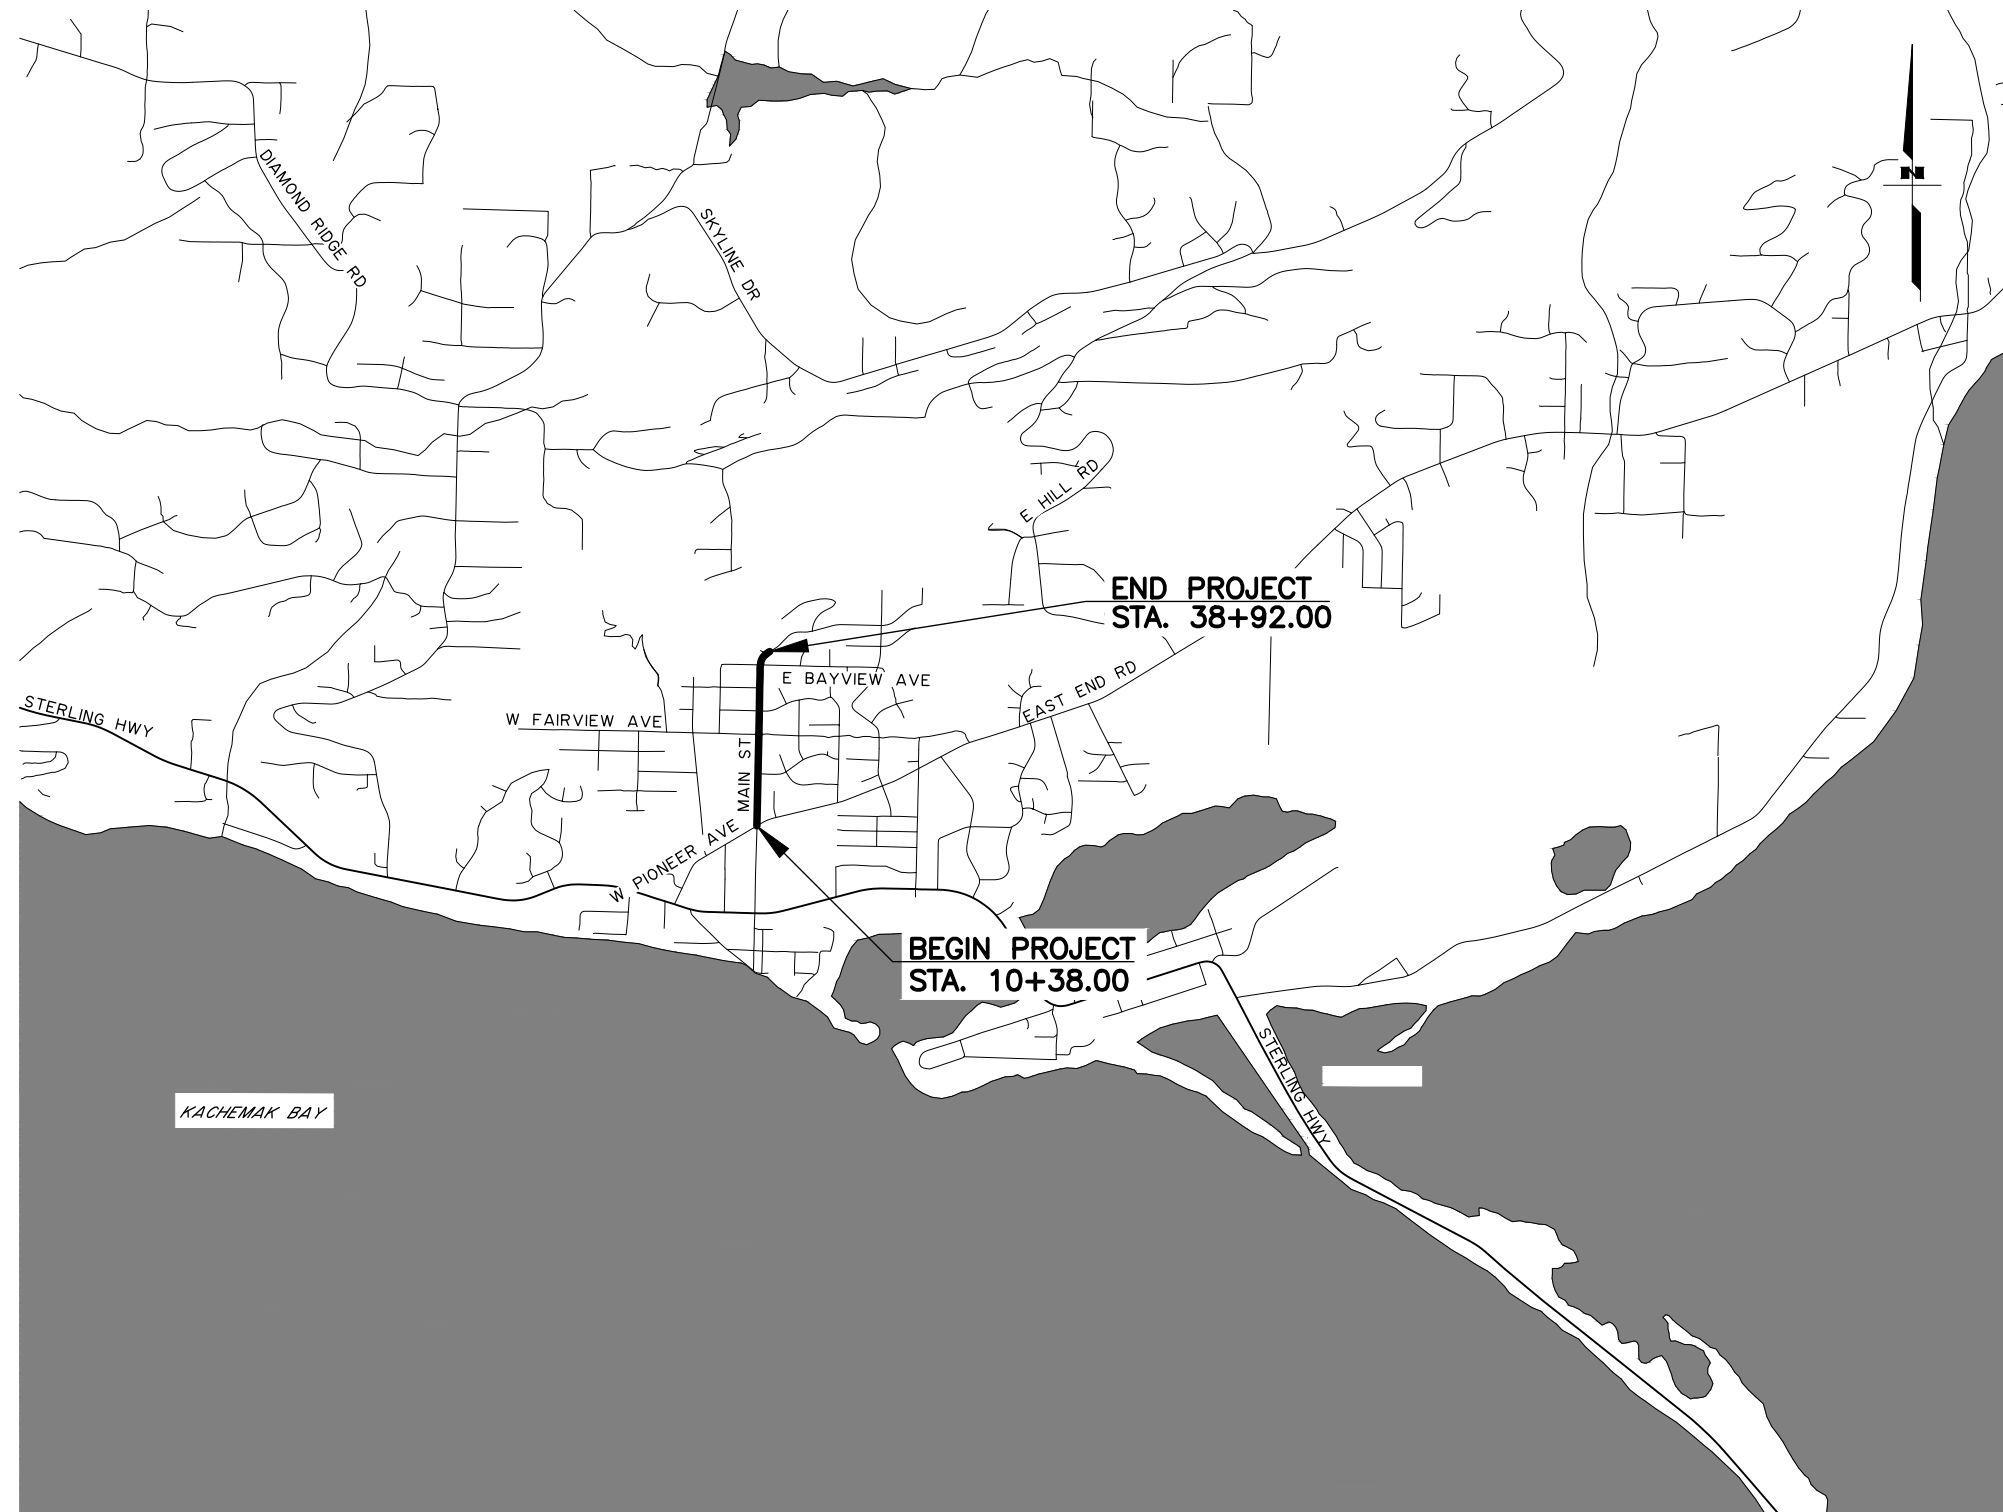

HOMER CITY COUNCIL

MAYOR  
KEN CASTNER

COUNCILMEMBERS  
DONNA ADERHOLD  
JOEY EVENSEN  
STORM HANSEN-CAVASOS  
RACHEL LORD  
HEATH SMITH  
CAROLINE VENUTI

FUNDED THROUGH HART  
(HOMER ACCELERATED ROAD PROGRAM)

APPROVED BY:

\_\_\_\_\_  
JANETTE KEISER, P.E.  
DIRECTOR OF PUBLIC WORKS

NO.	DATE	REVISION


PROJECT DESIGNATION	YEAR	SHEET NO.	TOTAL SHEETS
160-0782	2021	2	2

DESIGNED BY  
CHECKED BY  
DRAFTED BY

SCALE  
1" = 50'

DATE  
4/9/2021 12:27 PM

H:\JOBS\17-014\_HOMER ROADS, DRAINAGE, AND TRAILS TERM (HOMER)\TASK 2 - MAIN STREET (PHASE 1)\_SIDEWALK DESIGN\CAD\DRAWINGS\FIGURE\_SWPPP\_17014\_02.DWG

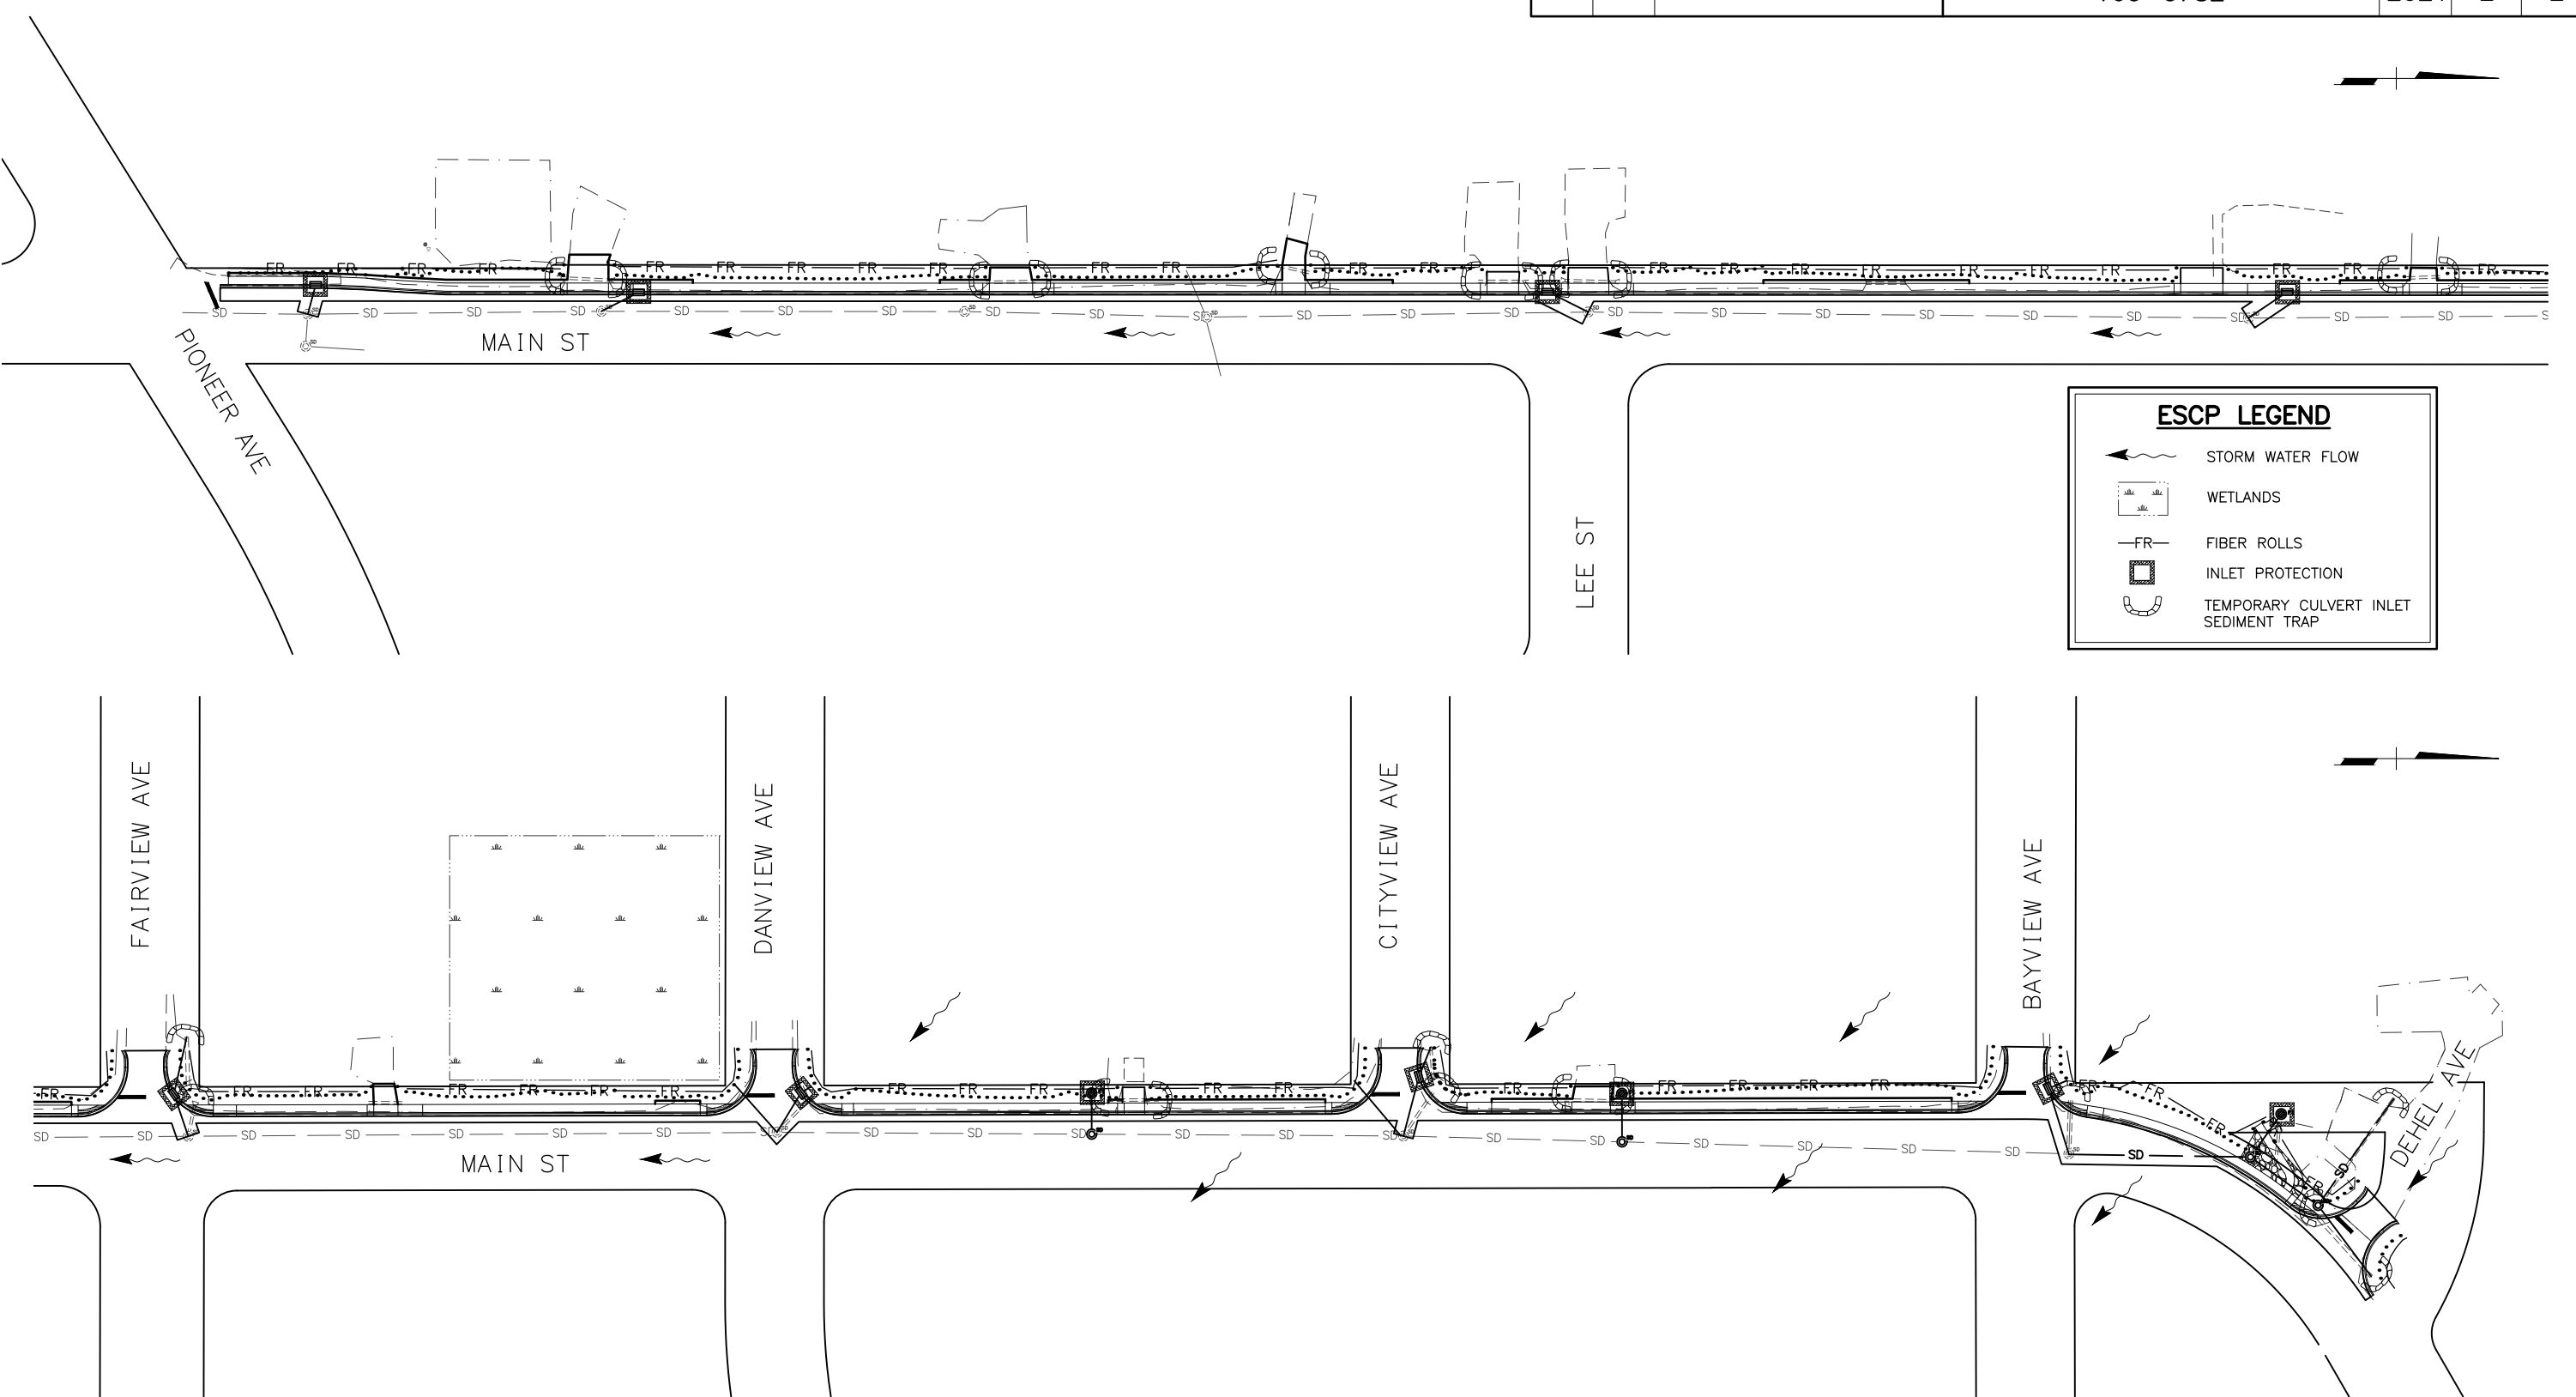

**ESCP LEGEND**

- STORM WATER FLOW
- WETLANDS
- FIBER ROLLS
- INLET PROTECTION
- TEMPORARY CULVERT INLET SEDIMENT TRAP

**NOT FOR CONSTRUCTION**

CITY OF HOMER  
PUBLIC WORKS DEPARTMENT  
**MAIN STREET  
SIDEWALK IMPROVEMENTS**

**SWPPP SITE MAP**

HDL ENGINEERING CONSULTANTS, LLC  
3335 ARCTIC BOULEVARD, STE 100  
ANCHORAGE, AK 99503  
(907)564-2120  
AECL861

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX B – BMP DETAILS

## BMP 06.00. Concrete Washout

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Concrete Washout Containment prevents the discharge of concrete waste pollutants to stormwater by providing on-site washout containment in a designated and contained area.

#### *Description*

Concrete Washout Containment contains concrete and fluids from the chutes of concrete mixers and hoppers of concrete pumps when they are rinsed out after delivery. Containment areas allow for easier disposal of consolidated solids and prevent pollution from run-off or infiltration to groundwater. A washout facility can consist of a pre-fabricated container or self-installed (fabricated on-site) lined containment area, which can be above- or below-grade. Containment areas require sufficient volume to completely contain all liquid and waste concrete materials.

#### *Applicability*

Concrete Washout Containment is required on projects where concrete, stucco, mortar, grout, and/or cement are used as construction materials.

#### *Selection Considerations*

The number and size of containment areas provided should be based on the expected demand for storage capacity.

- *Pre-fabricated Washout Containers:* Pre-fabricated washout containments can be any watertight unit that can contain all liquids and solid waste generated by washout operations. When available, pre-fabricated containers are delivered to the site and minimize installation efforts. They are also resistant to damage and protect against spills and leaks. Some companies will also offer complete service with their product, such as providing maintenance and regular disposal of waste materials. Such full-service options could relieve the superintendent of these responsibilities. However, when a contractor selects a company that provides such an option, they must also ensure that the company is properly disposing of materials and it would be prudent to give preference to companies that recycle collected materials.

- *Below-grade Containment:* Use of below-grade containment areas helps prevent breaches and reduces the likelihood of run-off. This option is recommended for projects expecting extensive concrete work or for airport projects. However, this option is not recommended for areas with high water tables or shallow groundwater; such as near natural drainages, springs, or wetlands.
- *Above-grade Containment:* Above-grade containment areas must be sized and installed correctly, and diligently maintained in order to be effective. However, particularly if a pre-fabricated container is unavailable, this option is better suited in areas with potentially high water tables to prevent leaching of wash water into groundwater, or in areas where excavation is not practical.

#### *Design*

*Location:* Concrete Washout Containment should be placed in a location that provides convenient access for concrete trucks, preferably near the area where the concrete is being poured. Place Concrete Washout Containment a minimum of 50 feet from storm drains, open ditches, or waterbodies, or provide secondary containment for the Concrete Washout Containment.

*Number of Containments:* Larger sites with extensive concrete work should have Concrete Washout Containment at multiple locations for ease of use. Multiple Washout Containments are also required if a single containment unit is not adequate for the volume of waste material generated before the containment structure is cleaned.

*Capacity:* Concrete Washout Containment should provide sufficient capacity to handle the expected volume of solids, wash water, and rainfall to prevent overflow and allow 12 inches of freeboard. To estimate capacity, assume 7 gallons of wash water and solids are generated from washing one truck chute, and 50 gallons are generated in washing out the hopper of a concrete ready-mix or pump truck. Estimate the number of trucks based on the total volume of concrete in the project, the hopper capacity of each concrete pump truck, the expected number of loads, and the planned maintenance interval.

*Containment Area:* For larger sites, it is recommended that self-installed containment (both above- and below-grade) areas be at least 10 feet wide with sufficient length and depth to provide the required capacity. Above-grade self-installed containment areas shall be limited to a size and capacity for which the selected outside barrier is designed to remain structurally sound when filled with waste materials.

*Cover:* A temporary cover should be provided to prevent rain or other precipitation from filling the containment area and causing wash water overflow. The cover should be a secure, non-collapsing, non-water collecting cover.

*Signage:* Each on-site facility must have highly visible signage to indicate washout containment locations. Signs should be at least 48 by 24 inches and have 6-inch high contrasting letters, placed at a height of at least 3 feet above ground level and within 30 feet of the facility.

#### *Relationship to Other Erosion and Sediment Control Measures*

*Operator Education:* Use of Concrete Washout Containment as a best management practice (BMP) is only successful if concrete truck operators utilize them. Operators need to be made aware of the presence of these containments. All concrete truck operators, including those of subcontractors, should be trained on the importance of managing concrete waste, washout procedures, and washout locations.

#### *Common Failures or Misuses*

- Overflow and discharge of waste when the containment area is not covered prior to anticipated rainfall and/or when accumulated liquid wastes have not been removed.
- Leaking resulting from torn or damaged liners going unnoticed or not being replaced, with consequent discharge of washout liquid or slurry to waterways, storm drains, or directly onto the ground.
- Lack of communication to truck drivers of the necessity of using the containment area for washout.
- Compromised structural integrity due to miscalculated capacity and installation,

particularly for self-installed, above-grade containment.

- Insufficient quantity and/or size to contain all liquid and concrete waste generated by washout operations.

#### SPECIFICATIONS

##### Standard Specification

- 665 – Concrete Washout

##### Drawing

- BMP – 06.00 Concrete Washout, Sheets 1 & 2

**CONCRETE WASHOUT GENERAL NOTES:**  
**MATERIALS**

PRE-FABRICATED CONTAINERS: MADE OF STURDY MATERIALS THAT ARE WATER TIGHT.

FABRICATED ON-SITE CONTAINMENT:

1. BARRIER/SIDEWALLS: MAKE SIDEWALLS OF AN ABOVE-GRADE CONTAINMENT AREA FROM EARTHEN BERMS, BARRIER WALLS, WOOD PLANKS, OR OTHER MATERIALS THAT WILL BE STRUCTURALLY SOUND WHEN FILLED WITH WASTE MATERIALS.
2. LINER: IMPERMEABLE PLASTIC SHEETING OF AT LEAST 10 MIL THICKNESS, AND FREE OF HOLES, TEARS, AND OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL.
3. ANCHORS: SECURE THE LINER FOR ABOVE-GRADE CONTAINMENT AREAS AND SIDEWALL MATERIALS OTHER THAN BERMS WITH ANCHORS. USE SANDBAGS, 6-INCH WIRE STAPLES, AND WOOD OR METAL STAKES AS ANCHORS, BUT NOT LIMITED TO ONLY THEM.

SIGNS: DURABLE, RIGID MATERIAL WITH 6-INCH HIGH CONTRASTING LETTERS, PLACED AT A HEIGHT OF AT LEAST 3 FEET ABOVE GROUND LEVEL.

RAIN COVER: SECURE, NON-COLLAPSING, NON-WATER COLLECTING RAIN COVER, REQUIRED PRIOR TO PREDICTED WET WEATHER TO PREVENT ACCUMULATION AND OVERFLOW OF PRECIPITATION.

**INSTALLATION**

1. INSTALL SIGNS WITHIN 30 FEET OF THE WASHOUT.
2. IF THE WASHOUT IS LOCATED ON UNDEVELOPED PROPERTY OR OFF-PAVEMENT, PROVIDE A STABILIZED CONSTRUCTION EXIT.
3. PLACE CONCRETE WASHOUT CONTAINMENT A MINIMUM OF 50 FEET FROM STORM DRAINS, OPEN DITCHES, OR WATERBODIES, OR PROVIDE SECONDARY CONTAINMENT FOR THE WASHOUT.
4. PROVIDE SUFFICIENT CAPACITY TO HANDLE THE EXPECTED VOLUME OF SOLIDS AND WASH WATER AT 50% MAX CAPACITY AND ALLOW 12 INCHES MINIMUM OF FREEBOARD.
5. PRE-FABRICATED WASHOUT CONTAINERS ARE USUALLY DELIVERED ASSEMBLED. IF ASSEMBLY IS REQUIRED, FOLLOW MANUFACTURER'S INSTRUCTIONS.
6. SELF-INSTALLED CONTAINMENT:
  - a. ABOVE-GRADE WASHOUT: CONSTRUCT THE SIDEWALLS TO THE DIMENSIONS SHOWN ON THE DRAWINGS. IF NOT USING AN EARTHEN BERM FOR THIS PURPOSE, ENSURE THAT THE SIDEWALL MATERIAL IS SECURE AND EACH UNIT IS BUTTED TIGHTLY END TO END. LINE THE ENTIRE AREA WITH THE LINING MATERIAL, BRINGING THE SHEETING UP OVER THE SIDEWALLS AND SECURING THE ENDS WITH SANDBAGS, STAPLES OR OTHER APPROPRIATE ANCHORS.
  - b. BELOW-GRADE WASHOUT: EXCAVATE A FLAT, SUBSURFACE PIT TO THE DESIRED SIZE AND CAPACITY FOR THE CONTAINMENT AREA. THE RESULTING SIDEWALL SHOULD NOT EXCEED 3:1 SLOPES. PREVENT DAMAGE TO THE LINER BY KEEPING THE BASE OF THE PIT FREE OF ROCKS AND DEBRIS. USE THE EXCAVATED MATERIAL TO CREATE A BERM ALONG THREE SIDES OF THE PIT, LEAVING THE SIDE PROVIDING ACCESS RELATIVELY FLAT. IT IS RECOMMENDED THAT THE BERM BE AT LEAST 1-FOOT HIGHER THAN EXISTING GROUND. LINE THE ENTIRE AREA WITH THE LINING MATERIAL, BRINGING THE SHEETING UP OVER THE SIDEWALLS AND BERM, AND SECURING THE ENDS WITH SANDBAGS OR OTHER APPROPRIATE ANCHORS.

**INSPECTION**

1. INSPECT AND VERIFY THAT CONCRETE WASHOUT BMPS ARE IN PLACE PRIOR TO THE COMMENCEMENT OF CONCRETE WORK.
2. DETERMINE IF THE CONCRETE WASHOUT IS FILLED TO 50 PERCENT CAPACITY.
3. FOR SELF-INSTALLED CONTAINMENT:
  - a. INSPECT THE PLASTIC LINER TO ENSURE IT IS SECURELY ANCHORED AND INTACT.
  - b. INSPECT THE SIDEWALLS FOR LEAKS. ENSURE THE CONSTRUCTION DOESN'T DAMAGE THE SIDEWALLS.
4. FOR PRE-FABRICATED CONTAINMENT, INSPECT THE UNIT FOR LEAKS AND POTENTIAL DAMAGE.
5. CHECK TO ENSURE THAT EACH WASHOUT SIGN IS STILL SECURE AND VISIBLE.
6. IF THERE IS EVIDENCE THAT WASHOUTS ARE OCCURRING IN LOCATIONS OTHER THAN THE DESIGNATED WASHOUT: IMPROVE EXISTING SIGNAGE, INSTALL ADDITIONAL SIGNAGE, INCREASE COMMUNICATION WITH CONCRETE TRUCK DRIVERS, AND PROVIDE CONCRETE TRUCK DRIVERS WITH MAPS OF WASHOUT LOCATIONS WITH RESPECT TO POUR LOCATIONS.

**MAINTENANCE**

1. CLEAN EXISTING WASHOUTS BEFORE THE WASHOUT IS 50 PERCENT FULL. SOLIDIFY WITH BAGGED GROUT, VACUUM AND DISPOSE OF LIQUIDS IN AN APPROVED MANNER, OR ALLOW FOR EVAPORATION (CHECK WITH THE LOCAL SANITARY SEWER AUTHORITY TO DETERMINE IF THERE ARE SPECIAL DISPOSAL REQUIREMENTS FOR CONCRETE WASH WATER).
2. IF NECESSARY, PROVIDE AN ALTERNATE WASHOUT DURING EXISTING WASHOUT CLEANING.
3. RELINE SELF-INSTALLED CONTAINERS AFTER EACH CLEANING, BECAUSE EQUIPMENT CAN DAMAGE THE LINER. BEFORE RELINING, INSPECT THE CONTAINMENT STRUCTURE FOR SIGNS OF WEAKENING OR DAMAGE AND MAKE ANY NECESSARY REPAIRS. THEN LINE THE STRUCTURE WITH NEW PLASTIC SHEETING, CHECKING THAT IT IS FREE OF HOLES, TEARS, AND OTHER DAMAGE.
4. REPAIR DAMAGED WASHOUTS BEFORE THE NEXT CONCRETE POUR. IF NECESSARY, PROVIDE NEW WASHOUTS UNTIL THE EXISTING WASHOUTS ARE OPERATIONAL.
5. CONTAIN ANY SPILL OR DISCHARGE OF CONCRETE WASTE MATERIALS.
6. REPLACE OR INSTALL NEW SIGNAGE AS NEEDED.

**REMOVAL**

1. AN OPERATIONAL CONCRETE WASHOUT SHOULD REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT (OR PHASE OF THE PROJECT) IS POURED. WHEN THE CONCRETE WASHOUT IS NO LONGER NEEDED, THE LIQUID MUST BE EVAPORATED OR VACUUMED FOR DISPOSAL AND THE HARDENED SOLIDS MUST BE BROKEN UP, REMOVED, AND PROPERLY DISPOSED OF. DISPOSAL LOCATION TO BE APPROVED BY ENGINEER.
2. REMOVE FROM THE SITE PRE-FABRICATED WASHOUTS AND MATERIALS USED TO CONSTRUCT ABOVE-GRADE CONTAINMENT AREA AND PROPERLY DISPOSE OF THEM.
3. BACKFILL AND STABILIZE HOLES, DEPRESSIONS OR OTHER GROUND DISTURBANCE CAUSED BY THE CREATION OR REMOVAL OF THE WASHOUT WITH AN APPROVED BMP.


REVISIONS		
Date	Description	By

State of Alaska DOT&PF


**CONCRETE WASHOUT  
(NOTES)**

A  
P  
P  
R  
O  
V  
E  
D


Date 12/2015 XX/XX/XX

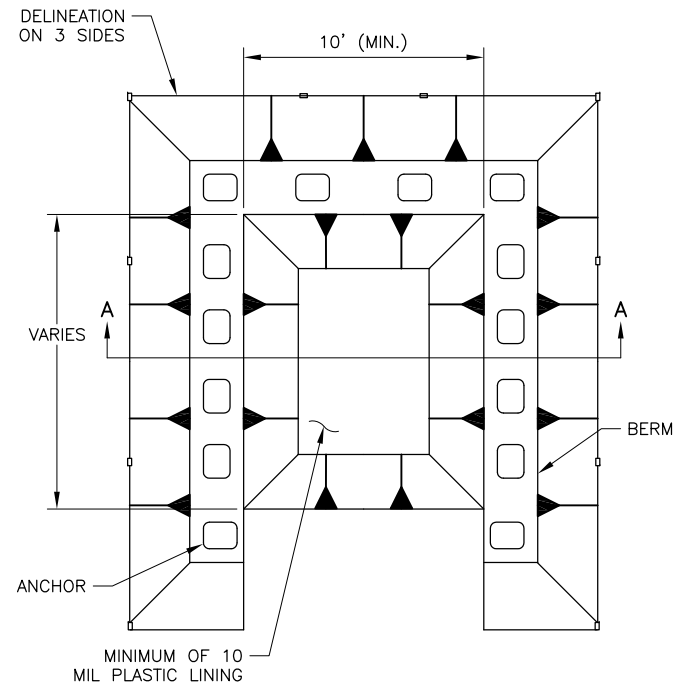


PLAN

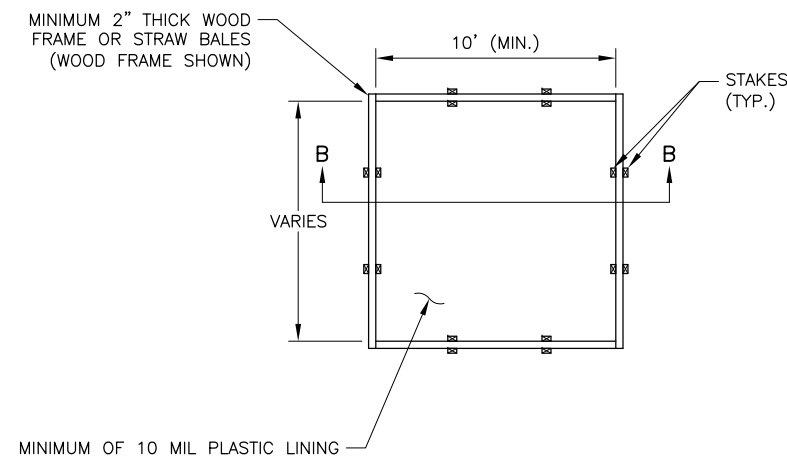


PLAN

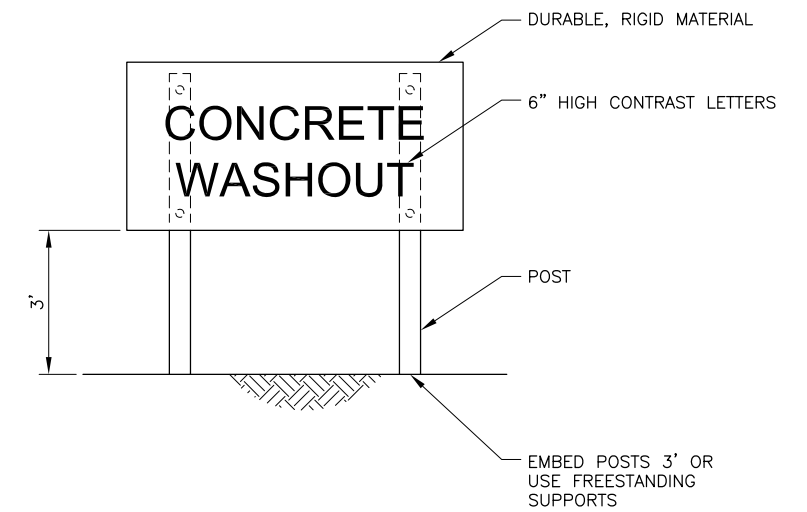

WASHOUT SIGN  
NOT TO SCALE

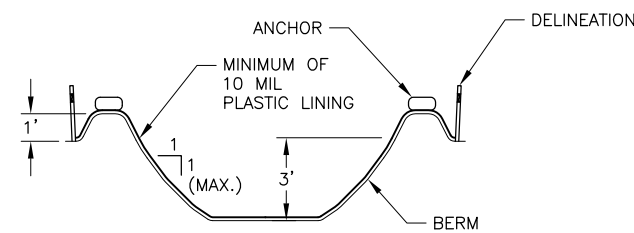


SECTION A-A

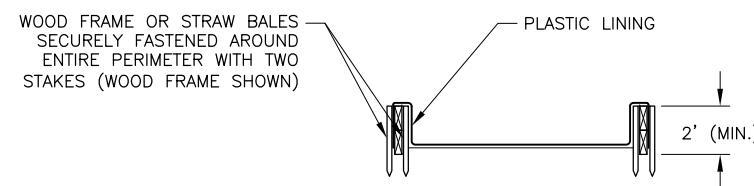

SECTION B-B

BELOW-GRADE CONCRETE WASHOUT  
FABRICATED ON-SITE  
NOT TO SCALE

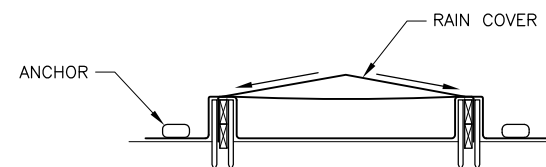

SECTION B-B  
WITH PLASTIC RAIN COVER

ABOVE GRADE CONCRETE WASHOUT  
FABRICATED ON-SITE  
NOT TO SCALE

REVISIONS		
Date	Description	By

State of Alaska DOT&PF

**CONCRETE WASHOUT**  
**(FABRICATED ON-SITE)**

A  
P  
P  
R  
O  
V  
E  
D

Date:      /      /



## **BMP 08.00. Culvert Inlet Protection**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Culvert Inlet Protection is used to trap sediment and reduce the amount of sediment entering a culvert.

#### *Description*

Culvert Inlet Protection is a low barrier, similar to a check dam, placed up-gradient of a culvert inlet to temporarily impound water and trap sediment while still allowing flow to enter the culvert. There are several types of temporary barriers applicable for different conditions:

- Geotextile-wrapped foam barriers
- Sand bags or gravel-filled sand bags
- Fiber rolls
- Geotextile-wrapped wire cage barrier

#### *Other Names*

Filter Inlet.

#### *Applicability*

Culvert Inlet Protection is applicable when there is potential for sediment to be transported to and through the culvert. Placement in the flowline is applicable for culverts conveying runoff or project drainage that must remain operational before permanent stabilization of the disturbed area. Placement above (all the way around) a culvert inlet is applicable when earth disturbing activities are occurring upslope of the inlet, to prevent sediment and runoff from entering the culvert inlet from above. Culvert Inlet Protection is not generally placed in the flowline of culverts conveying stream flow, since the purpose of the best management practice (BMP) is to treat run-off before it reaches receiving waterbodies such as streams. If placement in the flowline of streams is required, applicable permits must be obtained.

#### *Selection Considerations*

- Culvert Inlet Protection should be sited and constructed in a manner that will facilitate cleanout and disposal of trapped sediment.

- Culvert Inlet Protection should be constructed in a manner that will allow flow to pass and minimize ponding after the run-off has ceased.
- Blocking the inlet can cause flooding affecting streets and the construction area. Where flooding would cause a hazard, consider where overflow will go in extreme events and provide emergency overflows with additional treatment.
- Slope Gradient: The slope of the ditch discharging to the culvert inlet should not exceed 5 percent or flow velocity exceeding 2.5 to 3 cubic feet per second. The steeper the slope or the higher the velocity and shear stress, the larger the particle diameter that can be transported. The flatter the slope and the slower the flow, the longer the travel distance and time behind the barrier, allowing for sediment to settle. If Culvert Inlet Protection is required on steeper grades, consider using a series of barriers or a widened channel to provide velocity reduction or barriers of greater depth to lengthen the settling distance.
- Inlet protection should extend all the way around the inlet when upgradient slopes are not stabilized.
- Consider the effects if the barrier were to fail when water is ponded. Provide additional downstream protection if warranted.

#### *Design*

*Drainage Area:* The area of the construction drainage area to the culvert inlet should not exceed 1-acre. The total drainage area to the inlet may be larger than 1-acre, provided that the additional area is vegetated and/or permanently stabilized and that the spillway and ponding area is sized to adequately treat, impound, and convey the runoff from the tributary area.

*Depth:* Provide a temporary minimum ponding depth of 6 to 8 inches. The design must specify fiber rolls of adequate diameter, foam barriers, or sandbags of adequate thickness to provide the minimum ponding depth, and spillways with minimum elevations and width must be provided to limit the maximum ponding depth.

### *Relationship to Other Erosion and Sediment Control Measures*

Erosion control measures in the contributing areas must be in place to minimize the amount of sediment that must be treated at inlets. Culvert Inlet Protection is installed as a secondary measure to remove residual sediment that was not removed by other measures such as check dams, grassed swales, and sediment traps.

### *Common Failures or Misuses*

- Sediment accumulation resulting in reduced settling capacity.
- Improper installation, resulting in sediment bypassing filter and entering the culvert.
- Tearing, undermining, or collapsing of the barrier, resulting in sediment entering the culvert.



### SPECIFICATIONS

#### Standard Specification

- 667 – Culvert Inlet Protection

#### Drawing

- BMP – 08.00 Culvert Inlet Protection

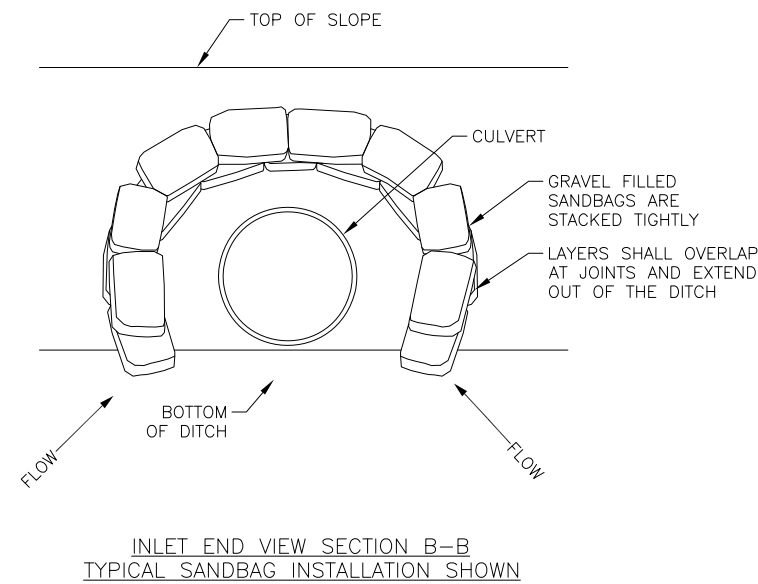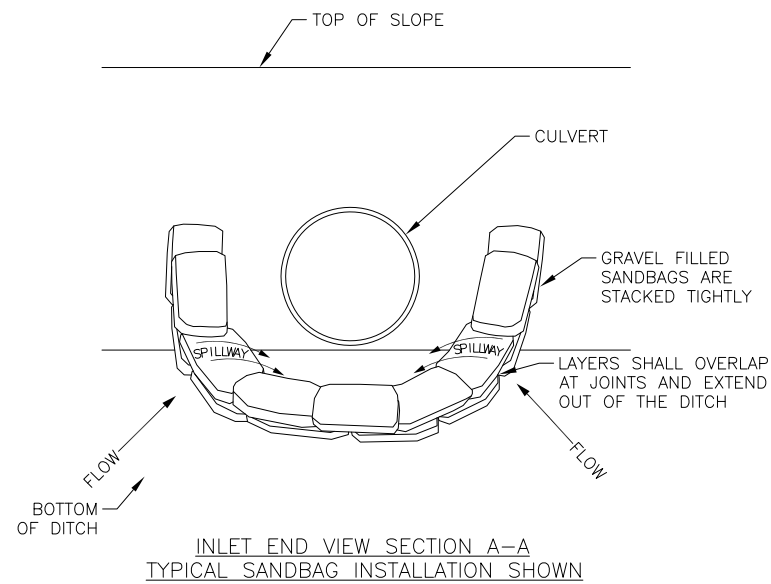

CULVERT INLET PROTECTION NOTES:

MATERIALS

BARRIER MATERIALS:

1. PREFABRICATED BARRIER SYSTEM, AS SHOWN ON DRAWING BMP-13.00.
2. SANDBAG BARRIER, CONSISTING OF TIGHTLY WOVEN BURLAP OR WOVEN GEOTEXTILE BAG MATERIAL SUFFICIENTLY DURABLE TO REMAIN INTACT FOR THE TIME INTENDED. BAGS 2/3 FULL OF GRAVEL OR SAND WITH A GRADATION SUCH THAT NO FINE SEDIMENT PASSES THROUGH THE BAG. IF THE SANDBAGS ARE NEEDED FOR MORE THAN ONE SUMMER SEASON, PROVIDE BAG MATERIAL THAT HAS ULTRAVIOLET STABILITY OF AT LEAST 70% IN CONFORMANCE WITH ASTM D4355 REQUIREMENTS. SECURELY CLOSE THE SANDBAGS.

3. FIBER ROLL, AS SHOWN ON DRAWING BMP-10.00, 8 INCHES MINIMUM DIAMETER.
4. COMPOST SOCK, AS SHOWN ON DRAWING BMP-05.00.

INSTALLATION



1. INSTALL WHERE INDICATED IN THE PLANS OR WHERE APPROVED BY THE ENGINEER.
2. ASSURE THAT BARRIER MAKES FULL CONTACT WITH SOIL ALL AROUND THE INLET.
3. IF PROTECTING BOTH DITCHLINE AND TOP OF PIPE, THE PROTECTION BARRIER CAN BE A SINGLE CONTINUOUS CIRCLE.
4. IN ADDITION:
  - a. PREFABRICATED BARRIER SYSTEM - ANCHOR WITH WIRE STAPLES ON SOIL, OR ADHESIVE ON PAVEMENT. OVERLAP 6 INCHES.
  - b. SANDBAG BARRIER - LAYER AND OVERLAP AT JOINTS.
  - c. FIBER ROLL - TRENCH A MINIMUM OF 2 INCHES. SEE STAKING REQUIREMENTS ON DRAWING BMP-10.00.
  - d. COMPOST SOCK - SEE STAKING REQUIREMENTS ON DRAWING BMP-05.00. STAKING REQUIRED WHEN PLACED WITHIN FLOWLINE/DITCH.

INSPECTION

1. CONFIRM THAT BARRIERS ARE IN FULL CONTACT WITH THE SOIL AND THAT BYPASS ROUTES ARE NOT PRESENT.
2. INSPECT FOR SEDIMENT ACCUMULATION, DISPLACEMENT, AND STRUCTURAL DAMAGE.

MAINTENANCE

1. REMOVE ACCUMULATED SEDIMENT BEFORE IT REACHES ONE-THIRD OF THE DESIGN DEPTH OF SPILLWAY.
2. RESTORE STRUCTURE TO ITS ORIGINAL DIMENSIONS AND FULL CONTACT WITH SOIL AROUND THE INLET AS SOON AS PRACTICABLE.
3. REPAIR ANY STRUCTURAL DAMAGE, INCLUDING REPLACING DAMAGED SANDBAGS, AS SOON AS PRACTICABLE.

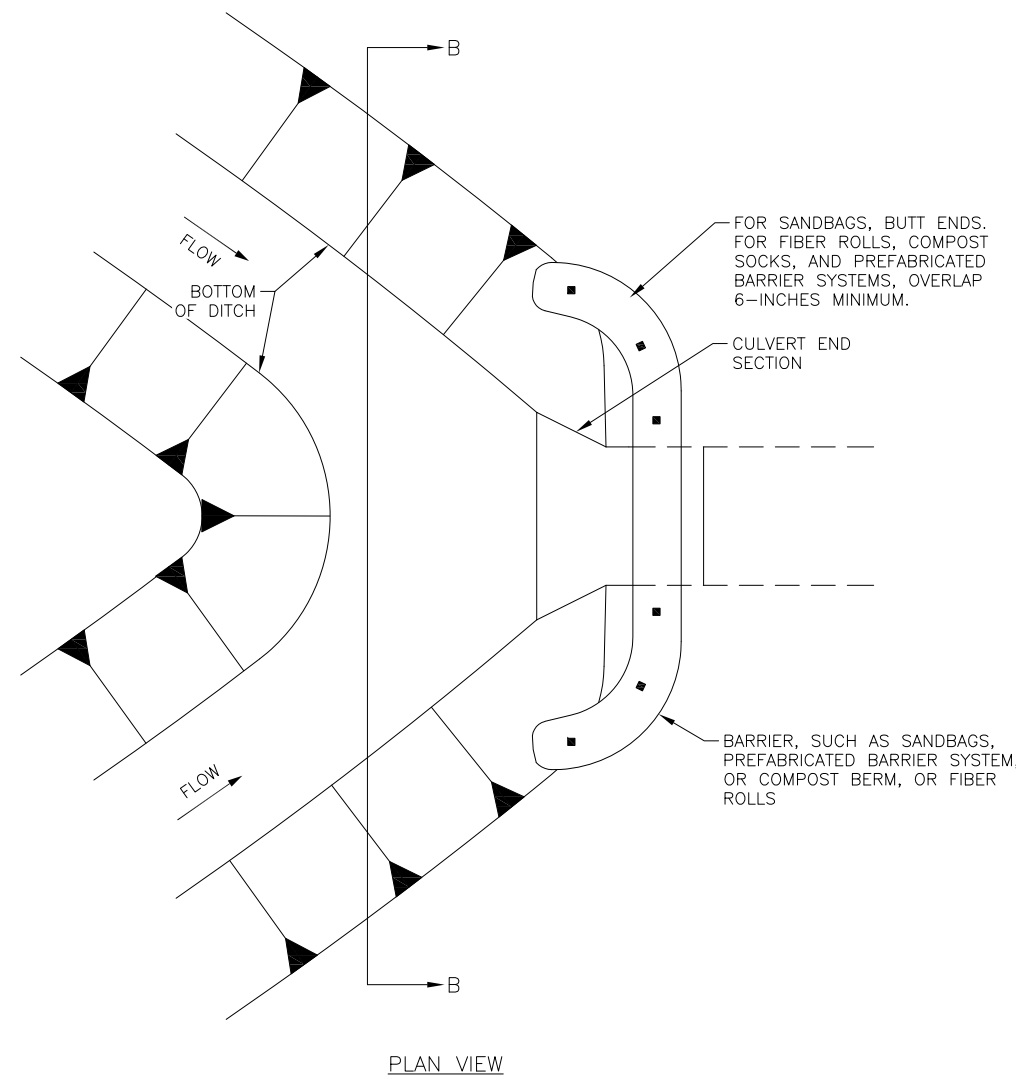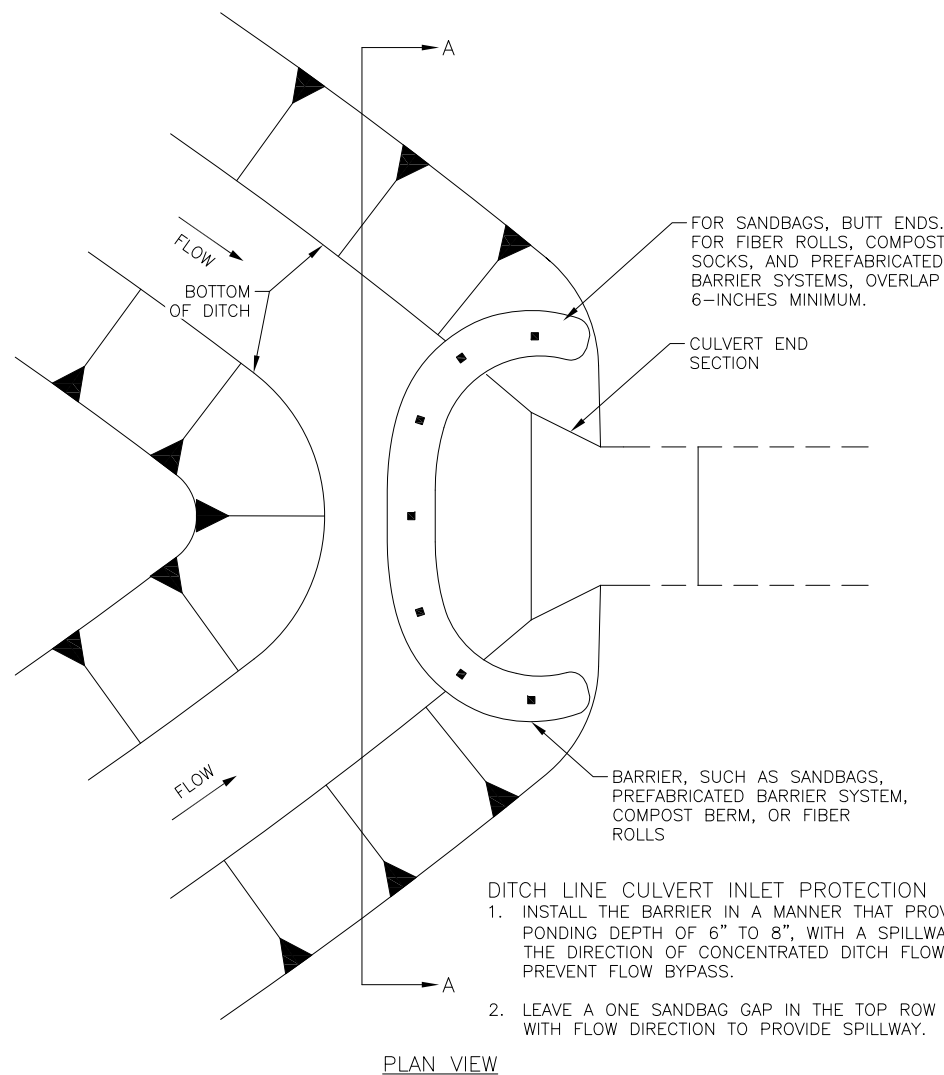

DITCH LINE CULVERT INLET PROTECTION NOTES:

1. INSTALL THE BARRIER IN A MANNER THAT PROVIDES PONDING DEPTH OF 6" TO 8", WITH A SPILLWAY IN THE DIRECTION OF CONCENTRATED DITCH FLOW TO PREVENT FLOW BYPASS.
2. LEAVE A ONE SANDBAG GAP IN THE TOP ROW IN LINE WITH FLOW DIRECTION TO PROVIDE SPILLWAY.

DITCH LINE CULVERT INLET PROTECTION  
NOT TO SCALE

TOP OF PIPE CULVERT INLET PROTECTION  
NOT TO SCALE


REVISIONS		
Date	Description	By

State of Alaska DOT&PF

CULVERT INLET PROTECTION

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

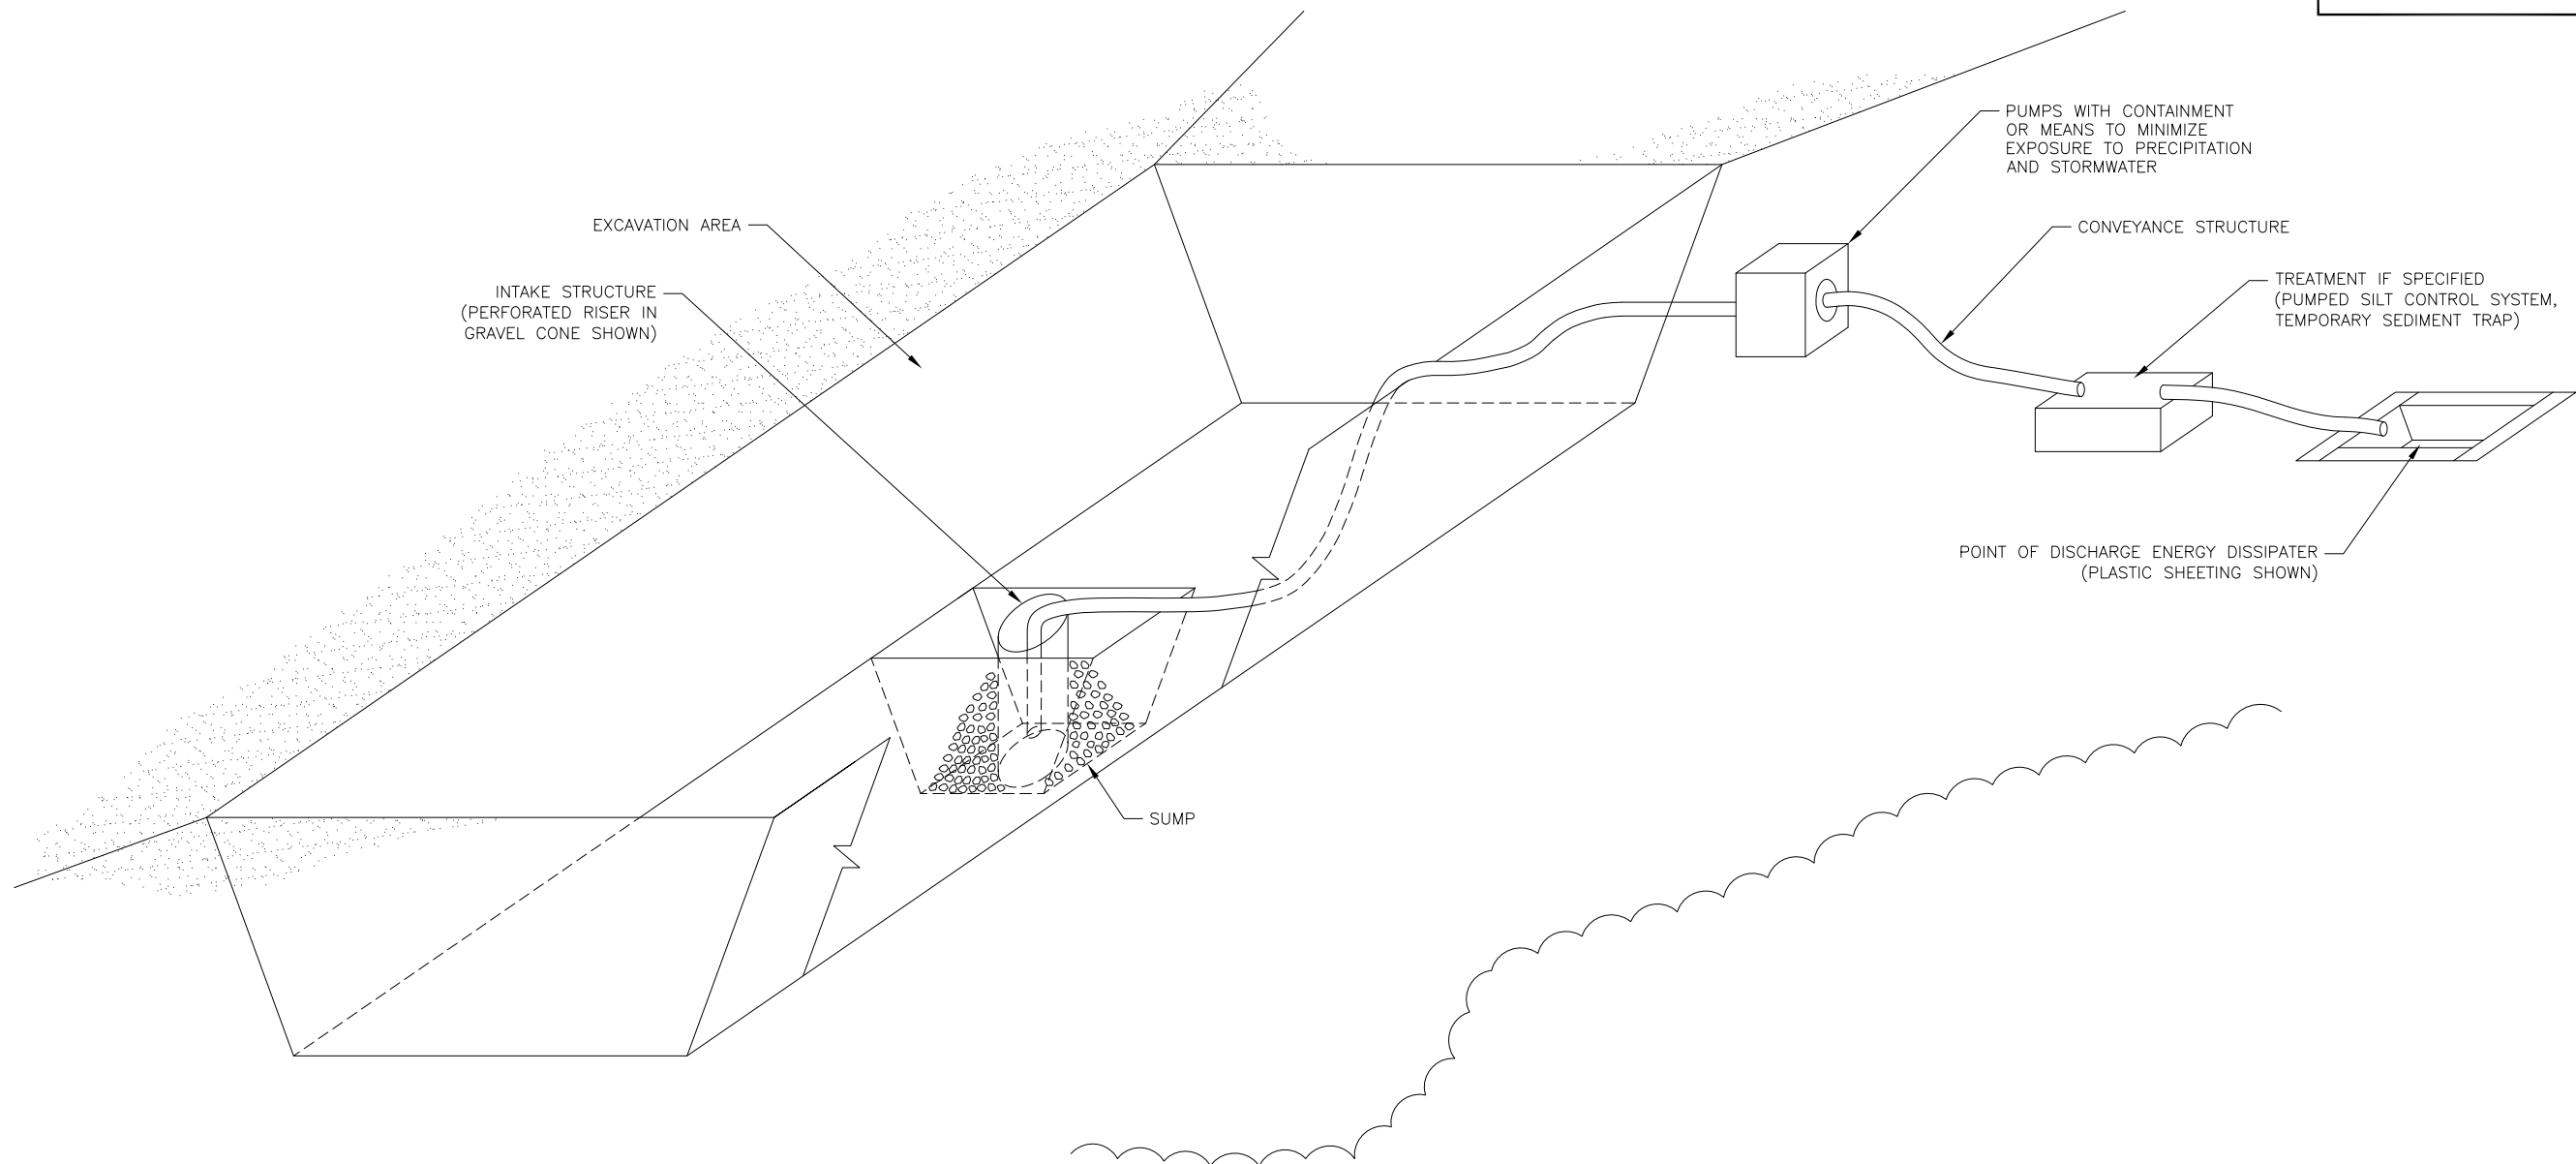

**EXCAVATION DEWATERING**  
NOT TO SCALE

**EXCAVATION DEWATERING NOTES:**

**MATERIALS**  
PUMP: SIZED FOR DESIGN FLOW IN CONTRACT, INTAKE LINE, FITTINGS, AND NOZZLES.

**INTAKE STRUCTURES:** RISERS, SCREENS, GRAVEL CONES, GRAVEL FILTER BERMS, GEOTEXTILE, OR EQUIVALENT,

**CONVEYANCE SYSTEM:** FLEXIBLE HOSE, WITH PROPER FITTINGS OR EQUIVALENT.

**ENERGY DISSIPATER:** PLASTIC SHEETING, RIPRAP, SANDBAGS, T-BAR SPREADER, OR EQUIVALENT.

**TREATMENT:** UPLAND VEGETATIVE AREA, PUMPED SILT CONTROL SYSTEM, OR TEMPORARY SEDIMENT TRAP.

**INSTALLATION**

1. INSTALL THE CONVEYANCE STRUCTURE. FOR PIPED CONVEYANCE, ENSURE THAT IT IS ADEQUATELY SECURED AGAINST MOVEMENT DURING PUMPING.
2. PLACE THE PUMP IN AN AREA DESIGNED FOR ITS USE AND OPERATION.
3. INSTALL SPILL PREVENTION BMPS PRIOR TO OPERATION.
4. INSTALL THE ENERGY DISSIPATER.
5. CONNECT THE CONVEYANCE STRUCTURE TO THE DOWNSTREAM DISCHARGE POINT.

**INSPECTION**

1. WHEN PUMPING, MONITOR PUMPS AND INTAKE AND DISCHARGE POINTS.
2. INSPECT THE CONVEYANCE STRUCTURE FOR LEAKS, EROSION, OR OTHER DEFECTS.
3. INSPECT THE TREATMENT CONTROLS FOR BYPASS, CLOGGING, AND SIGNS OF INADEQUATE TREATMENT.
4. INSPECT DISCHARGE POINT FOR EROSION OR FAILURE OF THE ENERGY DISSIPATION MATERIAL.
5. INSPECT THE EQUIPMENT AREA FOR PROPERLY STORED FUEL AND OTHER POTENTIALLY HAZARDOUS SUBSTANCES.

**MAINTENANCE**

1. REINFORCE, REPAIR, OR RESTORE ANY PORTION OF THE TREATMENT CONTROLS, CONVEYANCE SYSTEM, OR ENERGY DISSIPATER.

**REMOVAL**

1. REMOVE THE INTAKE HOSE.
2. REMOVE THE ENERGY DISSIPATER AND TREATMENT CONTROLS, IF THEY ARE NOT PART OF THE PERMANENT SITE FEATURES.
3. REMOVE THE CONVEYANCE SYSTEM.
4. AS REQUIRED, BACKFILL OR REGRADE THE CONVEYANCE SYSTEM ALIGNMENT AND TREATMENT AREA AND RESTORE TO ORIGINAL CONTOURS.
5. REGRADE AND SEED OR PERMANENTLY STABILIZE ALL DISTURBED AREAS.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF

**EXCAVATION DEWATERING**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

## **BMP 10.01.a. Fiber Rolls for Erosion Control**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

The purpose of Fiber Rolls for Erosion Control is to shorten the slope and help to slow, filter, and spread overland flows. They capture sediment, organic matter, and seeds that might otherwise be washed downslope.

#### *Description*

Fiber Rolls are long rolls of material such as wood excelsior, rice or wheat straw, flax, coconut fibers, or compost, which is rolled or bound in a tight tubular roll and wrapped in plastic or biodegradable netting. They are typically about 8 inches in diameter and under 30 feet long.

They may come pre-fabricated or they can be fabricated on-site.

#### *Other Names*

Wattles, Straw Wattles, Straw Rolls, Coir Logs, Excelsior Log, Straw Log, Filter Logs, Fiber Logs.

#### *Applicability*

Fiber Rolls can be applied to steep or long slopes and slopes that are susceptible to freeze/thaw activity, sheet and rill erosion, or dry ravel. They can be placed along the toe, top, face, and at grade-breaks on disturbed or erodible slopes. They can be used as a temporary berm to direct flow around exposed soils or to a sediment trap and as a check dam in unlined ditches. They can be used at other locations at the project site for sediment control.

#### *Selection Considerations*

- Use in areas of low shear stress.
- Avoid use on slopes that could build up ice; for instance, where seepage occurs.
- They are effective for one to two seasons.
- Fiber Rolls can be staked to the ground using willow cuttings to increase the revegetation effort. Since the fiber roll will retain moisture, it will provide a good site for the willow cuttings to root. The Alaska Department of Fish and Game (ADF&G) has prepared guidance for willow cuttings and dormant cuttings in the

*Streambank Revegetation and Protection: A Guide for Alaska* at:

<http://www.adfg.alaska.gov/index.cfm?adfg=streambankprotection.staking>

and

<http://www.adfg.alaska.gov/index.cfm?adfg=streambankprotection.cuttings>

- The quantity of sediment that a roll can capture prior to maintenance is limited to one-half the exposed height of the roll.
- Rolls will be difficult to move once they are saturated. Determine whether Fiber Rolls must be removed at the end of the project based on the use of the area. If removal is required, specify in the plan set and require removal of netting upon final stabilization.

#### *Relationship to Other Erosion and Sediment Control Measures*

Fiber Rolls are best used in combination with seeding, mulch, hydraulic erosion control products (HECPs), and/or rolled erosion control products (RECPs). They can be used to stabilize slopes until the permanent vegetation becomes established.

#### *Common Failures or Misuses*

- Unless they are placed in a trench, run-off can flow underneath Fiber Rolls and cause failure.
- Unless they are properly staked, Fiber Rolls can be transported by high flows.
- Water can flow between Fiber Rolls if they are not overlapped.
- Fiber Rolls must be placed perpendicular to flow (parallel to the slope contour).
- Fiber Rolls will not work if the slope is slumping, creeping, or sliding.

### SPECIFICATIONS

#### Standard Specification

- 669 – Fiber Rolls for Erosion and Sediment Control

#### Drawings

- BMP-10.00 Fiber Rolls for Erosion and Sediment Control
- BMPs -31.00, 32.00 and 33.00 Temporary Check Dam

## BMP 10.01.b. Fiber Rolls for Sediment Control

---

### DESIGN CONSIDERATIONS

#### *Objectives*

The purpose of Fiber Rolls for Sediment Control is to trap sediment and prevent it from being transported out of the project area, to another area, or to waters of the U.S.

#### *Description*

Fiber Rolls are long rolls of material such as wood excelsior, rice or wheat straw, flax, coconut fibers, or compost, which is rolled or bound in a tight tubular roll and wrapped in plastic or biodegradable netting. They are typically about 8 inches in diameter and under 30 feet long.

They may come pre-fabricated or they can be fabricated on-site.

#### *Other Names*

Wattles, Straw Wattles, Straw Rolls, Coir Logs, Excelsior Log, Straw Log, Filter Logs, Fiber Logs.

#### *Applicability*

Fiber Rolls can be placed at the perimeter of a project, below the toe of exposed and erodible slopes, and around temporary stockpiles. They may also be used for inlet protection. They can be used at other locations at the project site for erosion control.

#### *Selection Considerations*

- Use in areas of low shear stress.
- Avoid use on slopes that could build up ice; for instance, where seepage occurs.
- They are effective for one to two seasons.
- Fiber Rolls can be staked to the ground using willow cuttings to increase revegetation efforts. Since the Fiber Roll will retain moisture, it will provide a good site for the willow cuttings to root. The Alaska Department of Fish and Game has prepared guidance for willow cuttings and dormant cuttings in the *Streambank Revegetation and Protection: A Guide for Alaska* at:  
<http://www.adfg.alaska.gov/index.cfm?adfg=streambankprotection.staking>

and

<http://www.adfg.alaska.gov/index.cfm?adfg=streambankprotection.cuttings>

- The quantity of sediment that a roll can capture prior to maintenance is limited to one-half the exposed height of the roll.
- Rolls will be difficult to move once they are saturated. Determine whether Fiber Rolls must be removed at the end of the project based on the use of the area. If removal is required, specify in the plan set and require removal of netting upon final stabilization.

#### *Relationship to Other Erosion and Sediment Control Measures*

Fiber Rolls are best used in combination with seeding, mulch, hydraulic erosion control products (HECPs), and/or rolled erosion control products (RECPs).

- Fiber Rolls can be used in place of silt fence. The advantage of fiber rolls over silt fence is that installation is much easier, they do not have to be removed, and hydroseeding can be done after their installation.
- Compost socks can be used in place of Fiber Rolls and do not require trenching. Compost socks are also heavy enough that they can be placed on paved surfaces.
- A prefabricated barrier system can be used in place of fiber rolls and requires a smaller trench. A prefabricated barrier system can also be adhered to paved surfaces.

#### *Common Failures or Misuses*

- Unless they are placed in a trench and have tamped backfill in the trench on the uphill side, runoff can flow underneath Fiber Rolls and cause failure.
- Unless they are properly staked, Fiber Rolls can be transported by high flows.
- Water can flow between Fiber Rolls if they are not overlapped.

- Fiber Rolls must be placed perpendicular to flow (parallel to the slope contour).
- Fiber Rolls will not work if the slope is slumping, creeping, or sliding.

### SPECIFICATIONS

#### Standard Specification

- 669 – Fiber Rolls for Erosion and Sediment Control

#### Drawings

- BMP-10.00 Fiber Rolls for Erosion and Sediment Control
- BMP-08.00 Culvert Inlet Protection
- BMPs -25.00, 26.00, 27.00, 28.00 and 29.00 Storm Drain Inlet Sediment Protection



### FIBER ROLL GENERAL NOTES:

#### MATERIALS

**FIBER ROLLS:** THE NETTING MAY BE UV-DEGRADABLE POLYPROPYLENE, BIODEGRADABLE BURLAP, JUTE OR COIR. THE FILLINGS MAY BE STRAW, FLAX, RICE, OR COCONUT-FIBER. MINIMUM DIAMETER OF 6 INCHES.

**STAKES:** 1-INCH BY 1-INCH WOODEN STAKES 24 INCHES LONG (18 INCHES IF SOILS ARE ROCKY) OR 3/8-INCH REBAR WITH SAFETY CAPS OR 3/4-INCH TO 1 1/2-INCH DIAMETER LIVE WILLOW CUTTINGS. IF USING LIVE WILLOW CUTTINGS, DO NOT INSTALL ROPE.

#### INSTALLATION

1. PLACE FIBER ROLLS PERPENDICULAR TO FLOW AND PARALLEL TO THE SLOPE CONTOUR.
2. AT THE END OF THE ROLL, TURN THE END UPSLOPE TO PREVENT RUN-OFF FROM GOING AROUND THE ROLL END.

#### INSPECTION

1. ENSURE THAT THE ROLLS ARE IN CONTACT WITH THE SOIL AND THOROUGHLY ENTRENCHED.
2. LOOK FOR SCOURING UNDERNEATH THE ROLLS.
3. LOOK FOR SPLIT, TORN, UNRAVELING, OR SLUMPING FIBER ROLLS.
4. ENSURE EQUIPMENT HAS NOT DRIVEN OVER THE INSTALLED FIBER ROLLS.

#### MAINTENANCE


1. REPLACE DAMAGED SECTIONS OF FIBER ROLL.
2. REMOVE ACCUMULATED SEDIMENT UPSLOPE OF THE ROLL BEFORE IT REACHES ONE-HALF THE DISTANCE BETWEEN THE TOP OF THE FIBER ROLL AND THE GROUND SURFACE. WHEN PROTECTING A WATER BODY OR STORM DRAIN INLET. REMOVE ACCUMULATED SEDIMENT UPSLOPE OF THE ROLL WHEN IT REACHES ONE-THIRD OF THE DISTANCE BETWEEN THE TOP OF THE FIBER ROLL AND THE GROUND SURFACE.

#### REMOVAL


1. REMOVE FIBER ROLLS WHEN THE AREA IS STABILIZED OR WHEN THEY ARE NO LONGER NECESSARY.
2. COLLECT AND DISPOSE OF THE ACCUMULATED SEDIMENT.
3. REMOVE AND DISPOSE OF FIBER ROLLS.
4. FILL THE TRENCHES AND STAKE HOLES TO BLEND WITH THE ADJACENT GROUND AND REVEGETATE AS NECESSARY.

#### RETENTION


1. LEAVE FIBER ROLLS IN PLACE WHEN THE AREA IS STABILIZED OR WHEN THEY ARE NO LONGER NECESSARY.
2. COLLECT AND DISPOSE OF THE ACCUMULATED SEDIMENT.
3. REMOVE AND DISPOSE OF THE NETTING, STAKES, AND ROPE.

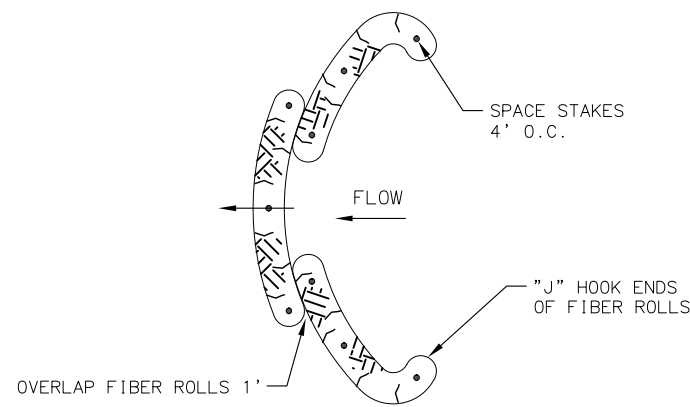

PLAN

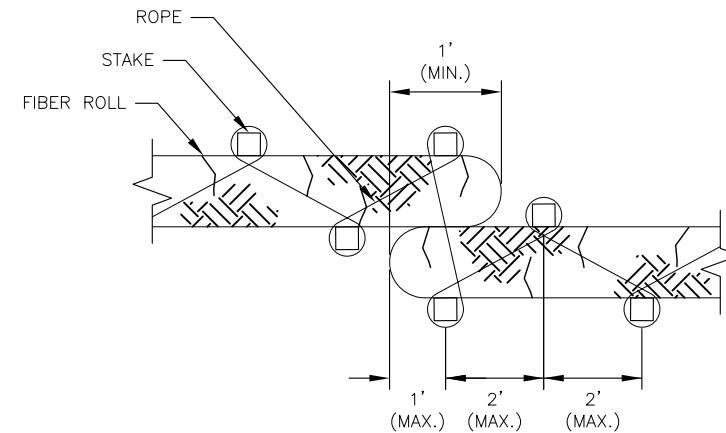

PLAN

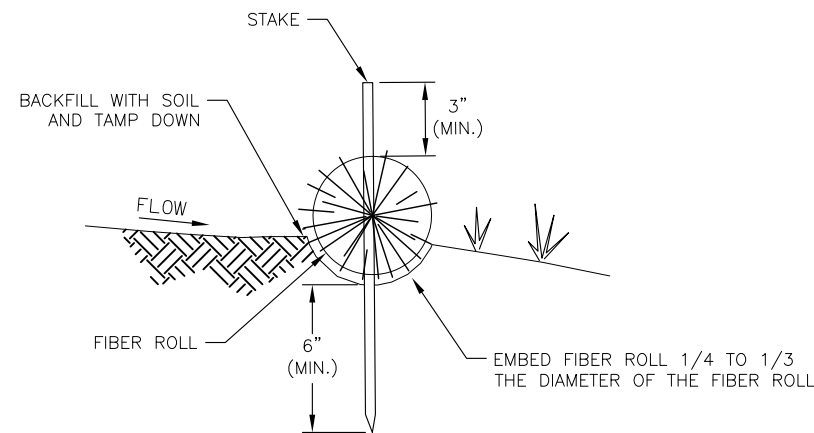


SECTION

### TRENCHED INSTALLATION

NOT TO SCALE

#### TRENCHED INSTALLATION NOTES:

1. DIG TRENCHES AND PLACE FIBER ROLLS IN THE TRENCHES.
2. CURVE BACK THE UPSLOPE END OF THE FIBER ROLL IN A "J" HOOK.
3. SPREAD EXCAVATED MATERIAL EVENLY ALONG THE UPHILL SLOPE AND COMPACT USING HAND TAMPING OR OTHER METHODS.
4. STAKE THE ROLL EVERY 4 FEET AND WITHIN 1-FOOT OF THE ENDS. LEAVE 3 INCHES OF THE STAKE ABOVE THE ROLL.
5. DRIVE STAKES THROUGH THE MIDDLE OF THE FIBER ROLL.
6. IF REQUIRED, PILOT HOLES FOR THE STAKES MAY BE CREATED BY DRIVING A STRAIGHT BAR THROUGH THE ROLL.

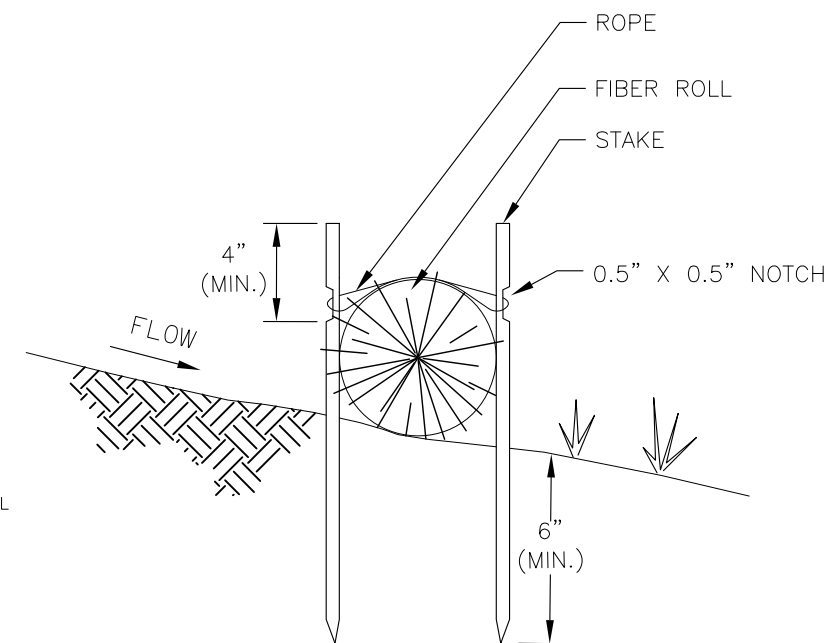


SECTION

### ROPE INSTALLATION

NOT TO SCALE

ALL-PURPOSE BIODEGRADABLE ROPE 3/8 OR LARGER

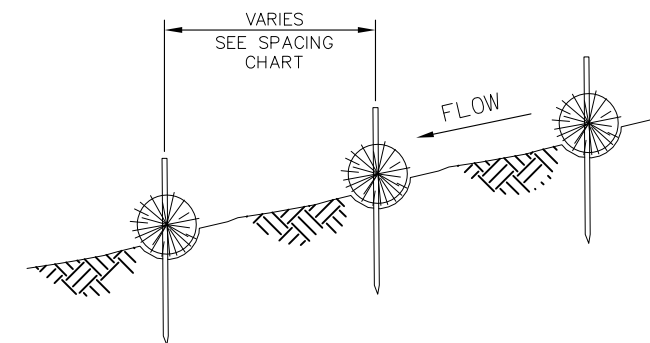

### TYPICAL SPACING CHART

SLOPE	SPACING (FEET)
1:1	10
2:1	20
3:1	30

### SLOPE INSTALLATION

NOT TO SCALE

#### SLOPE INSTALLATION NOTES:

1. INSTALL ON A SLOPE TO SHORTEN THE SLOPE LENGTH.
2. START INSTALLATION DOWNSLOPE.
3. SPACE ROLLS ACCORDING TO THE SPACING CHART AND DECREASE SPACING ON MORE ERODIBLE SOILS AND INCREASE SPACING ON ROCKY SOILS.

REVISIONS		
Date	Description	By
7/6/2018	Adjusted Stake Spacing from 4' to 2' in Rope Plan	Missler

State of Alaska DOT&PF

## FIBER ROLLS FOR EROSION AND SEDIMENT CONTROL

A  
P  
P  
R  
O  
V  
E  
D

Date 7/06/2018

## **BMP 12.00. Plastic Covering**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Plastic covering is used to temporarily protect soils, slopes, and stockpiles from erosion by wind or water.

#### *Description*

Plastic sheeting covers surfaces that are susceptible to erosion to provide temporary protection from the elements. The sheeting is keyed in at the top, overlapped at seams, and fastened or weighted down in a grid pattern.

#### *Other Names*

Visqueen, plastic sheeting.

#### *Applicability*

The applicability of plastic sheeting is limited to covering stockpiles or very small graded areas for urgent, short-term protective treatment (such as through one imminent storm event or for overwintering disturbed slopes) until alternative measures, such as seeding and mulching, can be installed. It is not recommended as cover for seeded slopes for more than two days. This temporary measure should only be used in conjunction with a sediment control (perimeter control) BMP.

#### *Selection Considerations*

Select plastic sheeting based on the expected functional longevity required to protect the stockpile or soil. Evaluate given the following limitations:

- Plastic sheeting is easily vandalized and torn, is subject to photo degradation, and must be disposed of in a landfill.
- Freezing temperatures weaken the sheeting and make it prone to tearing.
- Plastic sheeting results in 100% runoff, which may cause serious erosion problems in the areas receiving the runoff.
- Plastic prevents infiltration and soil saturation.

#### *Relationship to Other ESC Measures*

Plastic sheeting may be used temporarily before other stabilization measures, such as hydraulic

erosion control products (HECPs) or rolled erosion control products (RECPs).

#### *Common Failures or Misuses*

- Improper installation is a common problem with plastic sheeting. Plastic sheeting must be keyed in at the top of the slope to prevent undercutting.
- Installation upslope of steep and/or unstable slopes can lead to adverse effects from concentrated runoff.
- Allowing it to remain in place longer than its useful life. Plastic becomes brittle over time due to photo degradation and develops holes and tears.
- Improper weighting or too-wide spacing between weights can cause it to be blown off in the wind.


### SPECIFICATIONS

#### Standard Specification


- 674 – Plastic Covering

#### Drawing


- BMP-12.00 – Plastic Covering

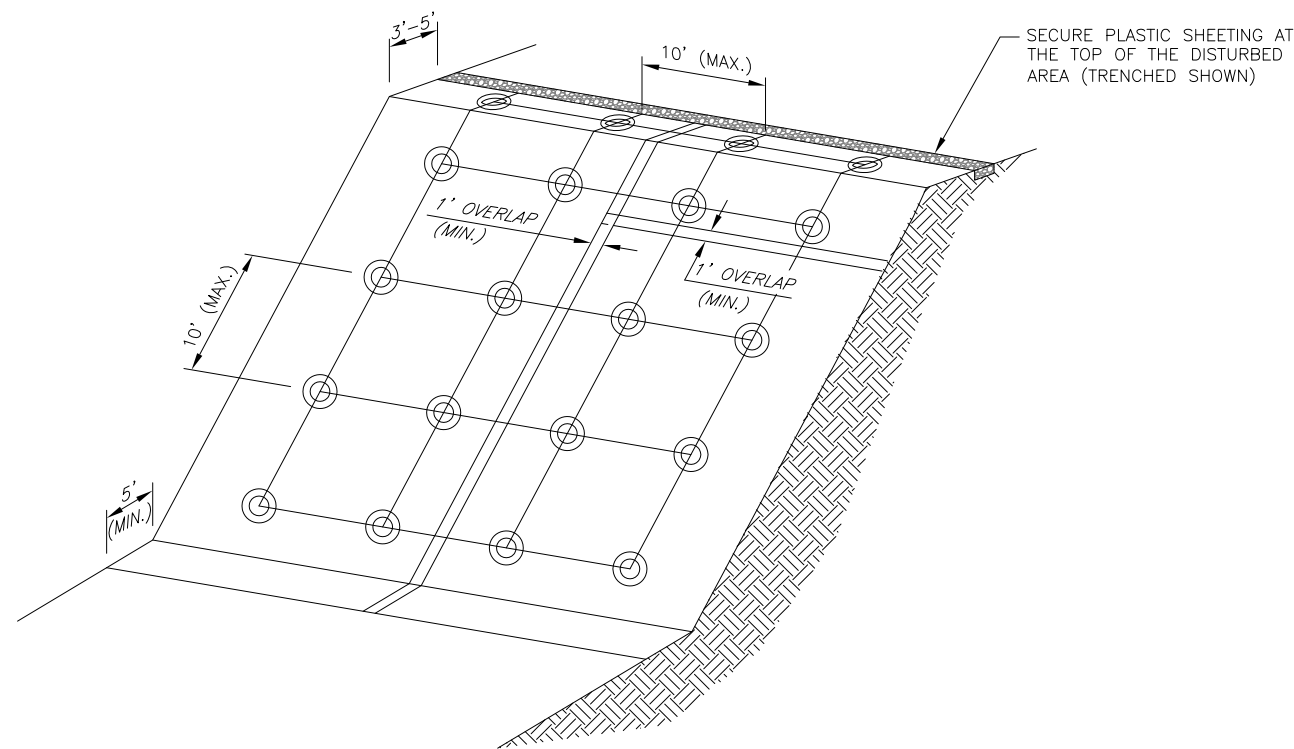

PERSPECTIVE

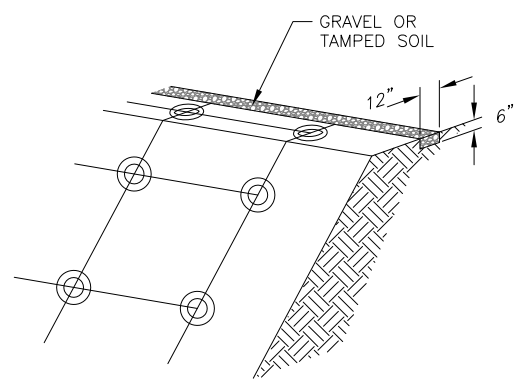

TRENCHED DETAIL

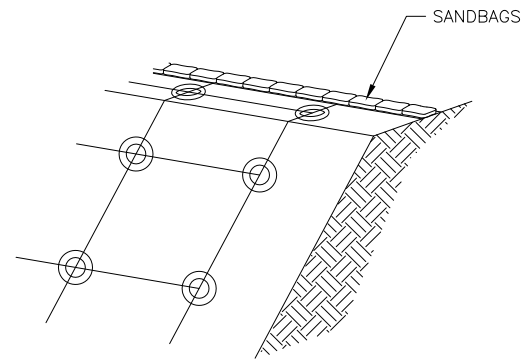

WEIGHTED DETAIL

PLASTIC COVERING  
NOT TO SCALE

PLASTIC COVERING NOTES:

MATERIALS

PLASTIC COVERING: PLASTIC COVERING SHALL MEET THE REQUIREMENTS OF ASTM D 4397 FOR POLYETHYLENE SHEETING HAVING A MINIMUM THICKNESS OF 6 MIL.

FASTENERS OR WEIGHTS: FASTENERS OR WEIGHTING OBJECTS, SUCH AS SANDBAGS, TIRES, OR OTHER SIMILAR MATERIALS.

INSTALLATION

1. INSTALL PLASTIC PARALLEL WITH THE SLOPE, NOT PERPENDICULAR. PLASTIC MAY BE INSTALLED PERPENDICULAR TO A SLOPE IF THE SLOPE LENGTH IS LESS THAN 10 FEET. OVERLAP UPHILL SHEET OVER DOWNHILL SHEET A MINIMUM OF 1-FOOT.
2. SECURE THE PLASTIC SHEETING AT THE TOP OF THE SLOPE BY KEYING INTO A TRENCH OR WEIGHT WITH A CONTINUOUS LINE OF SANDBAGS SO THAT NO WATER CAN FLOW UNDERNEATH.
3. INSTALL WEIGHTS ON ROPES OR FASTENERS IN A 10-FOOT MAXIMUM GRID, TO SECURE THE PLASTIC TIGHTLY AGAINST THE SOIL.
4. INSPECT WEIGHTS TO MAKE SURE THEY ARE STILL IN PLACE, REPLACE AS NEEDED OR ADD ADDITIONAL WEIGHT IF THERE IS NOT A SUFFICIENT AMOUNT ON THE SLOPE.
5. TAPE, FASTEN, OR WEIGHT SEAMS ALONG THEIR ENTIRE LENGTH WITH A MINIMUM OF 1-FOOT OF OVERLAP AT ALL SEAMS.
6. SECURE EDGES TO PREVENT WATER FROM ERODING GROUND UNDERNEATH AND WIND FROM LIFTING THE COVER.

INSPECTION

1. INSPECT SHEETING AFTER INSTALLATION AND ACCORDING TO ESTABLISHED SCHEDULES.
2. CHECK FOR EROSION, UNDERMINING, ANCHORAGE (KEYING AND EMBEDDING) FAILURE, TORN SHEETS, AND DETERIORATION.

MAINTENANCE

1. REPAIR FAILURES AS SOON AS PRACTICABLE.
2. IF WASHOUT OR BREAKAGES OCCUR, REPAIR DAMAGE TO THE SLOPE AND REINSTALL THE MATERIAL AS SOON AS PRACTICABLE.

REMOVAL

1. REMOVE PLASTIC SHEETING AND WEIGHTS PRIOR TO STABILIZING THE AREA OR WHEN CONSTRUCTION ACTIVITY IS COMPLETED.
2. AFTER REMOVAL, FILL TRENCHES TO BLEND WITH THE ADJACENT GROUND AND REVEGETATE, AS NECESSARY.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF

PLASTIC COVERING

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

## **BMP 20.00. Silt Fence**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

The purpose of Silt Fence is to trap sediment and prevent it from being transported out of the project area to another area, or to a water body.

#### *Description*

Silt Fence is geotextile fabric secured to posts and secured in a trench, and/or with sandbags or drain rock.

#### *Other Names*

Geotextile for Sediment Control, Sediment Barrier.

#### *Applicability*

Silt Fence is used downslope from erosion-susceptible terrain to trap sheet flow run-off before the drainage exits the project site. Adequate space must be provided for pooled water on the uphill side of the fence.

Barrier locations are chosen based on site features and conditions (e.g. soil types, climate, terrain features, sensitive areas, etc.), design plans, existing and anticipated drainage courses, and other available erosion and sediment controls. Typical barrier sites are catchpoints beyond the toe of fill, or on sideslopes above waterways or drainage channels.

Although drainage in contact with the fence is to some degree filtered by the geotextile, the fabric's small pores not only block larger-sized eroded particles but also severely restrict water exfiltration rates and behaves like a dam. For this reason, Silt Fences are not to be used for concentrated flows in continuous flow streams or ditches; or as check dams.

Silt Fence can be installed in standing water to provide time for particles to settle.

Silt Fences are used to encircle stockpiled erodible material to prevent off-site sediment transport.

Since Silt Fence installation can cause significant damage, alternative best management practices (BMPs) should be considered for installation instead of Silt Fence. Use Fiber Rolls, compost socks, brush bundles to filter small amounts of sediment in shallow gullies or ditches. Temporary settlement

basins, gravel berms, or foam barriers can be used as alternatives to Silt Fence.

Do not use Silt Fence on airport runways, taxiways, aprons, or within the Runway Safety Areas.

#### *Selection Considerations*

Use of sediment control measures and the level of effort should be commensurate with the potential problem. Silt Fence is not to be used solely as a project delineator (see Site Delineation, BMP-55).

- Use of a Silt Fence sediment control measure is usually more complex, expensive, and maintenance-prone than other sediment control measures.
- Consider impacts of the fence installation, maintenance, and removal on sensitive areas needing protection (e.g. avoid equipment encroachment on wetlands).
- Consider potential undesirable effects of fence placement (e.g. a trench in ground that will not readily “heal” after fence removal; undesirable effects of extent or depth of ponded water, etc.)
- An equipment access route and space for fence installation, maintenance, and removal must be available without encroaching into sensitive areas or off the project limits.
- Wire reinforcement can be used with Silt Fence by backing the geotextile fabric with chain link, polymeric mesh, or welded wire fencing. Below is a list of considerations for adding wire reinforcement to Silt Fence installation:
  - Consider using wire reinforcement and longer posts to resist overturn.
  - Consider using wire reinforcement in areas of high wind.
  - Consider using wire reinforcement for standing water installations.

#### *Types of Silt Fence for Purchase:*

- *With Pockets:* Sewn-in pocket Silt Fence is geotextile that has factory-sewn pockets for the posts and does not require post fasteners.
- *Without Pockets:* Silt Fence without pockets is geotextile fabric that requires fasteners to attach

the fabric to the posts or Silt Fence that is available with posts pre-attached.

- **Wire Reinforcement:** When Silt Fence is wire reinforced, the geotextile fabric is backed with chain link or welded wire fencing.

*Methods of Installation:*

- **Trenchless:** Drive support posts into the ground, attach geotextile on the upslope side of the line of stakes with a portion lying flat on the ground, and place clean rock or sandbags on the geotextile. Using sandbags to anchor the fence bottom is a less desirable method because of the tendency for undermining. Require removal of the rock or sandbags when the fence is removed.
- **Trench Key:** Drive support posts into the ground, excavate a trench on the uphill side along the line of the stakes, attach geotextile, and bury fence bottom. Use soil to backfill trench and compact to secure fence bottom. Compacted soil is preferred to gravel fill.
- **Machine Slice:** This method requires a Silt Fence installation machine or attachment. The machine utilizes a blade that plows or slices the fabric directly into the soil minimizing soil disturbance. Displaced soil must be manually backfilled into the slice before the tractor is used to mechanically compact the soil.

*Design*

Locate Silt Fence at a distance from the base of the slope or pile such that there is space for temporary storage of potential accumulated material. Consider a space of 4 feet for worker access if feasible. The grade and length of slope as well as soil erodibility must be considered when specifying silt fence. If the slope is steep or long, consider intermediate slope breaks.

Below are design considerations for Silt Fence that is not wire-reinforced:

- **Design Life:** 1 season (6 months) or less.
- **Contributing Sheet Flow Drainage Area:** Not to exceed 0.25 acres/100 ft. of fence.
- **Maximum Height of Ponding Water:** 18 in.

*Guidelines for Maximum Slope Length for Silt Fence:*

Slope (H:V)	Length of Slope Above Fence, Assumes 30 In High Fence
10:1	150 ft.
6:1	85 ft.
5:1	70 ft.
4:1	55 ft.
3:1	40 ft.
2:1	25 ft.
1:1	15 ft.

*Relationship to Other Erosion and Sediment Control Measures*

Sediment control measures are secondary to erosion prevention or soil stabilizing measures. Silt Fence may be used as part of a sequential system with other temporary or permanent measures such as vegetation, check dams, settling ponds, etc. Occasional flow velocity increases may be offset using corrective measures such as rock berms or other redirecting energy absorbers.

*Common Failures or Misuses*

- Inappropriate for intended function (e.g. used for check dam, flow diversion, diversion dam, etc.).
- Installation of Silt Fence in streams or concentrated flow.
- Use as a mid-slope protection on slopes greater than 4:1.
- Use as a perimeter control in high flow areas.
- Field-sewn seams.
- Use of incorrect type of fabric.
- Loose or sagging fabric between posts.
- Fence improperly attached or fastened to posts.
- Posts not driven deep enough into the ground.
- Posts spaced too far apart.
- Posts installed on incorrect side of fence.
- Placement of overlapped joints across pooled drainage areas.
- Fence allows spillover or bypass.
- Soil is not compacted next to fence after backfilling trench, allowing water to flow underneath.

- Trenches are too shallow to anchor the Silt Fence below ground or trenchless construction failure.
- Slope erosion occurs below the fenceline due to drainage that bypasses the barrier end, or water build-up that “blows out” a poorly-secured fence bottom.
- Fence function impairment due to sediment build-up, maintenance neglect, etc.
- Fence topples due to poor installation and/or high levels of impounded backup water or sediment.
- Uneven distribution of pooled drainage along non-level fenceline surface reduces efficiency.
- End of fence is not “J-hooked” upslope allowing water to run around the end.
- Poor support system (e.g. soil too rocky to secure posts, fabric stapled to trees, etc.).
- Installation of Silt Fence in a long continuous run.



### SPECIFICATIONS

#### Standard Specification


- 633 – Silt Fence
- 729-2.04 - Geosynthetics

#### Drawing

- BMP-20.00 Silt Fence (Sheets 1 and 2)

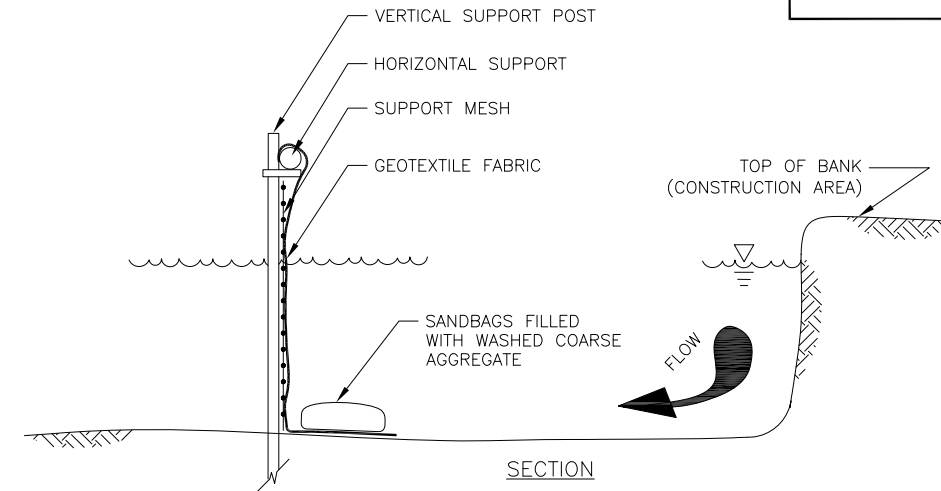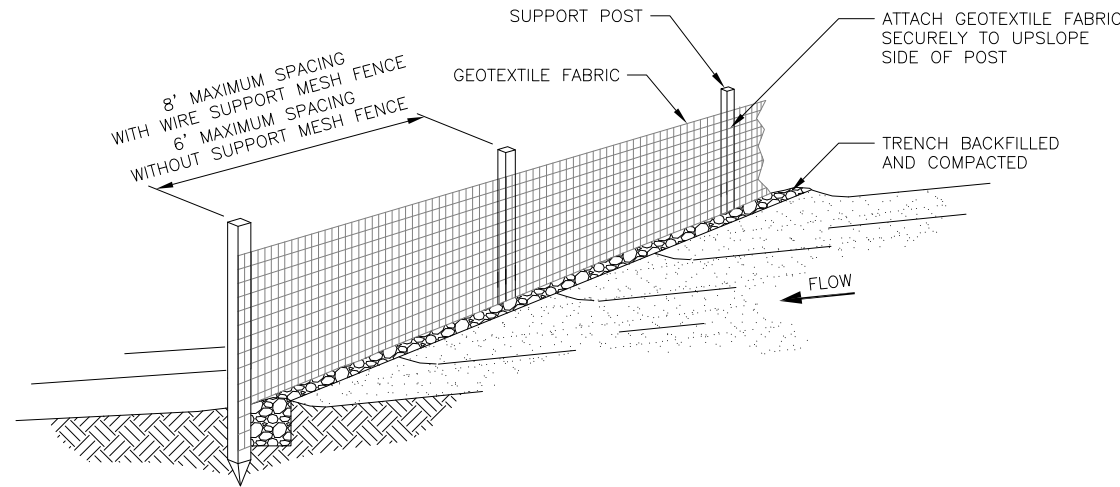

**GENERAL INSTALLATION**  
NOT TO SCALE

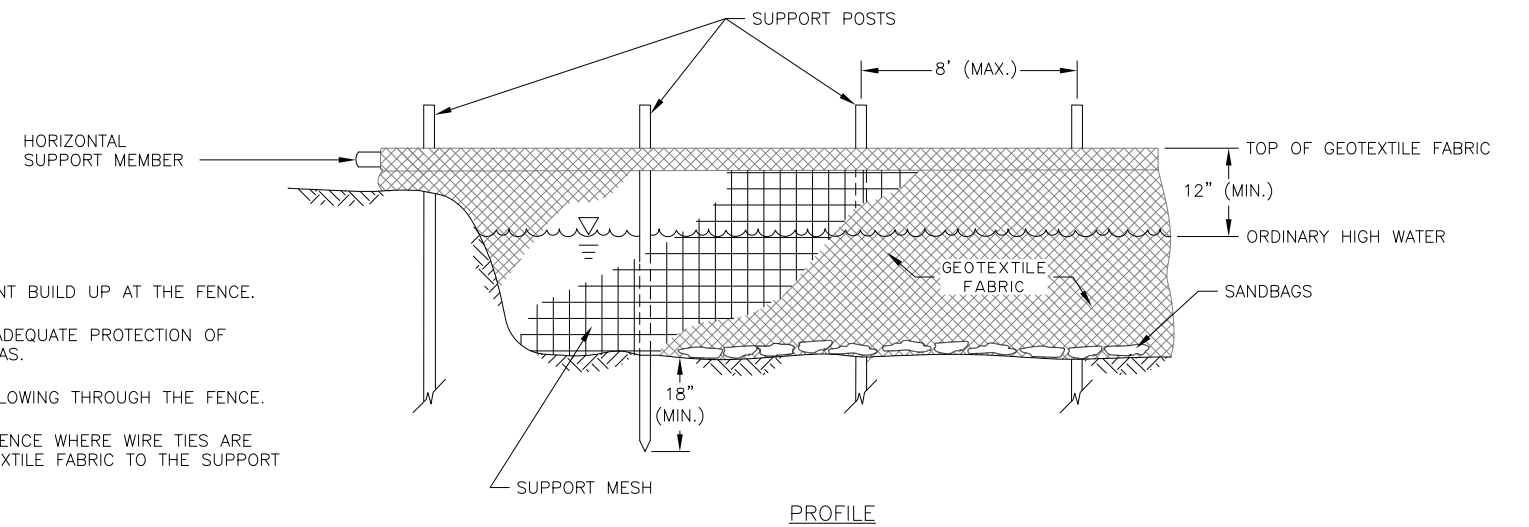

**STANDING WATER INSTALLATION**  
NOT TO SCALE

**SILT FENCE GENERAL NOTES:**

**MATERIALS**  
SILT FENCE: SEE SPECIFICATION SECTION 633, SILT FENCE.

**INSTALLATION**

1. INSTALL FENCELINE ALONG A LEVEL CONTOUR AND PERPENDICULAR TO ANTICIPATED SHEET FLOW DRAINAGE PATH(S).
2. ORIENT END SECTIONS UPHILL SLIGHTLY IN A J-HOOK TO PREVENT WATER FROM GOING AROUND THE SILT FENCE.
3. DO NOT EXCEED 100 FEET FOR EACH 1/4-ACRE OF DRAINAGE AREA AND DO NOT EXCEED 500 FEET REGARDLESS OF DRAINAGE AREA.
4. THE DIFFERENCE IN ELEVATION BETWEEN THE HIGHEST AND LOWEST POINT ALONG THE TOP OF THE SEDIMENT FENCE SHALL NOT EXCEED ONE-THIRD THE FENCE HEIGHT.
5. WHERE GROUND SURFACES ARE UNEVEN, INSTALL SHORTER FENCES FOLLOWING CONTOURS (RATHER THAN INSTALLING ONE LONG, CONTOUR-CROSSING FENCE THAT DIRECTS DRAINAGE TO ACCUMULATE IN LOW SPOTS).
6. LOCATE FENCE 3 TO 10 FEET BEYOND TOE OF FILL TO LEAVE ROOM FOR A BROAD, SHALLOW SEDIMENTATION POOL AND FOR EQUIPMENT ACCESS DURING FENCE MAINTENANCE AND REMOVAL.
7. IF FEASIBLE, LEAVE A MINIMUM OF 3.5-FOOT BUFFER BETWEEN FENCING AND SENSITIVE RECEIVING AREAS.
8. PLACE GEOTEXTILE ON THE UPSLOPE SIDE OF POSTS OR, WHEN USING SILT FENCE WITH SEWN-IN POCKETS, PLACE POCKETS ON THE UPSLOPE SIDE OF THE FENCE.
9. EXCAVATE TRENCHES NOT WIDER OR DEEPER THAN NECESSARY FOR PROPER INSTALLATION OF THE SILT FENCE. DO NOT EXCAVATE TRENCHES IN PERMAFROST.
10. AT JOINTS, ROLL ENOUGH OF THE ENDS OF SECTIONS TOGETHER AT SUPPORT POST SUCH THAT THE JOINT PREVENTS SILT-LADEN WATER FROM ESCAPING THROUGH THE FENCE.
11. IF USING THE FRONT WHEEL OF A TRACTOR OR ROLLER, COMPACT THE UPSTREAM SIDE FIRST, THEN EACH SIDE TWICE (A TOTAL OF FOUR TRIPS).

12. KEEP FENCE FABRIC TAUT.

13. WHEN USING SUPPORT MESH, ATTACH GEOTEXTILE TO THE SUPPORT MESH WITH FASTENERS SPACED EVERY 24 INCHES AT THE TOP AND MIDSECTION.

**MACHINE SLICE INSTALLATION (NOT IN PERMAFROST)**

1. USE A SILT FENCE INSTALLATION MACHINE OR ATTACHMENT TO PLOW OR SLICE THE FABRIC DIRECTLY INTO THE SOIL.
2. BACKFILL SOIL LOOSENED BY THE BLADE INTO THE SLICE AND USE THE TRACTOR TO MECHANICALLY COMPACT THE SOIL.
3. TUCK FABRIC DEEPER INTO THE GROUND WHERE NECESSARY.
4. INSTALL SUPPORT POSTS ALONG THE LENGTH OF THE FENCE FOLLOWING SIMILAR PROCEDURES FOR THE TRENCH METHOD.

**WINTER INSTALLATION (NOT IN PERMAFROST)**

1. DIG A TRENCH.
2. BACKFILL TRENCH WITH THE LOOSENED SOIL AND COMPACT SOIL PRIOR TO POST INSTALLATION.
3. MOISTEN THE BACKFILLED SOIL SO IT WILL FREEZE UP AND GRIP THE SILT FENCE FABRIC IN PLACE.
4. DO NOT LEAVE LARGE FROST CHUNKS AS THE BACKFILL.

**INSPECTION**

1. INSPECT FENCELINE FOR CONTINUITY, COLLAPSE, UNDERMINED AREAS, AND DAMAGE. DO NOT EXCAVATE TRENCHES IN PERMAFROST.
2. INSPECT FABRIC FOR TEARS, PUNCTURES, FRAYING, WEATHERING, AND COMPROMISED INTEGRITY.
3. CONFIRM THAT THE FENCE POSTS ARE SECURE.
4. ENSURE THE FENCE IS KEYED IN AND THAT THERE IS NO UNDERCUTTING.
5. LOOK FOR EVIDENCE OF SEDIMENT OR EROSION FLOW LEADING OFF THE DOWNHILL EDGE OF THE FENCE. (THIS MAY BE AN INDICATOR OF DRAINAGE BYPASS OR FENCE UNDERMINE.)

6. NOTE DEPTH OF SEDIMENT BUILD UP AT THE FENCE.

7. LOOK FOR SIGNS OF INADEQUATE PROTECTION OF OFF-SITE SENSITIVE AREAS.

8. CHECK FOR SEDIMENT FLOWING THROUGH THE FENCE.

9. CHECK FOR HOLES IN FENCE WHERE WIRE TIES ARE USED TO SECURE GEOTEXTILE FABRIC TO THE SUPPORT POST.

**MAINTENANCE**

1. INSTALL ALTERNATE OR ADDITIONAL BMPS AS NEEDED TO PREVENT UNDESIRABLE SEDIMENTATION OF SENSITIVE AREAS.
2. REPLACE DAMAGED FABRIC.
3. REMEDY FENCE SAGS AS NEEDED.
4. REMOVE ACCUMULATED SEDIMENT BEFORE IT ACCUMULATES TO ONE-HALF THE CAPACITY, OR ONE-THIRD OF THE AVAILABLE STORAGE IF PROTECTING A WATER BODY OR STORM DRAIN INLET.
5. DISPOSE OF SILT WASTE IN APPROVED MANNER/LOCATION (TYPICALLY IN A NON-EROSION AREA).
6. IF THERE IS EVIDENCE OF EXCESSIVE SEDIMENTATION AGAINST THE SILT FENCE, PROVIDE INCREASED EROSION CONTROL UPSLOPE.

**REMOVAL**

1. WHEN DISTURBED AREAS ARE PERMANENTLY STABILIZED OR SEDIMENT PROTECTION IS NO LONGER NEEDED, COLLECT AND PROPERLY DISPOSE OF ACCUMULATED SEDIMENT OR SEED IN PLACE.
2. CUT FABRIC AT GROUND LEVEL AND REMOVE SUPPORTS.
3. DISCARD FILTER FENCE AS APPROVED. AVOID DAMAGE TO SENSITIVE AREAS (E.G. WETLAND OR SURFACE WATER).

**STANDING WATER NOTES:**


- INSTALLATION**
1. DRIVE SUPPORT POSTS INTO THE GROUND AND ATTACH A HORIZONTAL SUPPORT MEMBER.
  2. ATTACH SUPPORT MESH AND GEOTEXTILE ON THE UPSLOPE SIDE OF THE STAKES, EXTEND GEOTEXTILE ON THE GROUND UPSLOPE OF THE FENCE, AND ANCHOR THE GEOTEXTILE WITH SANDBAGS OR EQUIVALENT TO PREVENT GAPS.
  3. SPACE SUPPORT POSTS A MAXIMUM OF 8 FEET APART.
  4. KEEP FENCE FABRIC TAUT.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**SILT FENCE**  
**(NOTES, GENERAL**  
**INSTALLATION, & STANDING**  
**WATER INSTALLATION)**

A  
P  
P  
R  
O  
V  
E  
D


Date **12/2015** X/XX/XX

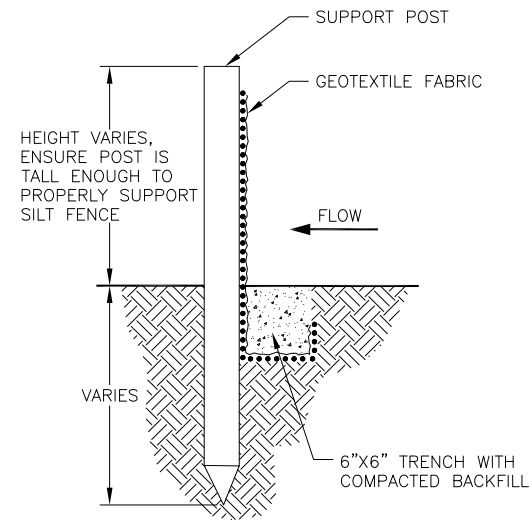

TRENCH DETAIL  
NOT TO SCALE

TRENCH NOTES:  
INSTALLATION

1. DRIVE SUPPORT POSTS INTO THE GROUND.
2. FOLLOW MANUFACTURER'S SPECIFICATIONS FOR POST BURIAL DEPTH.
3. EXCAVATE A TRENCH ON THE UPHILL SIDE ALONG THE LINE OF THE STAKES.
4. ATTACH GEOTEXTILE TO STAKES AND BURY GEOTEXTILE BOTTOM.
5. BACKFILL TRENCH AND COMPACT TO SECURE FENCE BOTTOM.

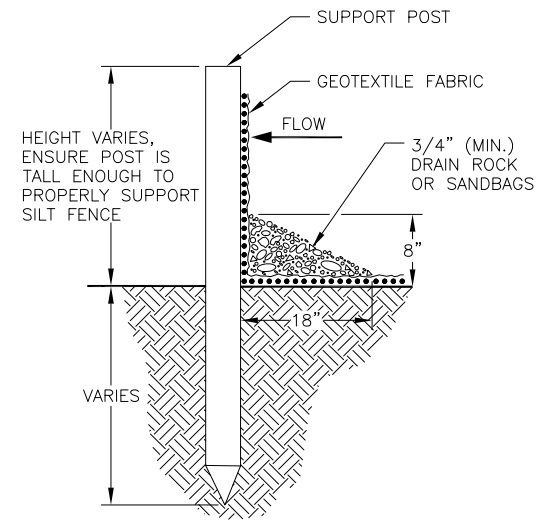

TRENCHLESS DETAIL  
NOT TO SCALE

TRENCHLESS NOTES:  
MATERIALS


CLEAN ROCK OR SANDBAGS.

INSTALLATION

1. DRIVE SUPPORT POSTS INTO THE GROUND.
2. ATTACH GEOTEXTILE ON THE UPHILL SIDE ALONG THE LINE OF THE STAKES.
3. EXTEND GEOTEXTILE ON THE GROUND UPHILL OF THE FENCE.
4. PLACE DRAIN ROCK ON GEOTEXTILE.

REMOVAL


1. WHEN SILT FENCE IS LOCATED IN WETLANDS OR SENSITIVE AREAS, REMOVE CLEAN ROCK OR SANDBAGS WHEN THE SILT FENCE IS REMOVED.

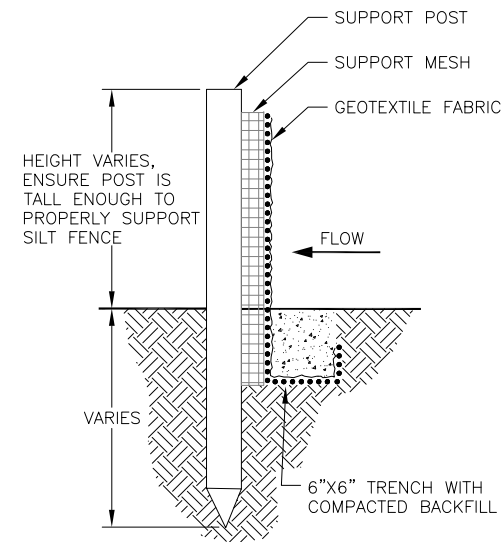

SUPPORT MESH REINFORCED  
FABRIC DETAIL  
NOT TO SCALE

SUPPORT MESH REINFORCED FABRIC NOTES:  
INSTALLATION

1. DRIVE SUPPORT POSTS INTO THE GROUND.
2. EXCAVATE A TRENCH ON THE UPHILL SIDE ALONG THE LINE OF THE STAKES. DO NOT EXCAVATE TRENCHES IN PERMAFROST.
3. EXTEND SUPPORT MESH A MINIMUM OF 3 INCHES INTO THE TRENCH.
4. ATTACH GEOTEXTILE TO STAKES AND BURY GEOTEXTILE BOTTOM.
5. BACKFILL TRENCH AND COMPACT TO SECURE FENCE BOTTOM.

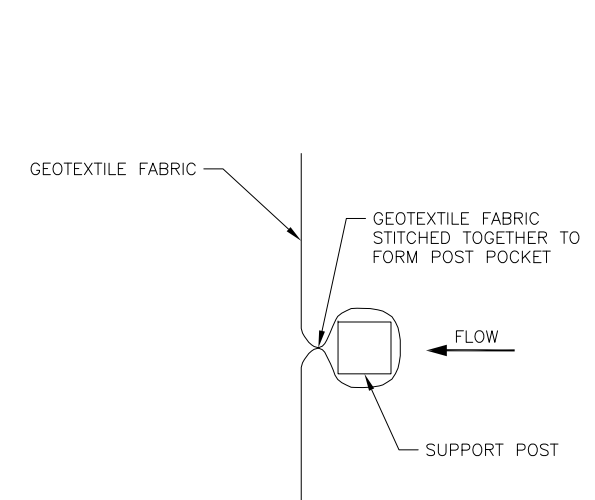

SEWN-IN POCKET DETAIL  
NOT TO SCALE

REVISIONS		
Date	Description	By

State of Alaska DOT&PF

SILT FENCE  
(DETAILS)

A  
P  
P  
R  
O  
V  
E  
D

Date     X/XX/XX



## **BMP 23.00 & 24.00. Stabilized Construction Exit**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Stabilized Construction Exits are used to clean mud and sediment from vehicle tires, minimizing the amounts transported off-site from construction projects.

#### *Description*

A Stabilized Construction Exit provides a stabilized rock area or pad underlined with a geotextile and located where traffic exits the construction site.

#### *Other Names*

Vehicle Tracking Exit/ Entrance, Construction Exit, Construction Entrance

#### *Applicability*

Stabilized Construction Exits are necessary for projects where sediment or mud can be tracked off-site. Stabilized Construction Exits are also applicable for projects adjacent to waters of the U.S., where poor soils have been encountered, or where dust is a problem during dry weather conditions.

#### *Selection Considerations*

Stabilized Construction Exits should be installed at project access points prior to commencing major grading operations.

- Limit exits to the project.
- Avoid exits that have steep grades or are located where sight distance may be a problem.
- Slope exit towards the project where possible to retain sediment on-site.
- Provide drainage to carry water to sediment trap or other suitable outlet.
- Design exit for heaviest/longest vehicles and equipment to be used on-site.
- Exit shall be a minimum length to provide for three complete revolutions of the largest vehicle tires and 12 feet wide.
- Use fencing as necessary to direct traffic to the exit.
- Construct exit on a firm compacted subgrade when practicable.

- Avoid crossing sidewalks or back-of-walk drains.
- Avoid constructing exits at curves in public roads.
- Separation geotextile may be placed under the Stabilized Construction Exit to prevent fine sediment from pumping up into the exit structure.
- If project conditions determine the need for Stabilized Construction Exits at specific locations, provide the location on the plans.

#### *Relationship to Other Erosion and Sediment Control Measures*

Stabilized Construction Exits may be used in combination with street sweeping and tire washing to minimize the amount of sediment transported off-site.

#### *Common Failures or Misuses*

- Failure to periodically “top dress” (provide additional rock) when sediment accumulates on the surface.
- Failure to repair and/or clean out any structures used to trap sediment.
- Failure to provide adequate depth and length of rock.
- Not having a Stabilized Construction Exit and using street sweeping as a substitute.
- Use of asphalt concrete grindings, crushed concrete, cement, or calcium chloride resulting in an increase in pH levels in stormwater.


### SPECIFICATIONS

#### Standard Specification


- 682 – Stabilized Construction Exit

#### Drawing:

- BMP-23.00 Stabilized Construction Exit (Sheets 1 of 2)
- BMP-24.00 Stabilized Construction Exit (Metal Plate, Sheet 2 of 2)

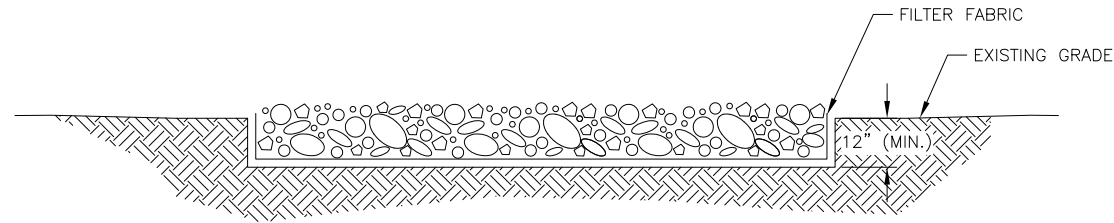

SECTION A-A

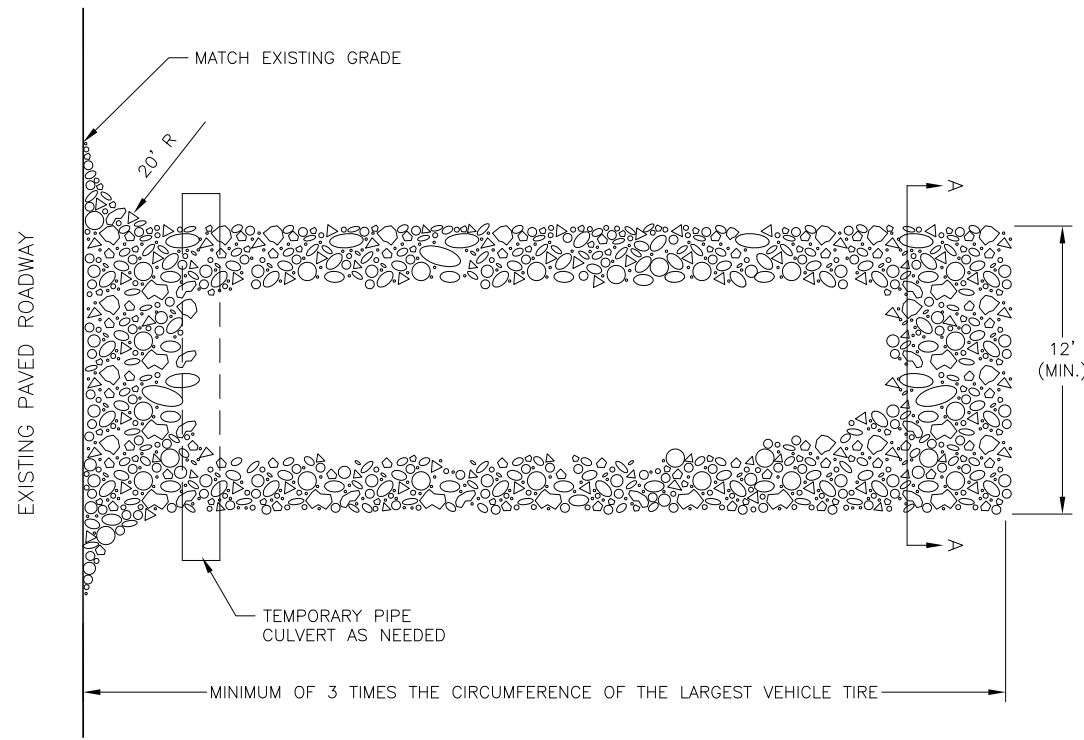

PLAN

**ROCK CONSTRUCTION EXIT**  
NOT TO SCALE

**ROCK CONSTRUCTION EXIT NOTES:**

**MATERIALS**  
ROCK: 2- TO 3-INCH COARSE AGGREGATE OR 3- TO 6-INCH QUARRY SPALL OR ANGULAR ROCK, WHICHEVER IS APPROPRIATE TO THE PROJECT FLEET.

**INSTALLATION**


1. PLACE THE FILTER FABRIC AND ROCK TO THE SPECIFIC GRADE SHOWN ON THE PLANS.

**MAINTENANCE**

1. REMOVE ACCUMULATED SEDIMENT OR MUD.
2. REPLACE ROCK MATERIAL WHEN SURFACE VOIDS ARE FILLED WITH SEDIMENT. REPLACE FABRIC AS NEEDED.
3. TOP DRESS WITH 2 TO 3 INCHES OF COARSE AGGREGATE OR 3- TO 6-INCH COARSE ROCK WHEN THE PAD BECOMES LADEN WITH SEDIMENT.

**INSPECTION**

1. INSPECT FOR ROCK THAT HAS BEEN DISPLACED FROM THE PAD.

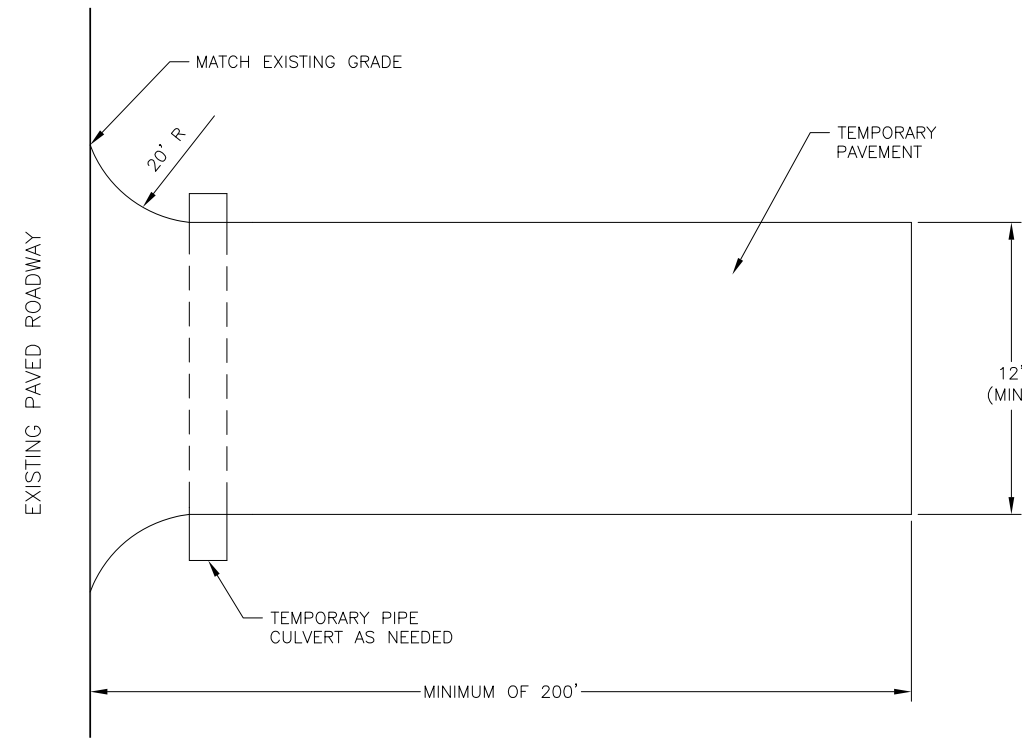

PLAN

**TEMPORARY PAVEMENT CONSTRUCTION EXIT**  
NOT TO SCALE

**TEMPORARY PAVEMENT CONSTRUCTION EXIT NOTES:**

**INSPECTION**  
1. INSPECT TEMPORARY PAVEMENT FOR DAMAGE.

**MAINTENANCE**

1. SWEEP DESIGNATED PAVED EXIT TO PREVENT SEDIMENT TRACK-OUT.
2. REPAIR DAMAGED TEMPORARY PAVEMENT.

**STABILIZED CONSTRUCTION EXIT GENERAL NOTES:**

- INSTALLATION**
1. INSTALL STABILIZED CONSTRUCTION EXIT PRIOR TO EARTH WORK.
  2. CLEAR THE EXIT AREA OF ALL VEGETATION, ROOTS, AND OTHER MATERIAL.
  3. PROVIDE DRAINAGE TO CARRY WATER TO A SEDIMENT TRAP, VEGETATIVE SEDIMENT FILTER OR OTHER PROTECTED OUTLET.
  4. EXCAVATE AND GRADE THE AREA FOR ROCK PLACEMENT.
  5. INSTALL SIGNS, FENCING OR BARRICADES TO CHANNEL OUTGOING TRAFFIC TO THE STABILIZED CONSTRUCTION EXIT.

**INSPECTION**

1. INSPECT STABILIZED CONSTRUCTION EXIT FOR SEDIMENT ACCUMULATION AND MATERIAL DISPLACEMENT.
2. INSPECT ROADWAY FOR SEDIMENT TRACK-OUT.
3. INSPECT DITCHES TO ENSURE NO SEDIMENT ACCUMULATION.

**MAINTENANCE**

1. MAINTAIN EACH EXIT IN A CONDITION THAT WILL PREVENT TRACKING OF MUD OR SEDIMENT ONTO PUBLIC RIGHT-OF-WAY.
2. REPAIR AND/OR CLEAN OUT ANY STRUCTURES USED TO TRAP SEDIMENT.
3. REMOVE ALL MUD AND SEDIMENT DEPOSITED ON PAVED ROADWAYS.
4. ADD MORE SIGNS, FENCING OR BARRICADES WHEN VEHICLES ARE EXITING THE PROJECT WITHOUT USING THE STABILIZED CONSTRUCTION EXIT. INSTALL ADDITIONAL STABILIZED CONSTRUCTION EXITS IF NEEDED, YET USE SIGNS AND BARRICADES TO MINIMIZE THE NUMBER OF STABILIZED CONSTRUCTION EXITS.
5. PREVENT TRACK-OUT BY USING ADDITIONAL BMPs, SUCH AS A TIRE WASH.

**REMOVAL**




1. REMOVE THE STABILIZED CONSTRUCTION EXIT AND ANY SEDIMENT TRAPPING STRUCTURES AFTER THEY ARE NO LONGER NEEDED, OR WITH FINAL SITE STABILIZATION.
2. REGRADE AND PERMANENTLY STABILIZE THE REMAINING DISTURBED AREAS ACCORDING TO THE PLANS.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**STABILIZED  
CONSTRUCTION EXIT  
(NOTES, ROCK &  
TEMPORARY PAVEMENT)**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

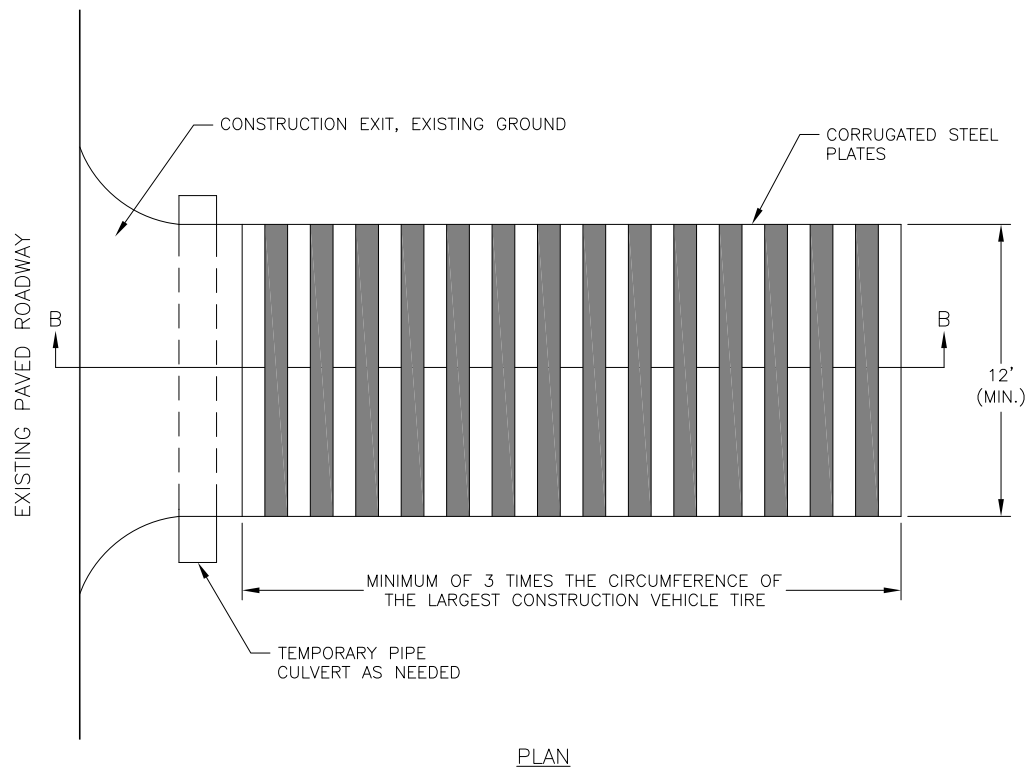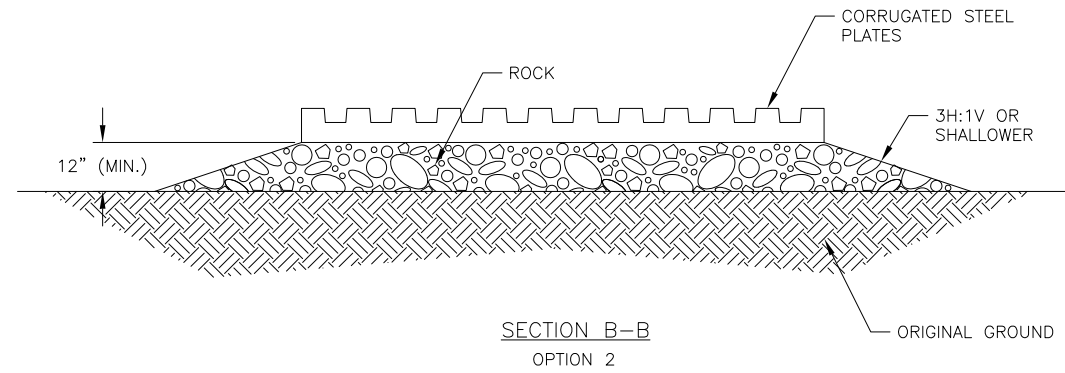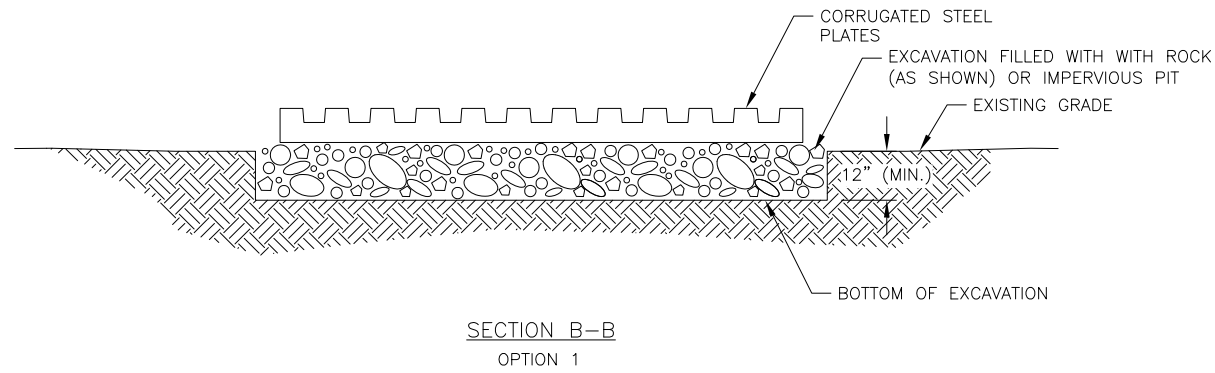

**METAL PLATE CONSTRUCTION EXIT**  
NOT TO SCALE

**METAL PLATE CONSTRUCTION EXIT NOTES:**

**MATERIALS**

CORRUGATED STEEL PLATES: SHAKER/RUMBLE PLATES, CORRUGATED STEEL PLATES, OR EQUIVALENT DESIGNED FOR ANTICIPATED TRAFFIC LOADS.

ROCK: 2- TO 3-INCH COARSE AGGREGATE.

**INSTALLATION**

1. IF CORRUGATED STEEL PLATES ARE OPEN TO THE SURFACE BELOW, INSTALL GRAVEL OR IMPERVIOUS PIT.
2. PLACE CORRUGATED STEEL PLATES.

**INSPECTION**

1. INSPECT CORRUGATED STEEL PLATES FOR DAMAGE.

**MAINTENANCE**

1. REPLACE DAMAGED CORRUGATED STEEL PLATES AS NECESSARY.
2. LIFT PLATE AND REMOVE ACCUMULATED SEDIMENT.
3. WHEN SURFACE VOIDS FILL WITH SEDIMENT, REPLACE ROCK MATERIAL.

**ADDITIONAL NOTES:**

SEE STABILIZED CONSTRUCTION EXIT GENERAL NOTES ON BMP 23.00 STABILIZED CONSTRUCTION EXIT (NOTES, ROCK & TEMPORARY PAVEMENT).

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**STABILIZED  
CONSTRUCTION EXIT  
(METAL PLATE)**

A  
P  
P  
R  
O  
V  
E  
D

Date **12/2015** X/XX/XX

BMP-24.00

## BMP 25.00 – 29.00. Storm Drain Inlet Sediment Protection – Curb and Area Inlets

These instructions cover BMP 25.00, 26.00, 27.00, 28.00 and 29.00.

### DESIGN CONSIDERATIONS

#### *Objectives*

Storm Drain Inlet Sediment Protection is used prior to permanent stabilization of the disturbed area to prevent sediment from entering downgradient storm drainage systems.

#### *Description*

Storm Drain Inlet Sediment Protection is a device or mechanism, either internal or external, for preventing sediment from entering a storm drain; generally by trapping sediment within or immediately adjacent to a storm drain inlet. Types of temporary protection devices applicable for different conditions are listed in the table. Prefabricated devices are available for internal and external applications.

#### *Other Names*

Storm Drain Inlet Protection, Filter Bag Insert, “Witch’s Hat,” Silt Sack

#### *Applicability*

Storm Drain Inlet Sediment Protection – Curb and Area Inlets are applicable when storm drain inlets must remain operational before permanent stabilization of the disturbed area and when there is potential for sediment to be transported into the storm drain system.

#### *Selection Considerations*

Internal devices generally consist of nonwoven, semi-porous material that traps larger sediment, but allows silt and clay-size particles to pass. They are most appropriate in situations where roadway flooding is a concern or where construction traffic will damage an external device.

External devices trap sediment by creating a ponding area surrounding or adjacent to the inlet, reducing velocities and allowing sediment to settle. This process allows external devices to be more efficient at trapping greater volumes of smaller sized sediment.

Curb inlets are distinguished from area inlets by their roadway edge location and proximity to traffic. Both are grated inlets, but whereas curb inlets are in-line with concrete curbing or curb and gutter features, area inlets are located in open areas and are generally surrounded by unpaved surfaces. These are also known as field inlets when they are permanent features, or they may be inlets in unpaved areas that will have paving around them as construction progresses.

Storm Drain Inlet Sediment Protection types applicable to curb inlets and area inlets are summarized in the following table:

**Storm Drain Inlet Sediment Protection Types and Applicability Table**

Storm Drain Inlet Sediment Protection Type	Applicability	
	Curb Inlet	Area Drain Inlet
External Sediment Protection		
Prefabricated Barrier System	Yes *	Yes
Gravel or Sand Bag Berm	Yes *	Yes
Fiber Roll	No	Yes
Filter Fabric (Silt Fence)	No	Yes
Inlet Grate Covers		
Filter Mat	No	Yes
Curb Face Mesh Filter	Yes	No
Internal Sediment Protection		
Filter Bag Insert	Yes	Yes
Sediment Control Inlet Hat	Yes	Yes
* If neither the sediment protection structure nor ponding will intrude into travel way		

- Fiber rolls and prefabricated barrier systems are not appropriate for locations where they cannot be properly anchored to the surface.
- Filter fabric (silt fence) as a sediment protection device is applicable to area inlets and for flows

less than 0.5 cubic feet per second (cfs) on flat grades (5 percent or less).

- Inlet grate filter mats are only applicable where heavy concentrated flows are not expected and are not applicable where ponding around the structure might cause excessive damage to adjacent structures and unprotected areas.
- Curb face inlet mesh filters for curb inlets prevent sediment from entering the inlet but they also require that runoff is bypassed. This sediment protection device should not be used at a sag inlet (an inlet at the lowest point on a vertical curve or in a depression); and, if used, conveyance to another point of discharge must be provided.

Any of these sediment protection devices may cause flooding affecting streets and the construction area. Where flooding would cause a hazard, consider where overflow will go in extreme events and provide emergency overflows with additional treatment.

#### *Design*

*Drainage Area:* Not to exceed 1 acre.

*Slope Gradient:* Not to exceed 5 percent.

Site and construct Storm Drain Inlet Sediment Protection in a manner that will facilitate cleanout and disposal of trapped sediment.

Design and construct the Storm Drain Inlet Sediment Protection in a manner that will allow flow to pass and to minimize ponding after the runoff has ceased.

#### *Relationship to Other Erosion and Sediment Control Measures*

Erosion and sediment control measures in the contributing areas must be in place to minimize the amount of sediment that must be treated at inlets. Storm Drain Inlet Sediment Protection is installed as a secondary measure to remove residual sediment that was not removed by other measures such as check dams, grassed swales, and sediment traps.

#### *Common Failures or Misuses*

- Sediment accumulation, by which filtering capacity is reduced, resulting in ponding of water.

- Improper installation, resulting in sediment bypassing filter and entering the inlet.
- Tearing, undermining, or collapsing of filter fabric, resulting in sediment entering the inlet.



#### SPECIFICATIONS

##### Standard Specifications

- 683 – Storm Drain Inlet Sediment Protection
- 633 – Silt Fence
- 729-2.04 Geosynthetics

##### Drawings

- BMP-25.00 Storm Drain Inlet Sediment Protection (Sheets 1 of 5)
- BMP-26.00 Storm Drain Inlet Sediment Protection
- BMP-27.00 Storm Drain Inlet Sediment Protection
- BMP-28.00 Storm Drain Inlet Sediment Protection
- BMP-29.00 Storm Drain Inlet Sediment Protection
- BMP-13.00 Prefabricated Barrier System
- BMP-10.00 Fiber Rolls for Erosion and Sediment Control

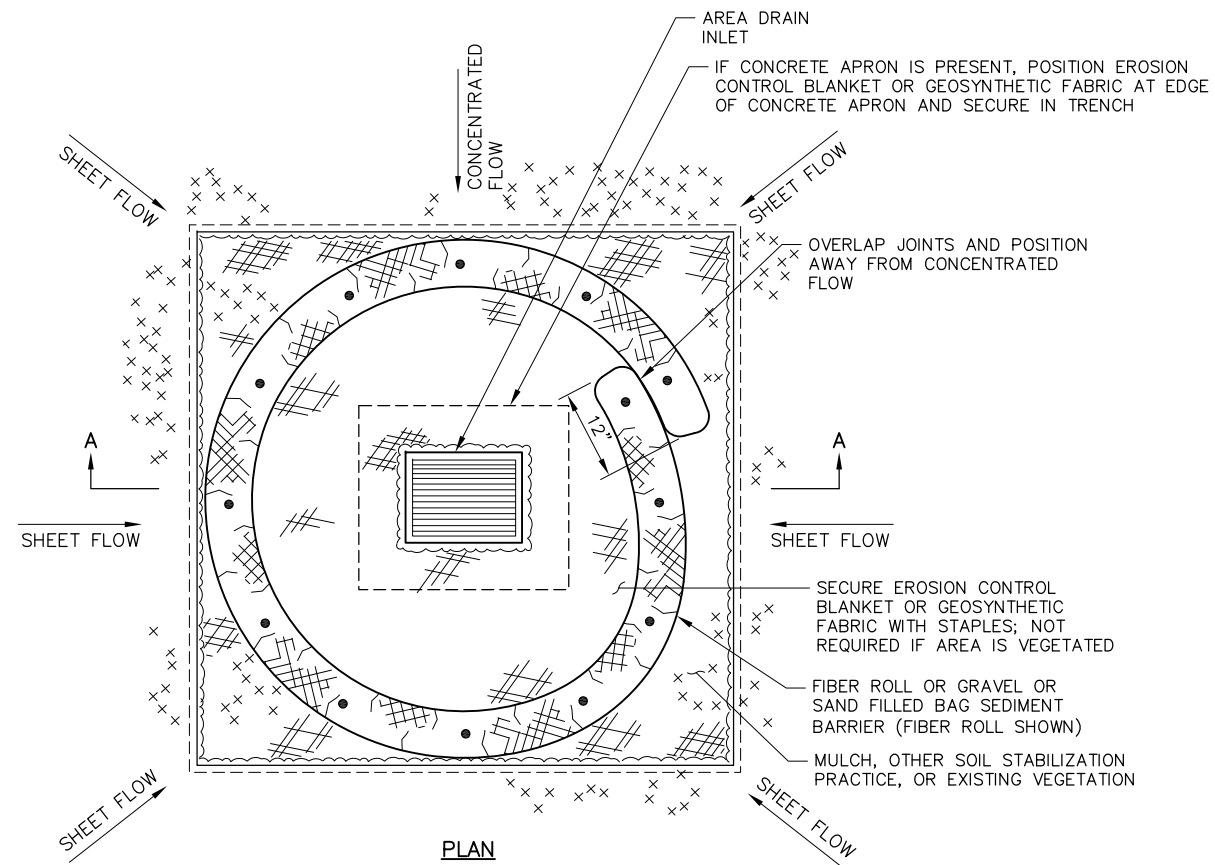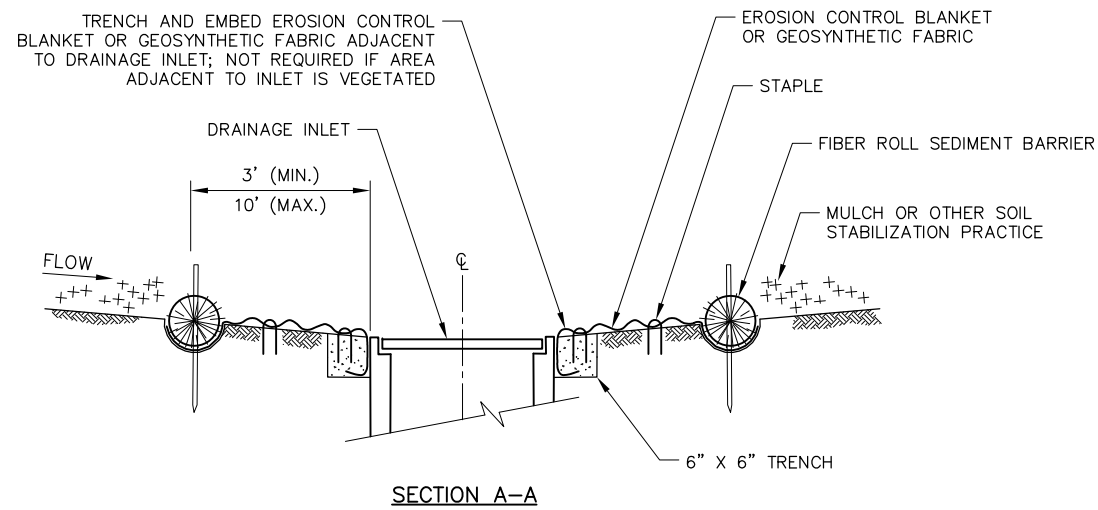

**FIBER ROLL OR GRAVEL OR SAND BAG BERM  
FOR AREA INLETS**  
NOT TO SCALE

**FIBER ROLL OR GRAVEL OR SAND BAG BERM NOTES:  
MATERIALS**

**FIBER ROLL AND STAKES:** SEE DRAWING BMP-10.00 FIBER ROLL FOR EROSION AND SEDIMENT CONTROL.

**GRAVEL- OR SAND-FILLED BAG:** TIGHTLY WOVEN BURLAP OR WOVEN GEOTEXTILE BAG MATERIAL THAT IS SUFFICIENTLY DURABLE TO REMAIN INTACT FOR THE TIME INTENDED. FILL BAGS 3/4 FULL OF GRAVEL OR SAND WITH A GRADATION SUCH THAT NO FINE SEDIMENT PASSES THROUGH THE BAG. IF THE SANDBAGS ARE NEEDED FOR MORE THAN ONE SUMMER SEASON, PROVIDE BAG MATERIAL THAT HAS ULTRAVIOLET STABILITY OF AT LEAST 70% IN CONFORMANCE WITH ASTM D4355 REQUIREMENTS. SECURELY CLOSE THE SAND BAGS.

**PREFABRICATED UNITS:** MAY BE USED IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING UPON APPROVAL BY THE ENGINEER.

**INSTALLATION**

1. IF PREFABRICATED BARRIERS ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

2. FIBER ROLL - SEE DRAWING BMP-10.00 [FIBER ROLL]

**INSPECTION, MAINTENANCE, AND REMOVAL**

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES, THIS SHEET.

**STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES:  
INSTALLATION**

1. IF PREFABRICATED BARRIERS ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

**INSPECTION**

1. CHECK FOR SEDIMENT DEPTH. CLEANING IS REQUIRED WHEN SEDIMENT HAS ACCUMULATED TO ONE-THIRD THE DESIGN DEPTH (OR LESS WHEN SPECIFIED BY THE MANUFACTURER OF PREFABRICATED BARRIERS).

2. CHECK FOR UNDERMINING OR BYPASSING, SUCH AS EVIDENCE THAT SEDIMENT IS ENTERING THE INLET OR THAT RUN-OFF IS BYPASSING THE BARRIER AND ENTERING THE INLET UNTREATED.

**MAINTENANCE**

1. IF PREFABRICATED BARRIERS ARE USED, MAINTAIN THEM AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

2. CORRECT UNDERMINING OR BYPASSING FAILURES.

3. REMOVE ACCUMULATED SEDIMENT BEFORE IT REACHES ONE-THIRD OF THE AVAILABLE STORAGE OF THE SEDIMENT PROTECTION DEVICE OR LESS WHEN SPECIFIED BY THE MANUFACTURER.

4. REMOVE AND DISPOSE OF ANY ROCK OR DEBRIS THAT HAS ACCUMULATED BEHIND THE SEDIMENT BARRIER TO PREVENT FURTHER CLOGGING.

5. REPLACE FRAYED OR TORN FABRIC OR MATERIALS AND REPAIR ANY STRUCTURAL DAMAGE AS SOON AS PRACTICABLE.

**REMOVAL**

1. LEAVE INLET SEDIMENT PROTECTION DEVICES IN PLACE AND OPERATIONAL UNTIL THE DRAINAGE AREA IS PERMANENTLY STABILIZED.

2. REMOVE AND DISPOSE OF TRAPPED OR REMAINING SEDIMENT.

3. STABILIZE DISTURBED SOIL AREAS RESULTING FROM REMOVAL OF BARRIERS OR SEDIMENT.


REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**STORM DRAIN INLET  
SEDIMENT PROTECTION  
(NOTES & AREA INLET FIBER ROLL  
OR GRAVEL/SAND BAG BERM**



A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015

X/XX/XX

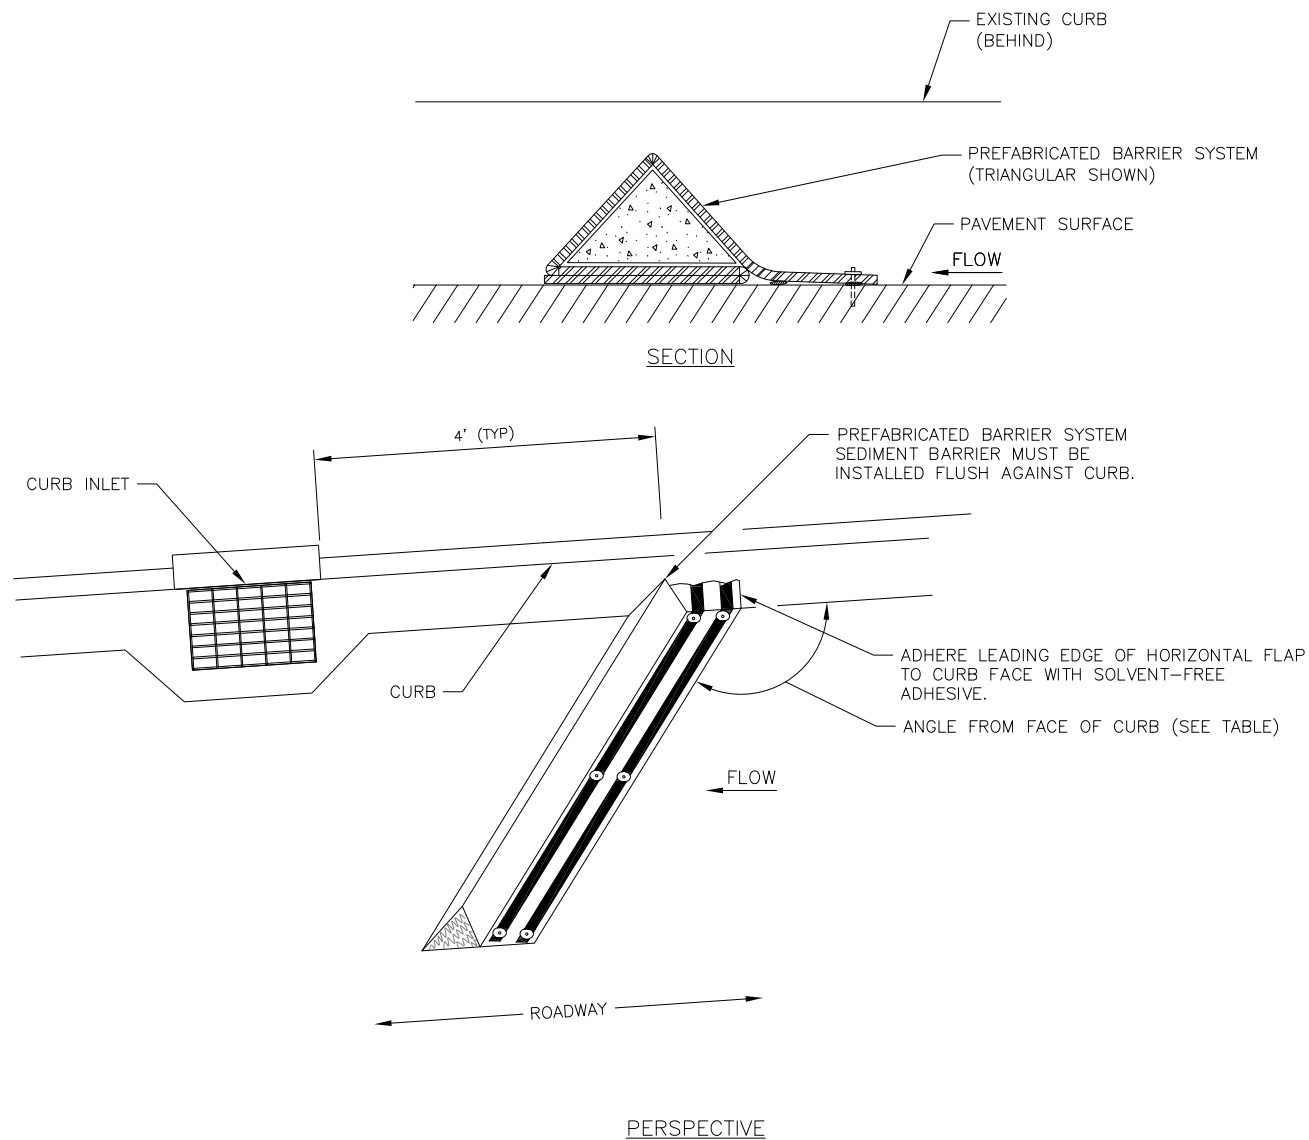

**PREFABRICATED BARRIER SYSTEM  
FOR CURB INLETS**  
NOT TO SCALE

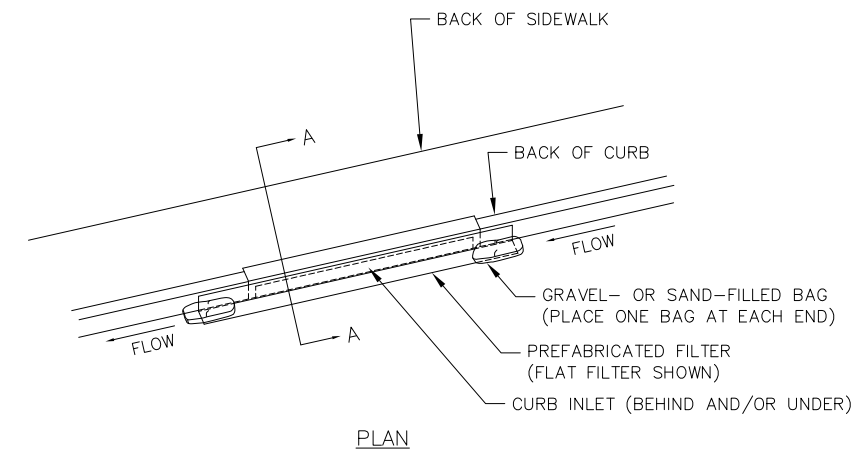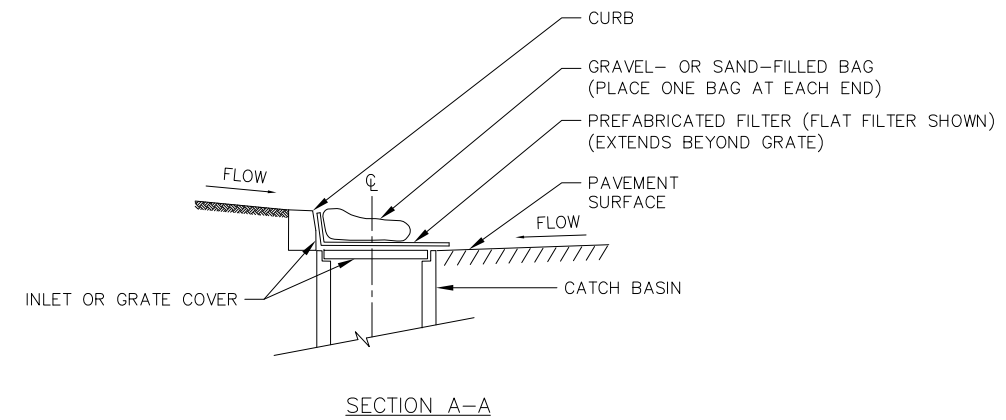

**CURB FACE INLET FILTER SYSTEM  
FOR CURB INLETS**  
NOT TO SCALE

**CURB INLET PREFABRICATED BARRIER NOTES:  
MATERIALS**

1. PREFABRICATED UNITS: UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.

**INSTALLATION**

1. PREFABRICATED BARRIERS: INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.
2. PREFABRICATED BARRIER SYSTEM - SEE DRAWING BMP-13.00 PREFABRICATED BARRIER SYSTEM

SLOPE OF ROADWAY (PERCENT)	0 TO 2.9	3 TO 5+
ANGLE FROM FACE OF CURB	70°	45°
SUGGESTED BARRIER LENGTH	4'	
SUGGESTED DISTANCE FROM INLET	4'	

**INSPECTION, MAINTENANCE, AND REMOVAL**

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES ON BMP-25.00 [STORM DRAIN INLET SEDIMENT PROTECTION (NOTES & AREA INLET FIBER ROLL OR GRAVEL/SAND BAG BERM)] NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.

**CURB FACE INLET FILTER SYSTEM NOTES:  
MATERIALS**

**PREFABRICATED FILTER:** LINEAR, FLAT OR TUBE SHAPED CURB INLET FILTER

**GRAVEL- OR SAND-FILLED BAG:** TIGHTLY WOVEN BURLAP OR WOVEN GEOTEXTILE BAG MATERIAL THAT IS SUFFICIENTLY DURABLE TO REMAIN INTACT FOR THE TIME INTENDED. FILL BAGS 3/4 FULL OF GRAVEL OR SAND WITH A GRADATION SUCH THAT NO FINE SEDIMENT PASSES THROUGH THE BAG. IF THE SANDBAGS ARE NEEDED FOR MORE THAN ONE SUMMER SEASON, PROVIDE BAG MATERIAL THAT HAS ULTRAVIOLET STABILITY OF AT LEAST 70% IN CONFORMANCE WITH ASTM D4355 REQUIREMENTS. SECURELY CLOSE THE SAND BAGS.

**PREFABRICATED UNITS:** UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.

**INSTALLATION**

1. INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

**INSPECTION, MAINTENANCE, AND REMOVAL**

1. SEE NOTES ON BMP-23.00 STORM DRAIN INLET SEDIMENT POTENTIAL BARRIERS, SHEET 1 - NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.

REVISIONS		
Date	Description	By


State of Alaska DOT&PF  
**STORM DRAIN INLET  
SEDIMENT PROTECTION  
(CURB INLET PREFABRICATED BARRIER  
SYSTEM & CURB FACE INLET FILTER)**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015

XX/XX/XX

SLOPE OF ROADWAY (PERCENT)	0 TO 3.9	4 TO 5.9	6 TO 7.9	8 TO 10	10+
INTERVAL BETWEEN BARRIERS	100'	75'	50'	25'	12'

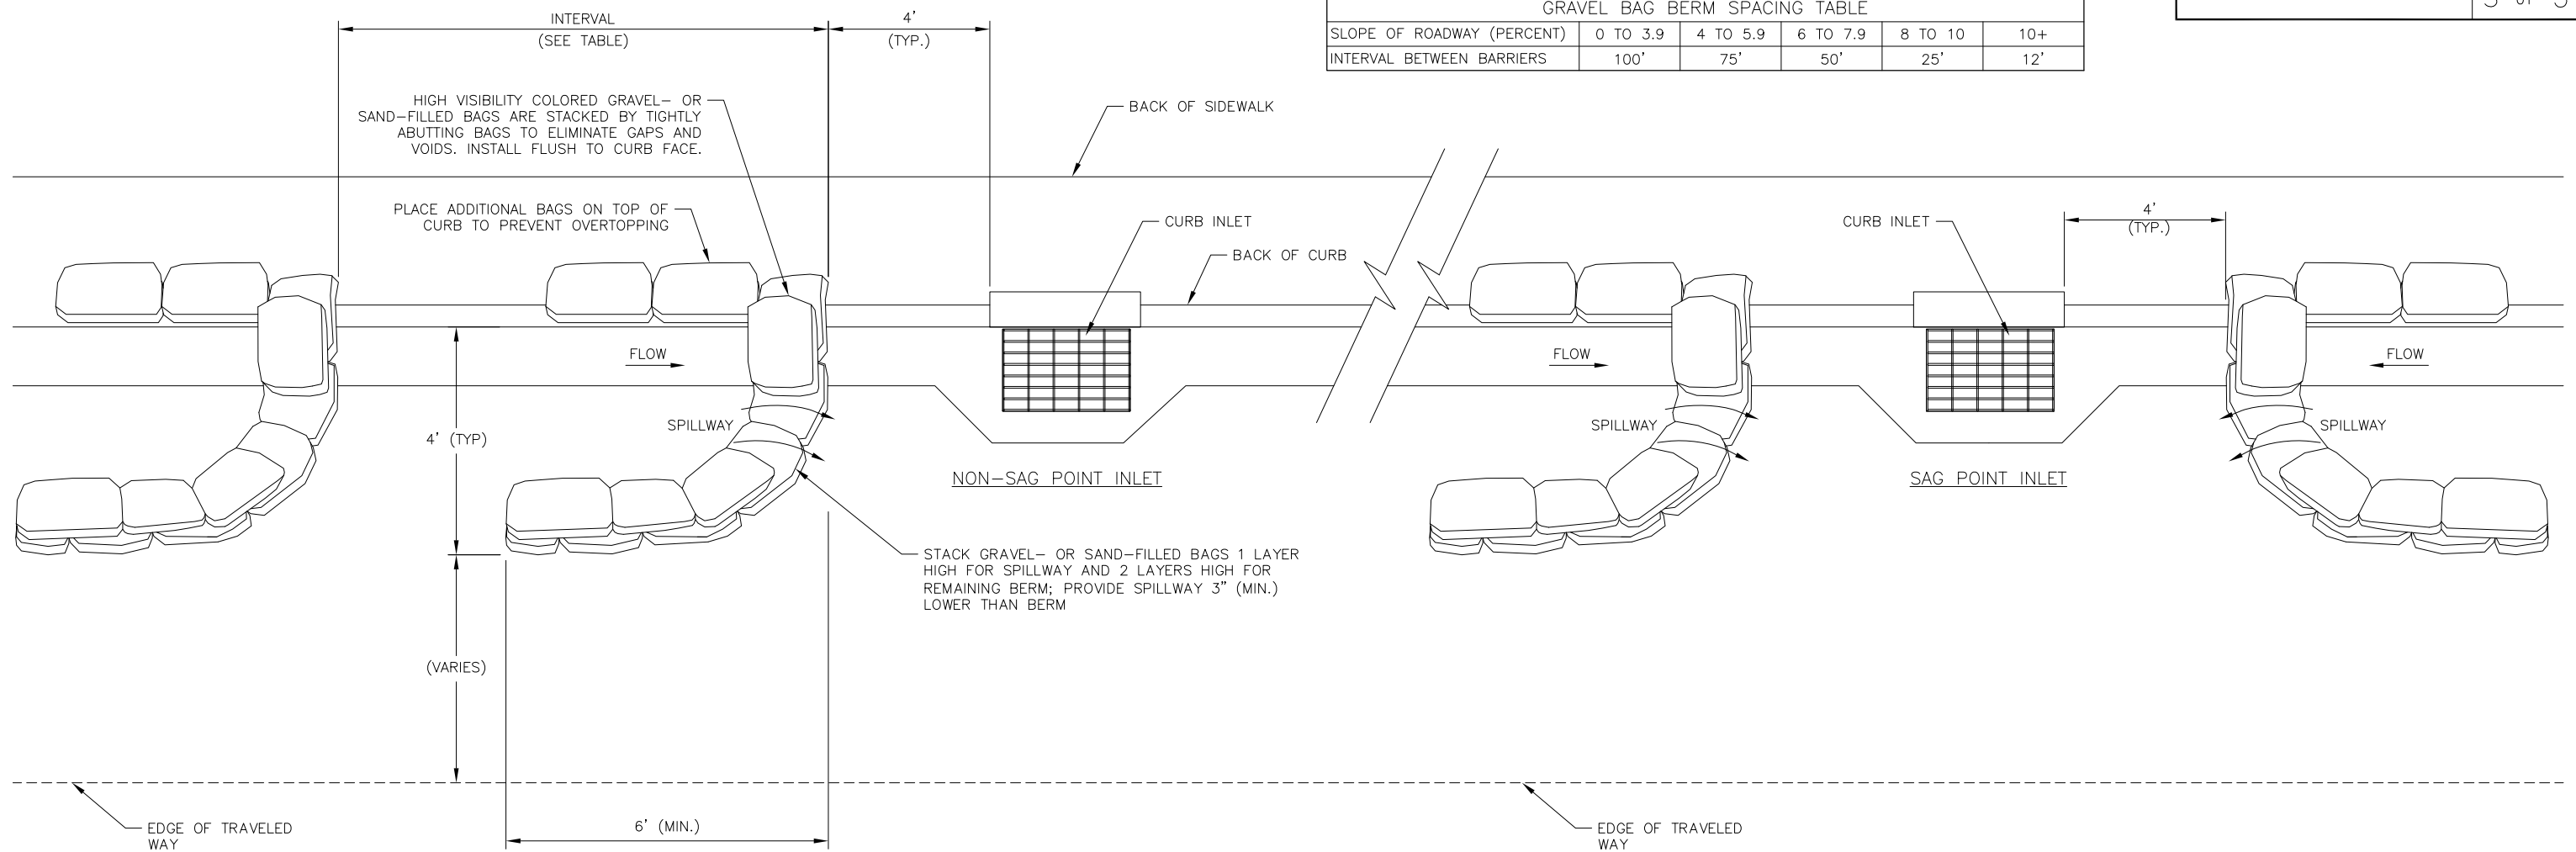

PERSPECTIVE

GRAVEL OR SANDBAG BERMS FOR CURB INLETS  
NOT TO SCALE

**CURB INLET GRAVEL OR SANDBAG BERM NOTES:**  
MATERIALS

**PREFABRICATED UNITS:** UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.

**GRAVEL- OR SAND-FILLED BAG:** TIGHTLY WOVEN BURLAP OR WOVEN GEOTEXTILE BAG MATERIAL THAT IS SUFFICIENTLY DURABLE TO REMAIN INTACT FOR THE TIME INTENDED. FILL BAGS  $\frac{3}{4}$  FULL OF GRAVEL OR SAND WITH A GRADATION SUCH THAT NO FINE SEDIMENT PASSES THROUGH THE BAG. IF THE SANDBAGS ARE NEEDED FOR MORE THAN ONE SUMMER SEASON, PROVIDE BAG MATERIAL THAT HAS ULTRAVIOLET STABILITY OF AT LEAST 70% IN CONFORMANCE WITH ASTM D4355 REQUIREMENTS. SECURELY CLOSE THE SAND BAGS.

**INSTALLATION**

1. DELINEATE SAND BAGS WITH TRAFFIC CONTROL DEVICES WHERE NECESSARY
2. IF PREFABRICATED BARRIERS ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

**INSPECTION, MAINTENANCE, AND REMOVAL**

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES ON BMP-25.00 [STORM DRAIN INLET SEDIMENT PROTECTION (NOTES & AREA INLET FIBER ROLL OR GRAVEL/SAND BAG BERM)] NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.


REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**STORM DRAIN INLET  
SEDIMENT PROTECTION  
(CURB INLET GRAVEL  
OR SANDBAG BERMS)**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX



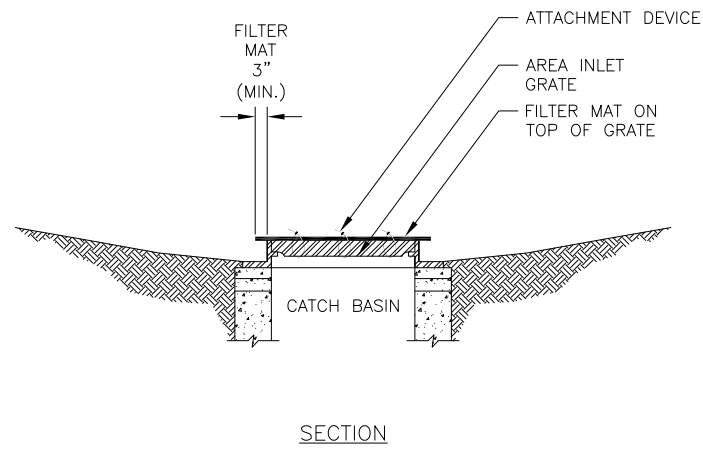

FILTER MAT FOR AREA INLETS  
NOT TO SCALE

AREA INLET FILTER MAT NOTES:

MATERIALS

MAT: FABRICATED FROM COIR OR EQUIVALENT MATERIAL FOR INLET PROTECTION

ATTACHMENT DEVICES: WIRE OR PLASTIC TIES

PREFABRICATED UNITS: UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.

INSTALLATION


1. POSITION THE MAT OVER THE INLET GRATE AND ENSURE THAT IT EXTENDS BEYOND THE EDGE OF THE GRATE BY 3-INCHES MINIMUM ON ALL SIDES.
2. INSTALL AND ATTACH THE MAT TO THE GRATE AS SPECIFIED BY THE MANUFACTURER.
3. IF OTHER PREFABRICATED UNITS ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

MAINTENANCE

1. SWEEP TOP AND SIDES OF THE MAT TO REMOVE SEDIMENT AND DEBRIS.
2. REMOVE AND REPLACE MAT IF IT BECOMES CLOGGED.

INSPECTION, MAINTENANCE, AND REMOVAL

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES ON BMP-25.00 [STORM DRAIN INLET SEDIMENT PROTECTION (NOTES & AREA INLET FIBER ROLL OR GRAVEL/SAND BAG BERM)] NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.

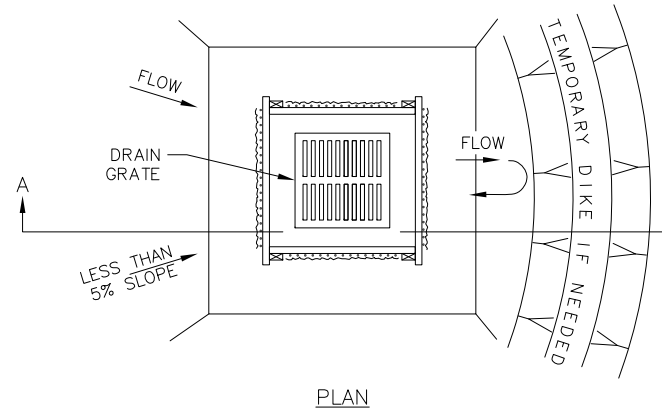

FILTER FABRIC FOR AREA INLETS  
NOT TO SCALE

AREA INLET FILTER FABRIC NOTES:

MATERIALS

PREFABRICATED UNITS: UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.


FILTER FABRIC: (SILT FENCE) SHALL COMPLY WITH SECTION 729-2.04 SILT FENCE.

INSTALLATION

1. IF PREFABRICATED BARRIERS ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.
2. PLACE A STAKE AT EACH CORNER OF THE INLET OR IN A CIRCULAR PATTERN AROUND THE INLET NO MORE THAN 3 FEET APART. DRIVE STAKES INTO THE GROUND A MINIMUM OF 12 INCHES.
3. ENSURE STABILITY BY BRACING AT THE TOP.
4. INSTALL FILTER FABRIC (SILT FENCE) AS SHOWN ON DRAWING BMP-20.00 SILT FENCE.

INSPECTION, MAINTENANCE, AND REMOVAL

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES ON BMP-25.00 [STORM DRAIN INLET SEDIMENT PROTECTION (NOTES & AREA INLET FIBER ROLL OR GRAVEL/SAND BAG BERM)] NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.

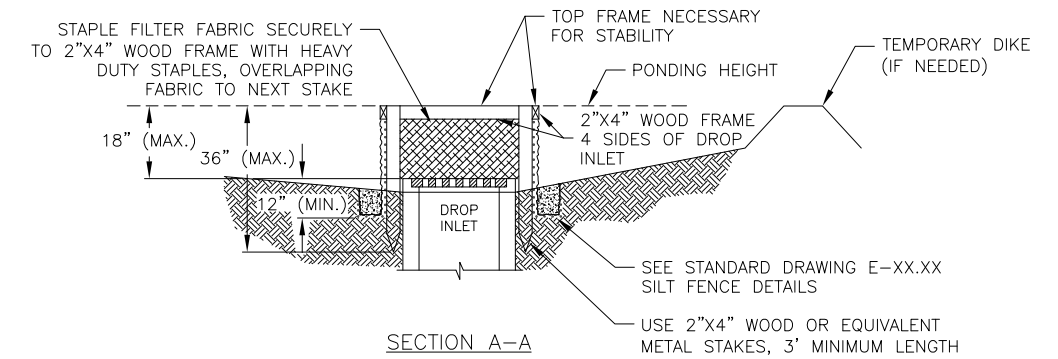

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**STORM DRAIN INLET  
SEDIMENT PROTECTION  
(AREA INLET FILTER MAT  
& FILTER FABRIC)**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

AREA DRAINS OR CURB INLET NOTES:

MATERIALS

PREFABRICATED UNITS: UPON APPROVAL BY THE ENGINEER, USE IN PLACE OF THE DESIGN SHOWN ON THIS DRAWING.

SEDIMENT CONTROL INLET HATS: SHALL BE A POLYETHYLENE HAT-LIKE STRUCTURE COVERING THE INLET WITH SMALL WEEP HOLES ON THE SIDE PROVIDING A FILTERING FUNCTION FOR THE STORMWATER RUNOFF, AND A LARGE OPENING ABOVE THE WEEP HOLES FOR EMERGENCY OVERFLOW.

FILTER BAG INSERTS: SHALL CONSIST OF A REPLACEABLE FILTER BAG REINFORCED WITH AN OUTER POLYESTER MESH FABRIC.

1. THE FILTER BAG SHALL BE SUSPENDED FROM A GALVANIZED STEEL RING, REBAR OR STEEL RODS, OR FRAME THAT FITS WITHIN A GRATE UTILIZING A STAINLESS STEEL BAND AND LOCKING CLAMP.
2. CONSTRUCT THE FILTER BAG THAT IS SUSPENDED FROM A FRAME OF A POLYPROPYLENE FILTER GEOTEXTILE FABRIC, THAT MEETS THE FOLLOWING MINIMUM REQUIREMENTS:

	ASTM METHOD	VALUE	UNITS
UNIT WEIGHT	--	4	OUNCE/SQ YD
FLOW RATE	--	145	GALLONS/MINUTE/SQ FT
PERMITTIVITY	D4491	0.5	PER SECOND
GRAB TENSILE STRENGTH	D4632	200	POUNDS
PUNCTURE STRENGTH	D6241	80	POUNDS
TEAR STRENGTH	D4533	50	POUNDS
DEBRIS CAPACITY	--	2	CUBIC FT

3. DOUBLE STITCH ALL EDGES AND SEAMS.
4. THE FILTER BAG INSERT SHALL HAVE OVAL, EDGE-HEAT-SEALED OVERFLOW HOLES, MINIMUM 2 INCHES X 4 INCHES, CUT INTO ALL FOUR PANEL SIDES.
5. PROVIDE BUILT-IN OVERFLOW BYPASS.
6. THE INLET STRUCTURE'S GRATE OVERFLOW CAPACITY IS AT A MINIMUM EQUAL TO THE DESIGN FLOW CAPACITY.
7. PROVIDE A RETRIEVAL SYSTEM, SUCH AS FLAPS, HANDLES, OR CORDS, TO ALLOW REMOVAL OF THE BELOW-INLET GRATE BARRIER WITHOUT SPILLING THE COLLECTED MATERIAL.


INSTALLATION

1. IF PREFABRICATED SEDIMENT PROTECTION DEVICES ARE USED, INSTALL AS SPECIFIED BY THE VENDOR OR MANUFACTURER.

INSPECTION, MAINTENANCE, AND REMOVAL

1. SEE STORM DRAIN INLET SEDIMENT PROTECTION GENERAL NOTES ON BMP-25.00 [STORM DRAIN INLET SEDIMENT PROTECTION (NOTES & AREA INLET FIBER ROLL OR GRAVEL/SAND BAG BERM)] NOTES FOR INSPECTION, MAINTENANCE, AND REMOVAL.


INLET SPECIFICATIONS AS PER THE PLAN DIMENSION LENGTH AND WIDTH TO MATCH FLAP POCKET

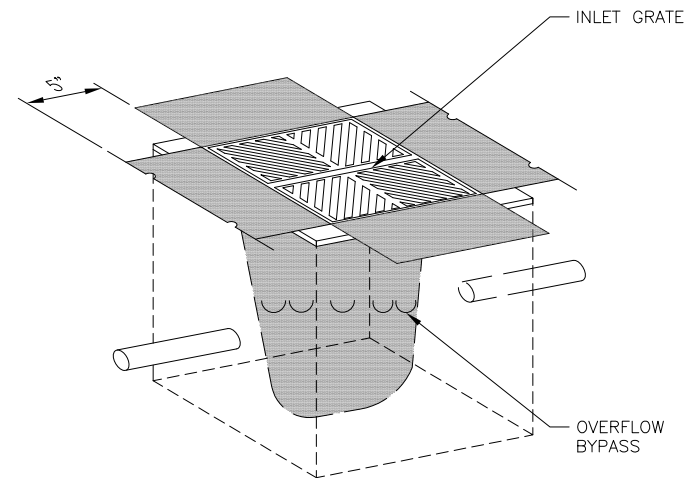

PERSPECTIVE

SEDIMENT CONTROL INLET HAT  
FOR AREA DRAINS OR CURB INLETS

NOT TO SCALE

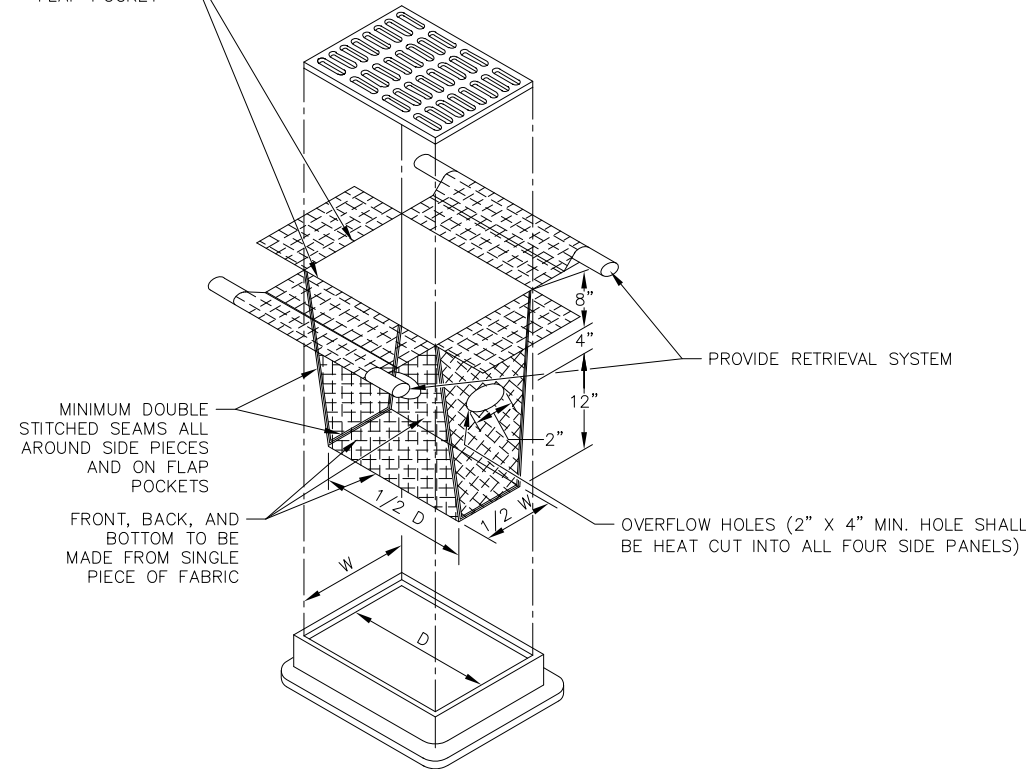

PERSPECTIVE

FILTER BAG INSERT  
FOR AREA DRAINS OR CURB INLETS

NOT TO SCALE

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
STORM DRAIN INLET  
SEDIMENT PROTECTION  
(AREA OR CURB INLET  
FILTER INSERT)

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

# BMP 30.00. Surface Roughening

---

## DESIGN CONSIDERATIONS

### *Objectives*

Surface roughening measures are intended to aid in the establishment of vegetative cover from seed, to reduce runoff velocity and increase infiltration, and to reduce erosion.

A rough, loose soil surface provides more favorable moisture conditions for seed germination than hard, smooth surfaces. It provides interstitial space for seed deposition and germination and root growth.

### *Description*

Surface roughening establishes a rough soil surface by creating horizontal grooves, furrows, or depressions running parallel to the slope contour over the entire face of the slope. The most common measures include:

- **Stair-Step Grading** - This is done by cutting “steps” along the contour of a slope, and is applicable to slopes with a gradient greater than 3:1, which have material soft enough to be bulldozed.
- **Tracking** - This is done by running tracked machinery (such as bulldozers) up and down slopes to leave horizontal depressions in the soil.
- **Mechanical methods** – This is done by drawing or rolling equipment such as punch or sheepfoot rollers over the surface.
- **Manual Raking** - This is done manually by using hand tools such as rakes or hoes to create grooves at least 1-inch deep and no more than 12 inches apart.

### *Other Names*

Contour grading, serration, cat tracking, track walking

### *Applicability*

Surface roughening measures provide simple, inexpensive, and immediate short-term erosion control for bare soil where vegetative cover is not yet established on construction slopes greater than 5 vertical feet. By themselves, they are not soil

stabilization and must be seeded, fertilized, and mulched as soon as possible.

### *Selection Considerations*

Selection of slope roughening measures should be based on slope grade, slope type (cut or fill), type of equipment available, and soil type.

1. Cut slopes steeper than 3:1. Use stair-step grading on any erodible material soft enough to be ripped with a bulldozer. Slopes consisting of soft rock with some subsoil are particularly suited to stair-step grading.
2. Fill slopes steeper than 2:1. Use tracking to roughen the face of the slope. If soil is loose, such as sandy soil, manual raking is more suitable.
3. Fill slopes between 2:1 and 3:1. Use tracking or mechanical methods to roughen the face of the slope, if necessary.
4. Cuts, fills, and graded areas no steeper than 3:1. Roughen these areas by tracking, mechanical methods, manual raking, or by using tilling, disking, or harrowing implements.

Surface roughening is suitable for all erodible soils. Stable, sloping rocky faces may not require roughening, while erodible slopes steeper than 3:1 require special attention to surface roughening.

### *Relationship to Other ESC Measures*

Diversions at the upper perimeter of the area function to prevent runoff from causing erosion on the exposed soil. Hydromulch/seed on slopes for erosion control. Silt fences and sediment basins at the lower perimeter of the area function to prevent off-site sedimentation.

### *Common Failures or Misuses*

- Roughening washed away by heavy rain, necessitating re-roughening and reseeded.
- Failure of upslope control measures (diversions), resulting in excessive flows over area and erosion of soil.
- Surface roughening alone is not considered stabilization.

- Surface roughening must not be used as a means to keep an area “actively worked” to reset the stabilization deadline.
- Track walking in the wrong direction is a common failure that provides valleys for the water to concentrate in.


### SPECIFICATIONS

#### Standard Specification

- 684 – Surface Roughening

#### Drawing


- BMP-30.00 – Surface Roughening

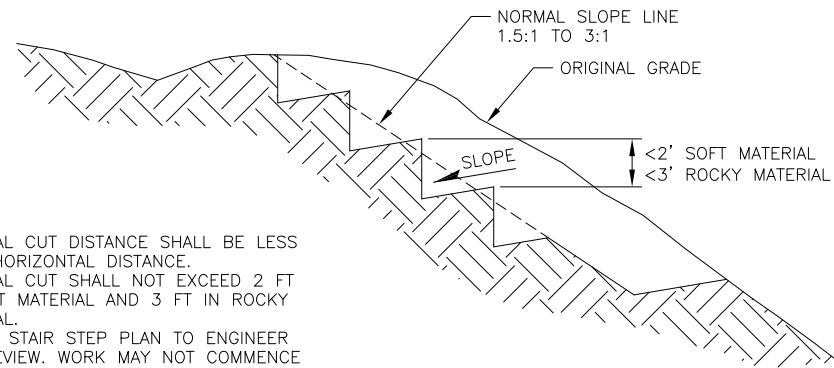

**NOTES:**


1. VERTICAL CUT DISTANCE SHALL BE LESS THAN HORIZONTAL DISTANCE.
2. VERTICAL CUT SHALL NOT EXCEED 2 FT IN SOFT MATERIAL AND 3 FT IN ROCKY MATERIAL.
3. SUBMIT STAIR STEP PLAN TO ENGINEER FOR REVIEW. WORK MAY NOT COMMENCE UNTIL AFTER APPROVAL.

DETAIL 1: STAIR STEP GRADING

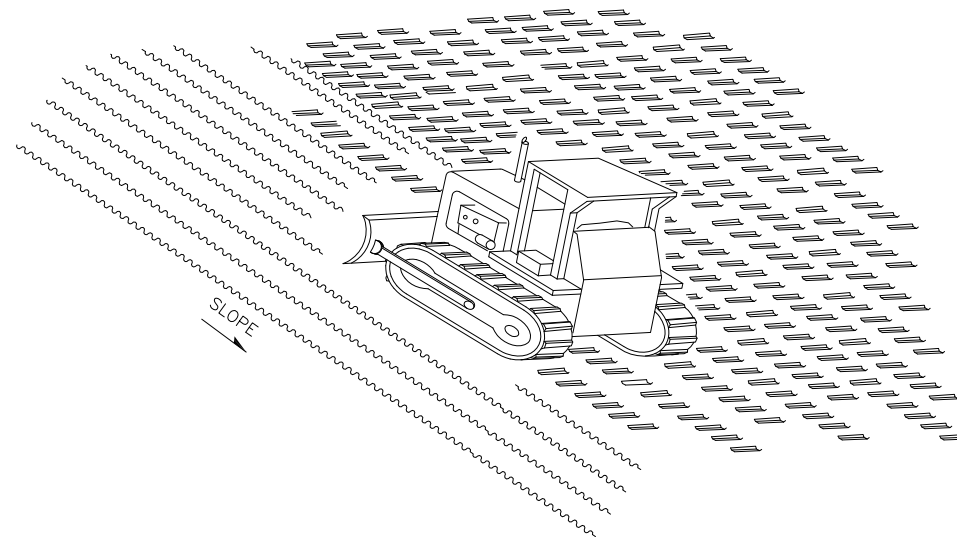

TRACK WITH MACHINERY UP AND DOWN THE SLOPE TO PROVIDE GROOVES TO CATCH SEED AND RAINFALL AND TO REDUCE RUNOFF.

DETAIL 2: TRACKING

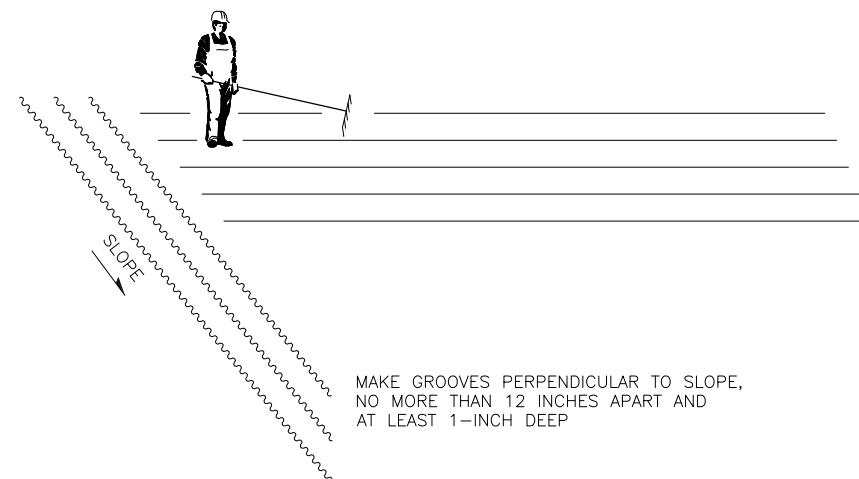

MAKE GROOVES PERPENDICULAR TO SLOPE, NO MORE THAN 12 INCHES APART AND AT LEAST 1-INCH DEEP

DETAIL 3: MANUAL RAKING

**EQUIPMENT**

TRACKED EQUIPMENT (SUCH AS BULLDOZERS), SHEEPSFOOT OR PUNCH ROLLERS, RAKES, HOES, HARROWING TOOLS OR OTHER EQUIPMENT AS APPROVED BY THE ENGINEER.

**INSTALLATION**

1. GROOVE THE SLOPE TO CREATE A SERIES OF RIDGES AND DEPRESSIONS THAT RUN ACROSS THE SLOPE, ALONG THE CONTOUR OF THE GROUND.
2. ON FILL SLOPES STEEPER THAN 3:1, ENSURE THAT THE FACE OF THE SLOPE CONSISTS OF LOOSE, UNCOMPACTED FILL 4 INCHES TO 8 INCHES DEEP.
3. DO NOT BLADE OR SCRAPE THE FINAL SLOPE FACE. DO NOT BACK BLADE DURING THE FINAL GRADING OPERATION.
4. WHEN ROUGHENING WITH TRACKED MACHINERY (DETAILS 1 OR 2), LIMIT THE NUMBER OF PASSES TO AVOID UNDUE COMPACTION OF THE SOIL.
5. AVOID EXCESSIVE ROUGHNESS THAT WOULD HINDER UNIFORM PLANT ESTABLISHMENT, SUCH AS A LARGE PERCENTAGE OF THE AREA WITH FURROWS DEEPER OR CLODS LARGER THAN 4 INCHES.

SEED, FERTILIZE, AND MULCH AREAS THAT ARE ROUGHENED AS SOON AS PRACTICABLE.

**INSPECTION**

ENSURE THE AREA HAS AN ADEQUATE DEPTH AND COVERAGE OF ROUGHENING. INSPECT THE AREAS ACCORDING TO ESTABLISHED SCHEDULES AS REQUIRED BY THE CGP AND THE SWPPP.

**MAINTENANCE**

REGRADE AND RESEED AS SOON AS PRACTICABLE IF RILLS OR CHANNELIZATION OF RUNOFF APPEAR.

REVISIONS		
Date	Description	By

State of Alaska  
Department of Transportation  
& Public Facilities  
**SURFACE ROUGHENING**

A  
P  
P  
R  
O  
V  
E  
D

NOT TO SCALE

Date 12/2015 X/XX/XX

## **BMP 31.00 – 33.00. Temporary Check Dam**

---

These instructions include BMP 31.00, 32.00, and 33.00.

### DESIGN CONSIDERATIONS

#### *Objectives*

Temporary Check Dams are used to reduce scour, reduce velocity, dissipate energy, prevent erosion, and settle sediment behind the weir structure in an unlined channel or vegetative swale.

#### *Description*

A Temporary Check Dam can be constructed of a variety of materials and is placed perpendicular to flow in a ditch or channel. It is placed so that it extends higher than the water level on both sides of the flow path and is lower in the center to allow water to flow through a controlled path.

Temporary Check Dams can be constructed from angular rock, fiber rolls, prefabricated foam barriers, sandbags, or compost socks. When rock is used, small sediment particles become lodged in the check dam's interior.

#### *Other Names*

In-Stream/Channel Energy Dissipater, Velocity Control Device, Sediment Trap, Ditch Check

#### *Applicability*

Temporary Check Dams are placed in series in ditches, swales, or other minor drainageways that require velocity checks, are not yet vegetated, or are intended to be filled or stabilized at a later time. When placed in a lined channel, check dams dissipate velocity, settle sediment, and anchor the liner.

Check dams may also be used as permanent measures for gradient control structures in ditches adjacent to elevated roadway sections.

#### *Selection Considerations*

Dependent on materials available, best management practices (BMPs) being used on the project and the durability required, Temporary Check Dams can be constructed from rock, fiber rolls, prefabricated barrier systems, sandbags, or compost socks. The Standard Drawing for Temporary Check Dams has details for the installation of each type of check dam.

- Check dams are used in narrow ditches.
- Steep channel slopes reduce effectiveness.
- Coupling check dams with a small adjacent upstream sump improves velocity slowing and sediment trapping ability.
- The area downstream from the last dam should be stabilized or flow diverted.
- Check dam rocks interfere with the establishment of vegetation.
- Some Temporary Check Dams are left as a permanent control measure. Removal may be indicated because of unsightliness or interference with maintenance (grass mowing) activities.

#### *Design*

The design of Temporary Check Dams (high at channel banks, lower in the middle) directs overtopping flows centrally to avert scouring of channel surfaces. The check dam is keyed into channel slopes to prevent bank undercut and erosion.

Check dam structures are sized to stay in place during peak flow. The check dam height or weir depth should pass 2-year, 24-hour storm runoff without overtopping the roadway or ditch sideslopes. Generally, check dams are not constructed higher than recommended since excessive weir depth seriously impacts the flow characteristics of the ditch.

- Design flow: 2-year, 24-hour
- Spacing:
  - Align the base of the upstream check dam with the top of the next downstream check dam.
  - Space check dams evenly in the drainageway, adjust spacing for grade breaks.
  - Use the spacing chart below to determine the distance between check dams based on slope and check dam height.

Maximum Spacing for Temporary Check Dams (Feet)

Ditch Grade	Minimum Weir Depth	
	12 inches	18 inches
6%	15	25
5%	20	30
4%	25	40
3%	30	50
2%	50	80

This table is used to estimate the number of check dams. Actual spacing should be based on field conditions and meet the requirement that the top elevation is equal to the bottom elevation of the next upstream check dam. Spacing is also a function of the ditch erodibility, the flow, and the velocity.

*Relationship to Other Erosion and Sediment Control Measures*

Temporary Check Dams are used for channel protection prior to establishment of permanent or stabilized erosion controls. Although check dams perform some sediment filtering, they are not intended to replace filters or sediment basins. A depression in the bottom of the channel at the upstream edge of a check dam augments velocity slowing and sediment removal; however, digging a sump through stabilized in-channel protection (e.g. grassed lining) should be avoided.

Protective channel linings (e.g. grassed waterway, concrete or rock-lined ditch, erosion control blankets, or matings), sediment settling ponds, permanent ditch blocks, brush barriers, diversions, slope drains, or combinations of these measures can be used in conjunction with or as an alternative to Temporary Check Dams.

*Common Failures or Misuses*

- Improper spacing of check dams.
- Undercut/washout of channel banks beside the structure due to improper installation (e.g. dam not built high enough onto the banks).
- Increased bank erosion (e.g. at channel bends) or inadequate protection of channel surfaces due to improper location or installation of check dams.

- Water backup and bank overflow due to overly tall dam structure.
- Use of check dams for soil stabilization.
- Placement of check dams at abrupt bends causing erosive waters to be misdirected by the check dam into channel banks.
- Check dams installed in grass-lined structures may kill the vegetative lining if siltation is excessive or the check dam remains submerged for extended periods of time.
- Placement in waters of the U.S. or wetlands without appropriate agency permitting.
- Placement of check dams below the expected backwater from a salmonid bearing water causing a loss of high flow refuge habitat for overwintering juvenile salmonids and emergent fry.
- Improperly anchored check dams causing the check dam to wash away.
- When rock is used, inadequate rock size or angularity.
- When rock is used, rocks washed downstream causing culvert clogs, misdirecting flow, etc.
- Use of silt fence or straw bales as check dams.

SPECIFICATIONS

Standard Specification


- 685- Temporary Check Dam

Drawings


- BMP-31.00 Temporary Check Dam (Notes & Fiber Roll or Compost Sock)
- BMP-32.00 Temporary Check Dam (Prefabricated Barrier System & Rock)
- BMP-33.00 Temporary Check Dam (Sandbag)

Reference Drawings


- BMP-04.00 Compost Berm
- BMP-05.00 Compost Sock
- BMP-10.00 Fiber Rolls for Erosion and Sediment Control
- BMP-13.00 Prefabricated Barrier System

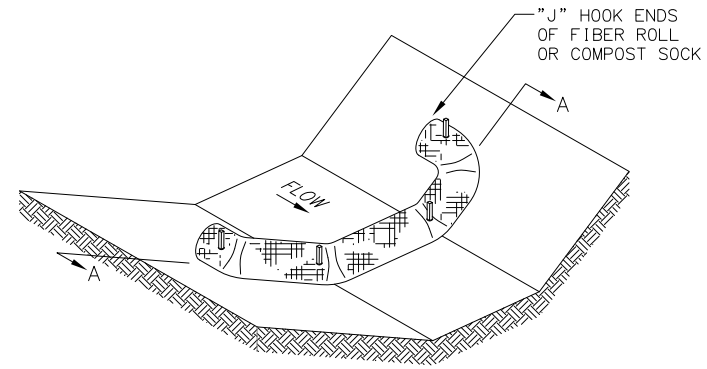

PERSPECTIVE

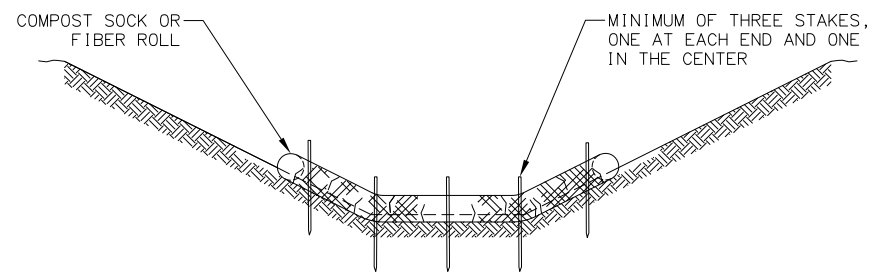

SECTION A-A

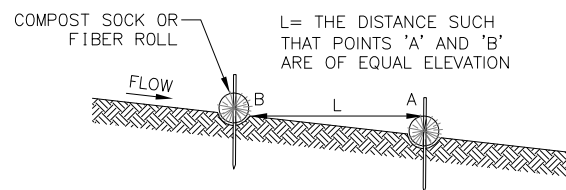

PROFILE

FIBER ROLL OR COMPOST SOCK  
NOT TO SCALE

- FIBER ROLL OR COMPOST SOCK NOTES:
1. FOR USE OF FIBER ROLLS SEE BMP-10.00 FIBER ROLLS FOR EROSION AND SEDIMENT CONTROL.
  2. FOR USE OF COMPOST SOCKS SEE BMP-05.00 COMPOST BERM & SOCK.
- INSTALLATION, INSPECTION, MAINTENANCE, AND REMOVAL
1. SEE TEMPORARY CHECK DAM NOTES, THIS SHEET.

TEMPORARY CHECK DAM GENERAL NOTES:

MATERIALS

TEMPORARY CHECK DAM: USE ONLY CLEAN MATERIALS.

INSTALLATION

1. INSTALL CHECK DAMS AS SOON AS DRAINAGE ROUTES ARE ESTABLISHED.
2. PLACE CHECK DAMS PERPENDICULAR TO THE FLOW OF WATER.
3. IF NECESSARY, IMPOUND OR BYPASS UPSTREAM WATER FLOW PRIOR TO INSTALLING CHECK DAMS.
4. EXTEND CHECK DAMS ONTO THE CHANNEL BANKS TO A HEIGHT ABOVE ANTICIPATED HIGH WATER LEVEL TO PREVENT LOCALIZED UNDERMINING AND EROSION.

INSPECTION

1. VISUALLY COMPARE UPSTREAM AND DOWNSTREAM FLOWS TO DETERMINE RELATIVE TURBIDITY LEVELS AND EFFECTIVENESS OF CHECK DAMS.
2. INSPECT CHANNEL BANKS FOR EVIDENCE OF UNDERMINING AND EROSION.
3. INSPECT FOR DAM DETERIORATION AND FOR MIGRATION OF STRUCTURAL COMPONENTS DOWNSTREAM.
4. ENSURE THE CENTER OF THE DAM IS LOWER THAN THE EDGES AND THAT WATER IS NOT RUNNING AROUND THE ENDS.

MAINTENANCE

1. REPAIR BANK UNDERCUTS.
2. REMOVE ACCUMULATED SEDIMENT BEFORE IT REACHES HALF THE HEIGHT OF THE DAM OR ONE-THIRD OF THE AVAILABLE STORAGE IF PROTECTING A WATER BODY OR STORM DRAIN INLET.
3. REPAIR UNDERCUTTING AND FLOW AROUND THE EDGES OR, IF NECESSARY, REPOSITION THE CHECK DAM.
4. INSTALL ADDITIONAL DAMS OR OTHER EROSION AND SEDIMENT CONTROL MEASURES AS NEEDED.

REMOVAL

1. AFTER THE DISTURBED AREA IS PERMANENTLY STABILIZED OR WHEN THE GRASS IN THE CHANNEL HAS MATURED SUFFICIENTLY TO PROTECT THE DITCH OR SWALE, REMOVE TEMPORARY CHECK DAMS.
2. TAKE CARE DURING CHECK DAM REMOVAL, SINCE THE WATERWAY SURFACE IS SUSCEPTIBLE TO DAMAGE.
3. IMMEDIATELY SEED OR PROVIDE OTHER FORMS OF PROTECTION FOR DAMAGED OR UNPROTECTED AREAS.


REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**TEMPORARY CHECK DAM**  
 (NOTES & FIBER ROLL OR  
 COMPOST SOCK)


A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX




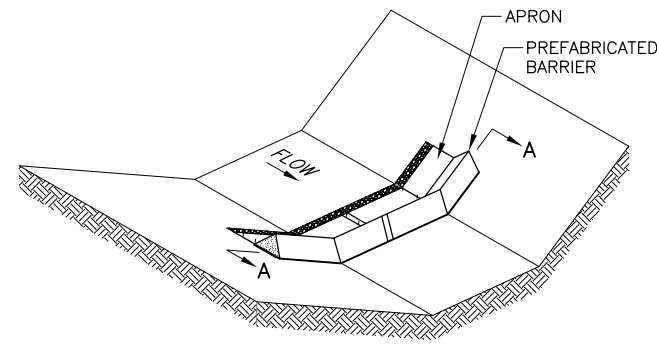


PERSPECTIVE

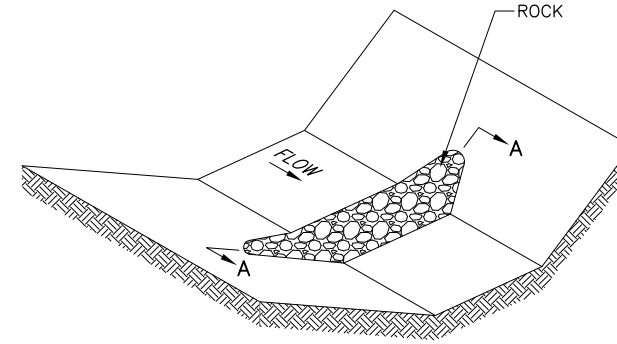


PERSPECTIVE

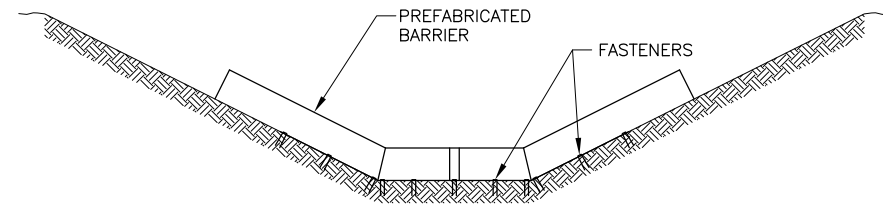


SECTION A-A

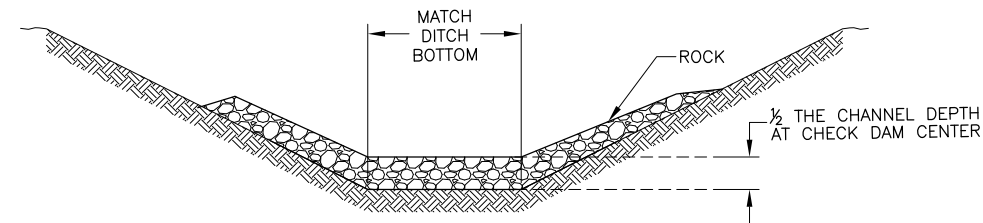

SECTION A-A

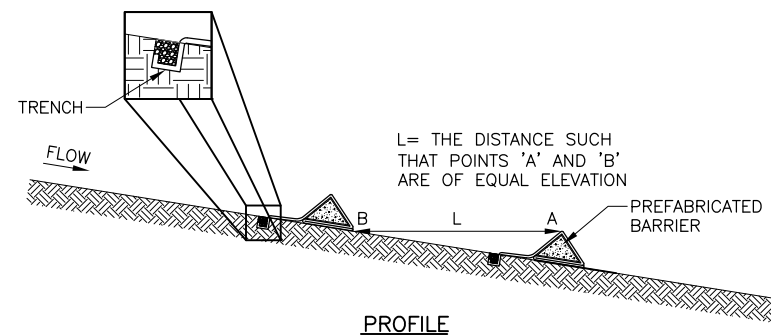

PROFILE

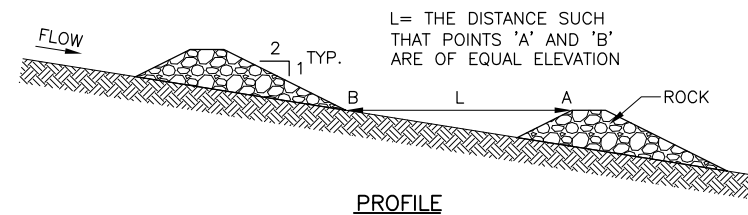

PROFILE

**PREFABRICATED BARRIER SYSTEM CHECK DAM**  
NOT TO SCALE

**PREFABRICATED BARRIER SYSTEM NOTES:**

1. FOR USE OF PREFABRICATED BARRIER, SEE BMP-13.00 PREFABRICATED BARRIER SYSTEM

**INSTALLATION, INSPECTION, MAINTENANCE, AND REMOVAL**

1. SEE TEMPORARY CHECK DAM GENERAL NOTES ON BMP-31.00 (TEMPORARY CHECK DAM SHEET 1) - NOTES FOR INSTALLATION, INSPECTION, MAINTENANCE, AND REMOVAL.

**ROCK CHECK DAM**  
NOT TO SCALE

**ROCK NOTES:**  
**MATERIALS**

BERM: CLEAN HARD ANGULAR (E.G. CRUSHED, SHOT) ROCK GRADED ACCORDING TO EXPECTED FLOWS; 3- TO 6-INCH DIAMETER ROCK IS USUALLY ADEQUATE.

**INSTALLATION**

1. PLACE ROCK BY HAND OR MECHANICAL MEANS, DISTRIBUTING SMALLER ROCKS TO THE UPSTREAM SIDE TO PREVENT TRANSPORT.

**MAINTENANCE**

1. REPAIR VOIDS.
2. FORTIFY DISINTEGRATING DAMS. CONSIDER WHETHER ROCK SIZE IS SUFFICIENT FOR FLOWS.
3. CORRECT EFFECTS OF ROCK MIGRATION (E.G. CLOGGED CULVERT, FLOW CONSTRICTION) OR ANY DOWNSTREAM EROSION. IDENTIFY THE ORIGIN OF THE PROBLEM AND REPAIR, REPLACE OR ADD BMPS TO CORRECT IT.

**ADDITIONAL NOTES**



1. SEE TEMPORARY CHECK DAM GENERAL NOTES ON BMP-31.00 (TEMPORARY CHECK DAM SHEET 1) - NOTES FOR INSTALLATION, INSPECTION, MAINTENANCE, AND REMOVAL.

REVISIONS		
Date	Description	By


State of Alaska DOT&PF  
**TEMPORARY CHECK DAM  
(PREFABRICATED BARRIER  
SYSTEM & ROCK)**

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

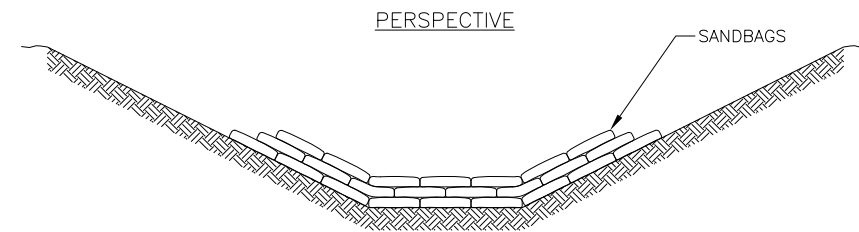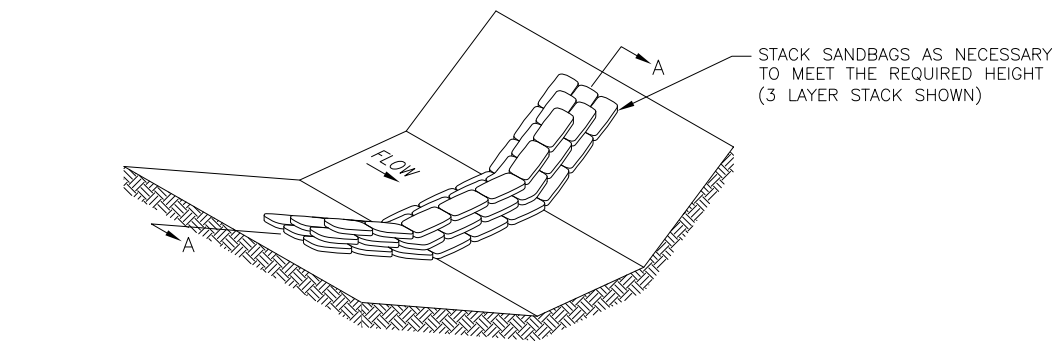

SECTION A-A

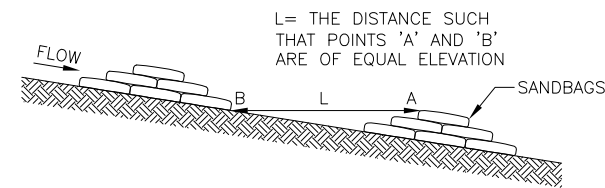

PROFILE

SANDBAG CHECK DAM  
NOT TO SCALE

**SANDBAG NOTES:**

**MATERIALS**

**SANDBAG BARRIER:** TIGHTLY WOVEN BURLAP OR WOVEN GEOTEXTILE BAG MATERIAL THAT IS SUFFICIENTLY DURABLE TO REMAIN INTACT FOR THE TIME INTENDED. FILL BAGS  $\frac{3}{4}$  FULL OF GRAVEL OR SAND WITH A GRADATION SUCH THAT NO FINE SEDIMENT PASSES THROUGH THE BAG. IF THE SANDBAGS ARE NEEDED FOR MORE THAN ONE SUMMER SEASON, PROVIDE BAG MATERIAL THAT HAS ULTRAVIOLET STABILITY OF AT LEAST 70% IN CONFORMANCE WITH ASTM D4355 REQUIREMENTS. SECURELY CLOSE THE SAND BAGS.

**INSTALLATION**

1. PLACE SANDBAGS SO THAT THE INITIAL ROW MAKES TIGHT CONTACT WITH THE DITCH LINE FOR THE LENGTH OF THE DAM.
2. TIGHTLY ABUT ALL SANDBAGS.
3. STAGGER SANDBAG LIFTS SO THAT THE CENTER OF THE BAG IS PLACED ON THE SPACE BETWEEN BAGS ON THE PREVIOUS LIFT.

**INSPECTION**

1. ENSURE THE SANDBAGS ARE IN TIGHT CONTACT WITH THE SOIL.
2. LOOK FOR SPLIT, TORN, OR UNRAVELING BAGS.

**MAINTENANCE**

1. REPLACE DAMAGED SANDBAGS AS NECESSARY.

**ADDITIONAL NOTES**

1. SEE TEMPORARY CHECK DAM GENERAL NOTES ON BMP-31.00 (TEMPORARY CHECK DAM SHEET 1) – NOTES FOR INSTALLATION, INSPECTION, MAINTENANCE, AND REMOVAL.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
**TEMPORARY CHECK DAM  
(SANDBAG)**

Date 12/2015  
APPROVED  
X/XX/XX

## **BMP 38.00. Vegetation Buffer**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

A Vegetation Buffer is intended to reduce the quantity of suspended soil sediments in construction-related stormwater runoff by using living strips of vegetation suitable to reducing run-off velocities. The application for this type of control can include, but is not limited to the following:

- Type I – Perimeter Control - Provides a Vegetation Buffer as a perimeter control between the on-site construction related activities and the project boundaries.
- Type II – Natural Buffer - Provides a Vegetation Buffer between the construction related activities and sensitive areas such as waters of the U.S. and riparian areas (as required by the Alaska Construction General Permit [CGP]).

#### *Description*

Vegetation Buffers can be strips of existing vegetation or can be areas that are graded and planted with grass or other types of vegetation. They are intended to be used adjacent to where construction activities will occur and are primarily designed to treat sheet flow. Vegetation Buffers should not be used in areas with concentrated flows. Larger areas must be used to accommodate the larger run-off volume. These strips function by reducing the velocity of run-off to allow the suspended sediments and other pollutants to settle and partially infiltrate into the underlying soils.

#### *Other Names*

Vegetated Sediment Filtration Areas, Buffer Strips, Vegetated Strips

#### *Applicability*

Vegetation Buffer strips can be used at numerous locations over a project but are best suited if installed at locations where the soil is well drained and where the water table and bedrock are well below the surface. Vegetation Buffers may also be effectively used on the top and bottom of slopes. They can be used either temporarily or as permanent installations.

#### *Selection Considerations*

During the design phase of a project any area specified to be a natural Vegetation Buffer area should be identified. The type of vegetation, soil conditions, and the estimated volume of stormwater run-off should be considered when selecting a natural Vegetation Buffer.

Vegetation Buffer areas that are installed (or planted) should be located directly adjacent to where construction activities will occur. These areas should be graded and planted to establish a healthy vigorous stand of vegetation prior to any construction occurring. Other erosion and sediment control measures should be installed to help protect and stabilize the Vegetation Buffer while the planted vegetation becomes established.

When retaining existing vegetation as a Vegetative Buffer, minimize the disturbed areas by locating temporary roadways to avoid stands of vegetation and following the existing contours to reduce cutting and filling. To avoid disturbing the root-zone of existing trees, the edge of the tree canopy or drip-line should be noted when locating these temporary roadways.

Vegetated Buffers must be on land controlled by the project. If in wetlands, they must be recognized in the wetland permit.

#### *Design*

The designer should consider the type of Vegetation Buffer (Type I or II) and the slope of the proposed Vegetation Buffer area, the soil type and infiltration rate, the water table level, the type of proposed or existing vegetation, the estimated stormwater flow in the area, and the protection of sensitive areas. There may be site specific constraints that dictate alternate widths for a Vegetation Buffer or require the use of a different perimeter control measure.

Vegetation Buffer areas should be fully established with vegetation prior to construction occurring. A fully established Vegetation Buffer should be composed of species that are capable of growing a sod forming mass that covers 90 percent of the selected area. New Vegetation Buffers with planted vegetation should be composed of more than just one species and be hardy to the area. The

combination of species should be capable of creating a perennial stand of vegetation and be able to withstand frequent inundation from run-off. See BMP-53 Permanent Seeding.

All Vegetation Buffer areas with either naturally-occurring or planted stands of vegetation should be delineated prior to and throughout construction to prevent damage to the vegetation and its roots. All Vegetation Buffer areas should be inspected for impacts from soil deposited by construction related activities, damage from channelized run-off, excess accumulation of sediment, and disturbance or damage from construction activities. It may be necessary to employ other erosion and sediment control measures upstream to support existing Vegetation Buffer areas. Do not include the acreage of Vegetation Buffers in the acreage of disturbed areas for the purpose of the Notice of Intent (NOI) acreage.

The two types of buffers for Vegetation Buffer landscaping include the following:

Type I Perimeter Control Vegetation Buffers are used to help filter sediments from run-off before it leaves the job site. These can be composed of existing or newly planted vegetation. The length of these buffers should be determined by the steepness of the slope.

Type II Natural Buffer Vegetation Buffers are used when required by the Alaska CGP to protect sensitive areas (such as waters of the U.S. or riparian areas). The minimum width shall be 25 feet unless found to be infeasible. However, in some cases the governing local ordinance may specify an alternate minimum width. In such cases, it is the responsibility of the designer and the contractor to review and adhere to the specific requirements for a Vegetation Buffer in the local ordinance. Local ordinances governing nonpoint source pollution in Alaska can be found here:

<http://www.commerce.state.ak.us/dca/nonpoint/ordinances.cfm?type=Hy>

#### *Relationship to Other Erosion and Sediment Control Measures*

Vegetation Buffer areas with existing vegetation may not require other erosion and sediment control measures; however, installing or planting new Vegetation Buffer areas will require other erosion

and sediment control measures during the establishment period of the specified vegetation.

#### *Common Failures or Misuses*

Common failures are generally due to faulty application and maintenance. These failures include:

- Damage to the roots or stalks of the vegetation from construction activities.
- Overwhelming the buffer with excessive quantities of stormwater run-off, sediments, channelized run-off, and pollutants.
- Inadequate subsurface soil, vegetation, and size of Vegetation Buffer strip
- Non-observance of delineated Vegetation Buffer areas.
- Designer does not visit site and fails to take site specific conditions into account.


#### SPECIFICATIONS

##### Standard Specifications

- 688 – Vegetation Buffer
- 201 – Clearing and Grubbing
- 203 – Excavation and Embankment
- 620 – Topsoil
- 651 – Hydraulic Erosion Control Product
- 652 – Soil Amendments
- 655 – Site Delineation
- 712-2.01 – Water
- 724 – Seed
- 725 – Fertilizer
- 726 – Topsoil
- 751 – Hydraulic Erosion Control Products
- 752 – Tackifier
- 753 – Soil Amendments

##### Drawing

- BMP-38.00 Vegetation Buffer

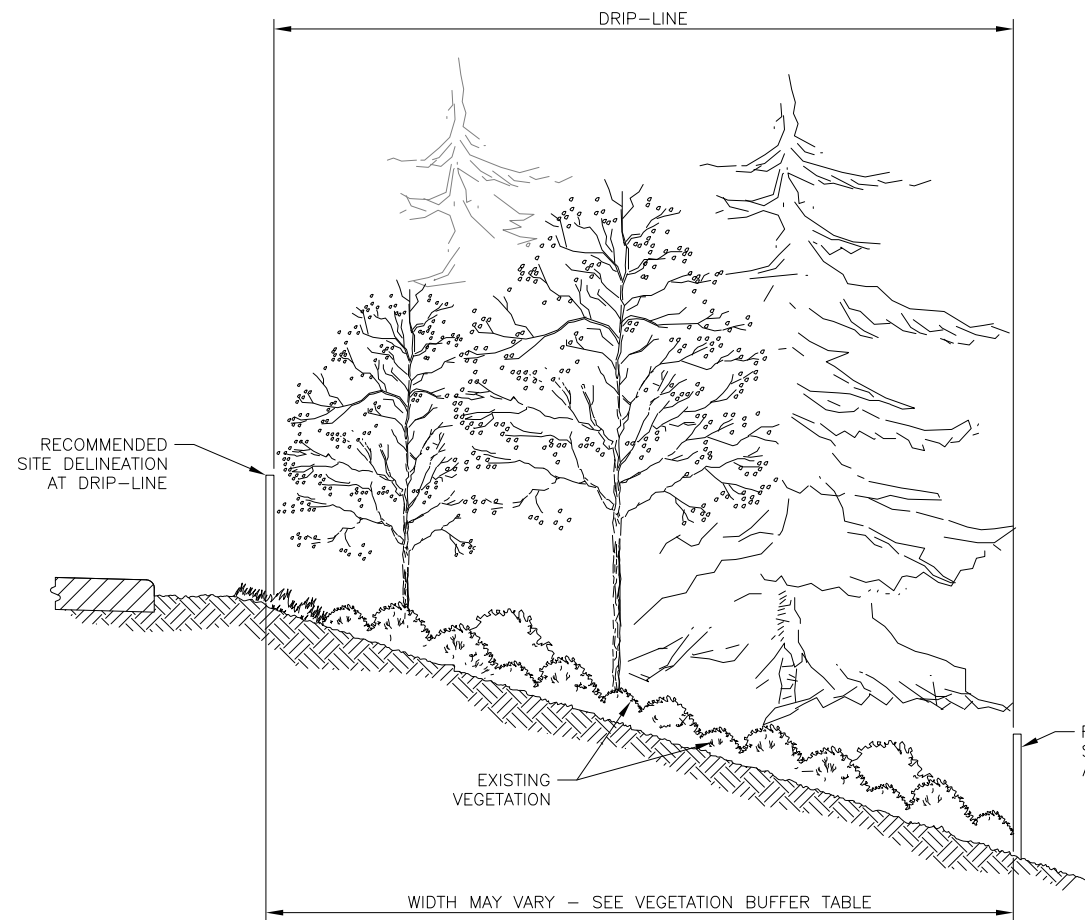


SECTION

EXISTING VEGETATION BUFFER

NOT TO SCALE

EXISTING VEGETATION BUFFER AREA NOTES:

- INSTALLATION**
1. DELINEATE UNDISTURBED NATURAL AREAS OF VEGETATION IDENTIFIED IN THE PLANS WITH METHODS CONSISTENT WITH THE SITE DELINEATION SPECIFICATION PRIOR TO COMMENCEMENT OF CLEARING AND GRUBBING OPERATIONS OR OTHER SOIL DISTURBING ACTIVITIES.
  2. ENSURE ALL OTHER SEDIMENT CONTROL MEASURES USED IN CONJUNCTION WITH THE VEGETATION BUFFER AREAS ARE IN PLACE AND FUNCTIONING PROPERLY.
  3. DO NOT ALLOW CONSTRUCTION MATERIALS, EQUIPMENT, OR PARKING ON THE VEGETATION BUFFER AREAS OR WHERE THE ROOT-ZONE OF THE VEGETATION MAY BE DAMAGED.

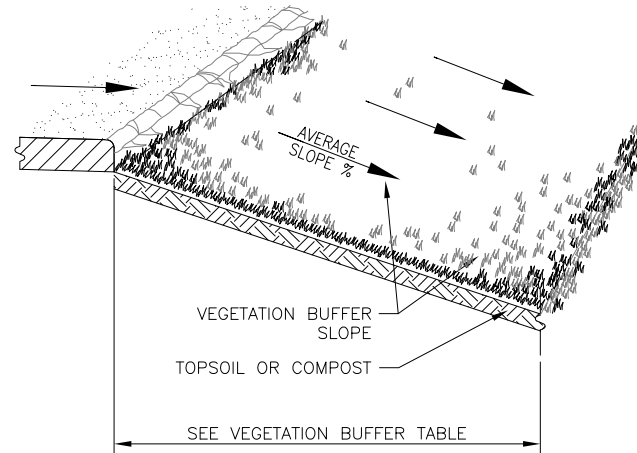

PERSPECTIVE

NEW VEGETATION BUFFER

NOT TO SCALE

NEW VEGETATION BUFFER AREA NOTES:  
THIS BMP IS NOT APPROPRIATE FOR PROJECTS LASTING LESS THAN 30 DAYS. THIS BMP IS NOT APPROPRIATE FOR ALL CLIMATE ZONES IN ALASKA.

MATERIAL  
TOPSOIL OR COMPOST

SEED, FERTILIZER, MULCH

INSTALLATION

1. ENSURE ALL SEDIMENT CONTROL MEASURES IDENTIFIED IN THE SWPPP (SUCH AS SILT FENCE AND DIVERSIONS) ARE IN PLACE TO PROTECT WATERS OF THE U.S. UNTIL THE VEGETATION BUFFER AREA IS ESTABLISHED.
2. ESTABLISH VEGETATION USING SPECIFIED SEED, FERTILIZER, AND MULCH. IF SEED MIX IS NOT SPECIFIED, USE PERMANENT SEED MIX FOR PERMANENT, POST-CONSTRUCTION BUFFERS AND FAST GROWING ANNUAL RYE FOR TEMPORARAY BUFFERS.
3. MAINTAIN VEGETATION AND PROVIDE IRRIGATION AS NECESSARY TO ENSURE VIGOROUS GROWTH AND TO PREVENT DIEBACK.
4. DELINEATE VEGETATION BUFFER AREAS WITH METHODS CONSISTENT WITH THE SITE DELINEATION SPECIFICATION AT THE EDGE OF THE NEW VEGETATION BUFFER.
5. AVOID DAMAGE TO THE VEGETATION BUFFER OR ROOT-ZONE BY NOT ALLOWING CONSTRUCTION MATERIALS, EQUIPMENT OR PARKING ON THEM.

VEGETATION BUFFER NOTES:

MATERIAL

SITE DELINEATION MATERIAL: SEE SPECIFICATION SECTION 655 SITE DELINEATION.

INSPECTION

1. INSPECT NATURAL EXISTING VEGETATION BUFFER AREAS TO ENSURE THAT THE SITE DELINEATION TO MARK THE NON-DISTURBANCE AREAS IS IN PLACE.
2. CHECK FOR DAMAGE BY EQUIPMENT AND VEHICLES.
3. INSPECT NEW VEGETATION BUFFER AREAS FOR THE PROGRESS OF GERMINATION AND PLANT GROWTH.
4. ENSURE STORMWATER FLOWING THROUGH THE AREA IS NOT FORMING PONDS, RILLS, OR GULLIES.
5. INSPECT FOR SEDIMENT DEPOSITION THROUGHOUT THE BUFFER.

MAINTENANCE

1. REPLACE OR REPAIR SITE DELINEATION (SUCH AS FENCING, STAKING, OR FLAGGING) AS NECESSARY TO DELINEATE THE VEGETATION BUFFER AREAS.
2. REPAIR ANY DAMAGE BY EQUIPMENT OR VEHICLES.
3. PROVIDE ADDITIONAL SEED, FERTILIZER, AND WATER TO REPAIR SEEDED AREAS DAMAGED BY EROSION OR PONDING OF WATER.
4. IF SEDIMENT IS DEPOSITING IN THE BUFFER, INSTALL IMPROVED EROSION CONTROL MEASURES UPSLOPE OF THE BUFFER.

REMOVAL

1. PROVIDE THE NECESSARY PERMANENT STABILIZATION TO AREAS WITH TEMPORARY VEGETATION BUFFER AS REQUIRED BY PLANS.
2. REMOVE SITE DELINEATION MATERIAL AFTER FINAL STABILIZATION OF WORK AREAS. WORK TO REMOVE THE SITE DELINEATION MATERIAL SHALL NOT DAMAGE THE EXISTING VEGETATION OR ANY STABILIZATION MEASURE.

VEGETATION BUFFER TABLE

AVERAGE SLOPE	BUFFER WIDTH (MIN.)
0%-2%	25 FEET
3%-5%	29-37 FEET
5%-10%	37-57 FEET
10%-20%	57-100 FEET
20% MAXIMUM	100 FEET

VEGETATION BUFFER TABLE NOTES:

1. THE MINIMUM WIDTH FOR ANY VEGETATION BUFFER IS 25 FEET. FOR EVERY 1% INCREASE OF THE SLOPE ADD 4 FEET TO THE VEGETATION BUFFER WIDTH.
2. INSTALL VEGETATION BUFFERS ENTIRELY WITHIN THE RIGHT-OF-WAY.
3. FOR VEGETATION BUFFERS THAT ARE USED AS PERIMETER CONTROL (TYPE 1):
  - a. THE MINIMUM WIDTH FOR ANY VEGETATION BUFFER IS 25 FEET WHEN BUFFER WIDTHS LISTED IN THE TABLE ABOVE ARE NOT FEASIBLE.
  - b. USE ADDITIONAL BMPS WHEN THE MINIMUM BUFFER WIDTH CANNOT BE ACHIEVED.
4. THE WIDTH OF VEGETATION BUFFERS THAT ARE NATURAL BUFFER AREAS AS REQUIRED BY THE CGP (TYPE II) MUST ALSO COMPLY WITH THE WIDTH REQUIRED BY LOCAL ORDINANCES, IF GREATER THAN 25 FEET.

REVISIONS		
Date	Description	By

State of Alaska DOT&PF  
VEGETATION  
BUFFER

A  
P  
P  
R  
O  
V  
E  
D

Date 12/2015 X/XX/XX

## **BMP 42.00. Vehicle/Equipment Storage, Maintenance and Fueling**

---

### SPECIFICATIONS

#### *Objectives*

Minimize or eliminate the discharge of pollutants and hazardous materials into storm drain systems, waters of the U.S., or groundwater.

#### *Applicability*

- Procedures and practices are used where on-site storage, maintenance, and fueling takes place.
- When practical, storage, maintenance, and fueling must be done off-site.

### GENERAL VEHICLE/EQUIPMENT PRACTICES

- Designate areas to be used for storage, washing, maintenance, and fueling of equipment and vehicles. Locate these areas as far away from stormwater drainage systems and waters of the U.S. as practicable. Use paved surfaces if practicable.
- Provide appropriate perimeter best management practices (BMPs) to divert clean stormwater run-on from the storage, maintenance, or fueling area and to protect stormwater from maintenance area run-off (i.e. berms, silt fence or fiber rolls.)
- Place drip pans or absorbent pads under vehicles or equipment to contain potential drips or leaks that may develop during storage, maintenance, or fueling.
- Have drip pans, absorbent pads, and spill kits located near or within the storage, maintenance or fueling area.
- Properly dispose of any used absorbent pads or any wastes collected in drip pans.
- Check ground under vehicles and equipment for evidence of leaks or drips.
- Clean up any leaks, spills, or contaminated surfaces immediately. Use absorbent pads to clean small spills and properly dispose of used pads.
- Make sure spill kit is adequately stocked and replace used supplies promptly.

- Check perimeter BMPs according to their specified inspection guidelines.

### VEHICLE/EQUIPMENT STORAGE

#### *Description*

If overnight storage of vehicles and equipment on-site is necessary, follow these procedures:

#### *Procedures*

- Inspect vehicles and equipment to be stored on-site for leaks. If leaks are found, either immediately repair the leak or contain the leak and repair as soon as possible.

### VEHICLE/EQUIPMENT MAINTENANCE

#### *Description*

If maintenance or washing of vehicles and equipment on-site is necessary, follow these procedures:

#### *Procedures*

- Store waste fluids in labeled, sealable, leak-proof containers. Check containers used to store waste fluids and other liquids used for maintenance to make sure they are sealed and free of leaks.
- Properly dispose of fuels, lubricants, and other materials used for maintenance in accordance with manufacturer's instructions and state, federal, and local regulations.
- Any maintenance materials stored on-site must be protected from exposure to precipitation. Use secondary containment designed to prevent spills or leaked chemicals from mixing with stormwater.
- Detergents, soaps and solvents are prohibited from use by the CGP for any equipment washing.
  - All wash water must be treated through an appropriate control measure (i.e. sediment basin or equivalent) prior to discharge to stormwater drainage systems or waters of the U.S.

- Check vehicles and equipment for excess buildup of oil and grease. Clean vehicle or equipment and properly dispose of excess oil and grease.

### VEHICLE/EQUIPMENT FUELING

#### *Description*

If fueling on-site is necessary, follow these procedures:

#### *Procedures*

- Fuel on a level grade area as far away from stormwater drainage systems and waters of the U.S., as practicable.
- Place drip pans or absorbent pads under vehicles or equipment to contain drips or leaks.
- Have drip pans, absorbent pads, and spill kits located nearby.
- During mobile fueling of equipment, properly protect the fueling hose from any damage.
- Fueling operations shall be attended at all times.
- Automatic shut-off nozzles are preferred. Do not “top off” fuel tanks. Leave adequate space for fuel expansion and movement in the tank while equipment is in operation.

## **BMP 52.00 & 53.00. Permanent Seeding and Soil Amendments**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Permanent Seeding is an erosion control measure intended to establish a perennial vegetation cover and provide full stabilization of a disturbed area. Protecting the soil with well-established perennial stands of grass, or other forms of vegetation, is one of the most effective methods of reducing erosion.

Soil amendments are commonly used in conjunction with Permanent Seeding to improve the soil. Application of the appropriate soil amendment(s) should reduce the potential for soil erosion and restore the health of the soil by improving soil structure. Amending the soil structure will improve the soil's water-holding capacity; and improve the infiltration rate and the ability to support vegetation.

#### *Description*

Permanent Seeding is applied to areas where construction has permanently ceased. The seed mix should be composed of several species and designed to establish a permanent perennial stand of vegetation that can survive in the area. Permanent Seeding should be accompanied by surface preparation, surface roughening, fertilizers, and mulch. Surface preparation and roughening enhance seed retention and germination, fertilizer boosts initial growth, and mulch retains moisture.

Soil amendments include topsoil, compost, shredded bark or wood chips, peat, biofertilizers, and mycorrhizae. Most soil amendments, except biofertilizers and mycorrhizae, should be tilled or blended into the soil.

#### *Other Names*

Permanent Seed Stabilization, Seeding with Soil Amendments, Compost Blanket with Seeding, Bonded Fiber Matrix with Seeding, Topsoil, and Seed.

#### *Applicability*

Permanent Seeding is a final stabilization measure that is generally required for all disturbed areas that are not otherwise stabilized (by paving, structures, landscaping, etc.). It should be completed in areas where ground disturbing activities have permanently ceased.

Seeding with soil amendments provides an additional control where the soil needs to be treated to support a stabilized vegetative mat. Soil amendments should be provided in areas where the soil is highly erodible and/or has poor nutrient content or structure. For example, a sandy soil needs organic matter added in order to increase the water and nutrient holding capacity.

#### *Selection Considerations*

- *Seed:* The designer should specify appropriate seed species based on the climatic and environmental conditions. The Alaska Department of Natural Resources (DNR) Plant Material Center manuals provide guidance for revegetation in Alaska, and include the *Revegetation Manual for Alaska, Interior Alaska Revegetation and Erosion Control Guide*, and the *Coastal Revegetation and Erosion Control Guide*. These manuals give recommended seeding species and planting dates. The dates to apply seed are dependent on the climatic conditions of the project location. These dates should be provided in the special provisions for each project.
- *Soil Amendments:* Soil amendments should be selected to increase the infiltration rate of water; improve the soil's fertility, texture, and structure; aid in the uptake of nutrients; help to stabilize the soil; aid in seed germination; increase microbial activity; and promote vegetation establishment.

When considering a soil amendment, the designer should consider how the amendment will improve the soil properties; such as the organic content and textural class, how long the amendment must remain in the soil, and the climate and ecology of the area

#### *Relationship to Other Erosion and Sediment Control Measures*

With or without soil amendments, seeding can be used alone but it is likely that other measures should be considered to protect and support seed establishment. Construction stormwater management control measures should be used up-gradient to prevent potential washouts. Sediment



control measures should be used to prevent the release of sediments to and from the treated area.

### *Design*

*Seed Selection and Application Rate:* Seed mix species should be carefully considered for each project. Several mixes may be applicable for a project depending on proximity to wetlands, roadways, and various microclimates in the general environment. The Alaska Plant Materials Center can assist with selecting species for all types of environments found in Alaska. Typically, seeds are applied at 20 - 40 lbs./acre, although site-specific conditions can affect how much seed needs to be applied. Add 30 percent to the quantity if surface roughening is required.

*Fertilizer and Application Rate:* Fertilizer should be used when establishing new seed. It is best to test the soils for existing nutrient content and pH to determine the appropriate fertilizer. If testing cannot be done until slopes are finished, then require a fertilizer application rate of 450 lb./acre of 20-20-10 (percent nitrogen-phosphorus-potassium) as an interim placeholder in the bid documents and the Engineer should adjust the fertilizer rate based on the test results.

*Mulch:* Mulch should be used when establishing new seed. Mulch helps to hold the seed to the soil surface and helps to retain moisture during seed germination. The application rate for mulching during seeding is approximately 2,000 to 4,500 lbs./acre, depending on the steepness of slopes. On slopes steeper than 3:1, tackifier should be added to the mulch (BMP 57).

*Soil Stabilizer.* For steeper slopes or more erodible soils, hydraulic erosion control products (HECP, BMP 51) can be considered for additional soil stabilization.

*Soil Testing:* This is recommended when there is uncertainty regarding the fertilizer application rate or when there are risk factors for successful grass growth. It is possible to require the contractor to sample soils, but it may be preferable to have trained Alaska Department of Transportation & Public Facilities (ADOT&PF) staff collect soil samples for laboratory analyses. If it is feasible to test the soils for their pH and nutrients, then the Project Engineer is able to change the fertilizer requirement according to the test results. The existing soil or imported

topsoil can be tested to identify the soil's composition of organic matter, macro nutrients, soil texture, and pH. For more information, contact the regional stormwater specialist. Add a special provision if you determine that the contractor should test the soil once graded.

*Soil Amendment Options:* There are many different soil amendments in addition to fertilizer that can be applied to a project. Selecting a soil amendment can depend on location of a project and availability of the amendment. These soil amendments include the following:

- *Topsoil:* When used as a soil amendment, topsoil should be tilled or blended into the existing soil.
- *Compost:* Compost should comply with the U.S. Composting Council Testing Methods and with specified gradation for each project. Compost can be applied to almost any soil. Compost can be used in wet climates or in the wet season, whereas topsoil or other soil amendments may be prone to erosion. When used as a soil amendment, compost should be tilled or blended into the existing soil.
- *Shredded Bark or Wood Chips:* Although the composition of bark or wood chip will vary per application, material should not contain any materials that would inhibit or stunt vegetation growth. All material should be kept moist prior to the application of seed. When used as a soil amendment, shredded bark or wood chips should be tilled or blended into the existing soil before seeding.
- *Peat:* Peat can be used as a soil amendment when the existing soil texture is sandy. Application of peat will enhance the existing soil by providing organics and increase the water holding capacity. Peat may be applied to the surface or tilled or blended into the soil. It should be applied at a thickness of 1 to 2 inches and, if specified, tilled or blended into the top 4 to 6 inches of the existing soil. When tilled or blended in, the peat composition should be approximately 15 to 25 percent of the soil.

Peat is naturally acidic. The existing soil should be tested for pH levels so the appropriate quantities of peat can be applied. Over-

application could result in limited growth of some seed species.

- Biofertilizers and Mycorrhizae: Biofertilizers and mycorrhizae are soil amendments that can be used to increase the success and shorten the establishment period of vegetation. When applied, biofertilizers and mycorrhizae help to rebuild living soil that has become damaged during earthwork. Biofertilizers and mycorrhizae help to increase microbial activity in soil resulting in increased nutrient availability to plant roots.

#### *Common Failures or Misuses*

Common failures are generally due to faulty application and maintenance. These failures include:

- Seed and slurry mix is not applied with a multi-directional flow or is applied at an inadequate application rate, resulting in non-uniform coverage or stabilization.
- The mulch, tackifier, or HECF (including bonded fiber matrix) used is inadequate to hold seed on slopes, resulting in erosion and washouts.
- Temporary seed, if not appropriately removed, may inhibit growth of permanent grass.
- Seed is not properly or adequately irrigated.
- Seed is floated away due to over-irrigation or by excessive rainfall.
- Seeded areas are disturbed by foot traffic and/or equipment after installation.
- Treated areas are compacted after the seed and amendments are applied.
- Soil amendments are inadequate to support seed growth.
- Supportive Construction Water Management or Sediment Control best management practices (BMPs) are not installed or maintained correctly.
- Fertilizer application is inadequate.
- Fertilizers with high, or quick-release, phosphorus content are used with biofertilizer and mycorrhizal soil amendments.

- Fungicides are used on or around areas that have received biofertilizers and mycorrhizal amendments.
- Inadequate quantities of amendments containing biofertilizers and mycorrhizae are applied.
- Seeding is applied too late in the season, resulting in limited growth and germination prior to freeze up.

#### SPECIFICATIONS

##### Standard Specifications

- 652 - Soil Amendments
- 650 - Compost Blanket
- 651 - Hydraulic Erosion Control Products
- 620 - Topsoil
- 712.201 - Water
- 724 - Seed
- 725 - Fertilizer
- 752 – Tackifier
- 750 – Compost
- 753 – Soil Amendments
- 751 Hydraulic Erosion Control Products

## **BMP 54.00. Site Delineation**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Site delineation measures are intended to mark (1) all areas where land disturbing activities will occur, including clearing and grading, and (2) specific areas that will be left undisturbed, such as trees, boundaries of sensitive areas, or environmental buffer zones, prior to work beginning. Buffer zones may include those at stream crossings and around the edges of any wetlands or waters of the U.S. that are located within or immediately adjacent to the property where the construction activity will take place.

This measure is intended to comply with the requirements of Alaska Construction General Permit.

#### *Description*

Site delineation measures may be physical barriers, such as temporary fencing, or visual indications, such as staking and flagging, used to delineate specific areas. They are intended to remain until construction activity is completed. The most common measures include temporary fencing, survey flagging tape, stakes, paint on asphalt or concrete, and signs.

#### *Other Names*

Flagging, temporary fencing, high-visibility fencing, staking, signs, paint markings.

#### *Applicability*

Site delineation applies to all construction projects involving land disturbing activities.

#### *Selection Considerations*

Choose marking materials that have high visibility and contrast with the natural surroundings. Select materials based on ability to last for the duration of construction. This is especially important for construction that will span multiple seasons, or last several years.

Sensitive areas and their buffers may require more substantial protection, such as work zone safety fences. Silt fence, in combination with survey flagging, can be an acceptable method of marking sensitive areas and buffers. However, silt fencing

should only be used for this purpose if it is also needed for, and properly installed and maintained as, a sediment control measure.

If fencing other than orange fencing is used, provide signage with wording describing the purpose of the fence.

If signs are to be used, specify the type and spacing of signs and the wording on the sign, such as 'No Entry,' 'Keep Out,' 'No Grade Change', 'No Work, Storage Of Materials or Equipment Permitted Beyond This Point,' or other appropriate directive. Specify minimum lettering size for signs.

For long linear projects that are constructed in phases, consider the following:

- Provide delineation to protect adjacent out-of-phase areas that are not part of the current phase of construction.
- Specify installation of site delineation to coincide with phases of construction so that the length of time the site delineation must be inspected and maintained is sufficient but no longer (too far in advance) than necessary.

#### *Common Failures or Misuses*

- Failure to install prior to land disturbing activities.
- Inappropriately using materials intended for other purposes. For example, silt fencing material should not be used unless it is properly installed as a sediment control measure (BMP-20).
- Installing markers too close to areas of construction activity; failure to provide adequate maneuvering room for construction activities.
- Damage to markings and flagging cut down during clearing activities.
- Using products that are easily vandalized by humans or disturbed by animals.

SPECIFICATIONS

Standard Specification

655 – Site Delineation

## **BMP 55.00. Street Sweeping and Vacuuming for Sediment Control**

---

### DESIGN CONSIDERATIONS

#### *Objectives*

Street Sweeping and Vacuuming for Sediment Control is used to remove sediment from paved surfaces to prevent it from entering storm drain systems or waters of the U.S.

#### *Description*

Sediment is removed from roads and paved surfaces by power sweepers or manual methods and disposed of in a controlled sediment disposal area.

#### *Applicability*

Sweeping is implemented anywhere sediment is tracked from the project area onto public or private paved roads and other paved surfaces. Street Sweeping and Vacuuming for Sediment Control should be conducted when sediment accumulation is visible on paved surfaces. Typically, this will be concentrated at the exit to the construction site

#### *Selection Considerations*

- Sweepers that pick up sediment and control dust emissions should be specified. Of the four types of mechanical power sweepers available, three (vacuum, regenerative air, and high efficiency sweepers) are acceptable. Prohibit the use of methods that use only mechanical kick brooms. Conventional mechanical broom sweepers have been found to have a negative effect on the amount of stormwater runoff pollution. Mechanical sweepers may only be used if followed by a vacuum-assisted sweeper.
- Manual broom sweeping with pickup is acceptable. On smaller construction sites and in areas not accessible by power sweepers, sweeping can be conducted manually using a broom and shovel.
- The use of leaf blowers and other similar equipment for sweeping is unacceptable.
- Reasonable measures must be employed to prevent dust from becoming airborne during any operation where material that may create dust is handled, transported, or stored.

- If the sediment or soil is wet or muddy, paved surfaces will need to be scraped manually or mechanically.

#### *Relationship to Other Erosion and Sediment Control Measures*

Erosion and sediment control measures in the contributing areas must be in place to minimize the amount of sediment that must be swept. Stabilized Construction Exit (BMP-23 and BMP-24) or Tire Wash (BMP-36 and BMP-37) should be included in the contract. Street Sweeping and Vacuuming for Sediment Control is a secondary measure to remove residual sediment that was not removed by other measures. Well-maintained stabilized construction exits, vehicle tracking controls, and tire wash facilities can help reduce the necessary frequency of Street Sweeping and Vacuuming for Sediment Control.

#### *Common Failures or Misuses*

- Insufficient erosion controls in the contributing disturbed area.

### SPECIFICATIONS

#### Standard Specifications

- 656 Street Sweeping and Vacuuming for Sediment Control

# BMP 57.00. Temporary Seeding

---

## DESIGN CONSIDERATIONS

### *Objectives*

Temporary Seeding is intended to temporarily stabilize the soil of a disturbed area to prevent the erosion and the discharge of soil and/or sediments.

Temporary Seeding is used in areas where permanent cover is not necessary or appropriate. By protecting bare soil from raindrop impact and binding the soil with roots, a well-established vegetative cover is one of the most effective methods of reducing erosion.

### *Other Names*

Temporary Stabilization.

### *Applicability*

Temporary Seeding is applicable to exposed areas subject to erosion that are not actively being worked. Temporary Seeding can be used where permanent covering is not necessary or where future ground disturbing activities will occur.

By itself, Temporary Seeding is not soil stabilization because the seeds are not effective until they sprout and create a stabilizing root mat. Temporary Seeding should be accompanied by surface preparation, surface roughening, fertilizer, mulch, and maintenance to encourage seed establishment. Temporary Seeding can remain and be left to winter over only if ground-disturbing activities are scheduled to resume the following spring. Prior to application of permanent stabilization measures, Temporary Seeding should be removed from, or plowed/tilled into, the existing soil

### *Selection Considerations*

- Consider application rate, regional climate, environment, and duration of required vegetation coverage prior to application. Temporary Seeding is intended to be used for a maximum of one growing season.
- Temporary Seeding should be applied soon after ground-disturbing activities cease in the area and in compliance with highway Section 641 (airport Section P-157). The use of fertilizers is advised to promote rapid and healthy seed growth. Fertilizer should be applied at the application

rate specified by the manufacturer or per the recommendations from a soil analysis

### *Design*

*Seed Selection:* Annual Ryegrass (*Lolium multiflorum*) should be used for short periods lasting no more than one growing season.

*Seed Application Rate:* Typical rate of 20 lbs/acre (per Plant Material Center recommendation), although the rate may be varied based on site-specific conditions.

*Fertilizer Application Rate:* Typical rate of 200 lbs/acre of 20-20-10 (percent nitrogen-phosphorus-potassium) fertilizer (per Plant Material Center recommendation).

*Other Soil Amendments:* In certain cases, in addition to fertilizer, specifying compost or topsoil may enhance vegetative growth. However, note that in some cases a layer of topsoil on gravel surfaces can increase erosion potential.

*Soil Stabilization Methods:* Hydraulic erosion control products (HECPs), including bonded fiber matrix, mulch, and tackifiers; and rolled erosion control products (RECPs) for slopes should be considered on a site-specific basis in conjunction with Temporary Seeding to decrease soil erosion potential

### *Relationship to Other Erosion and Sediment Control Measures*

Seeding should be performed in conjunction with surface roughening, soil stabilization methods, and grading practices. Concentrated flows or runoff should be directed away from the seeded areas using diversions.

### *Common Failures or Misuses*

Common failures are generally due to faulty installation and maintenance. These failures include:

- Ground or growth medium is insufficient to support seed.
- Seed is not applied at an adequate application rate.

- Mulch or HECP used is inadequate to hold seed on slopes.
- Seed is not applied uniformly and/or adequate ground coverage is not achieved.
- Seed is not properly or adequately irrigated.
- Seeded areas are disturbed by foot traffic and/or equipment after installation.
- Seeding is applied too close to freeze-up

### SPECIFICATIONS

#### Standard Specifications

- 658 – Temporary Seeding
- 620 – Topsoil
- 657 – Tackifier
- 650 – Compost Blanket
- 653 – Permanent Seeding
- 652 – Soil Amendments
- 753 – Soil Amendments
- 725 – Fertilizer
- 651– Hydraulic Erosion Control Products
- 751—Hydraulic Erosion Control Products
- 654– Rolled Erosion Control Products for Slopes
- 754-- Rolled Erosion Control Products

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX C – PROJECT SCHEDULE



## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX D – SUPPORTING DOCUMENTATION:

- TMDL
- ENDANGERED SPECIES
- OTHER PERMITS

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

# APPENDIX E – DELEGATION OF AUTHORITY, SUBCONTRACTOR CERTIFICATIONS

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP DELEGATION OF SIGNATURE AUTHORITY  
FOR CGP DOCUMENTS**

Project Name: Main Street Sidewalk Improvement

I, Janette Keiser hereby designate the Contractor's Superintendent assigned to Main Street Sidewalk Improvement to be the City's duly authorized representative for the purpose of overseeing compliance with environmental requirements, including the APDES Construction General Permit, at the construction site. The Contractor's Superintendent is authorized to sign all documents related to the storm water pollution prevention plan, reports, and additional documents required by the permit. By signing this authorization, I confirm that I meet the requirements to make such a designation as set forth in Appendix A, Subsection 1.12.2 of ADEC's Construction General Permit (CGP), and that the designee above meets the definition of a "duly authorized representative" as set forth in Appendix A, Subsection 1.12.3.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name: Janette Keiser

Title: Director

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP CERTIFICATION FOR CONTRACTOR**

Project Name: Main Street Sidewalk Improvement

Operator:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name: \_\_\_\_\_

Duly Authorized Representative in accordance with Appendix A, Part 1.12 APDES  
General Permit for Discharges From Large and Small Construction Activities

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Signature: \_\_\_\_\_

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP DELEGATION OF SIGNATURE AUTHORITY  
FOR CGP DOCUMENTS -- CONTRACTOR**

Project Name: **Main Street Sidewalk Improvement**

I, (Contractor's responsible corporate officer) hereby designate the project superintendant assigned to Main Street Sidewalk Improvement to be (Contractor's company name)'s duly authorized representative for the purpose of overseeing compliance with the APDES Construction General Permit, at the Main Street Sidewalk Improvement construction site. By signing this authorization, I confirm that I meet the requirements to make such a designation as set forth in Appendix A, Subsection 1.12.2 of ADEC's Construction General Permit (CGP), and that the designee above meets the definition of a "duly authorized representative" as set forth in Appendix A, Subsection 1.12.3.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

Signature \_\_\_\_\_

Date \_\_\_\_\_

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP SUBCONTRACTOR CERTIFICATION**

Project Name:	Main Street Sidewalk Improvement
Project Number:	
Project Location:	Main Street, Pioneer Avenue to Dehel Avenue, Homer, AK
Operator(s):	

As a subcontractor, you are required to comply with the Construction General Permit (CGP) and the conditions of the Stormwater Pollution Prevention Plan (SWPPP), for any work that you perform on-site. Any person or group who violates any condition of the SWPPP may be subject to substantial penalties or loss of contract. You are encouraged to advise each of your employees working on this project of the requirements of the SWPPP. A copy of the SWPPP is available for your review at the site or other location easily accessible during normal business hours CGP 5.10.3.1.

Each subcontractor engaged in activities at the construction site that could impact stormwater must be identified and sign the following certification statement:

**I certify under the penalty of law that I have read and understand the terms and conditions of the SWPPP for the above designated project and agree to follow the BMPs and practices described in the SWPPP.**

This certification is hereby signed in reference to the above named project:

Company: \_\_\_\_\_  
Address: \_\_\_\_\_ Telephone Number: \_\_\_\_\_  
\_\_\_\_\_

Type of Construction Service Provided:

Printed Name: \_\_\_\_\_  
Title: \_\_\_\_\_  
Signature: \_\_\_\_\_  
Date: \_\_\_\_\_

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX F – PERMIT CONDITIONS:

- COPY OF SIGNED NOTICE OF INTENT
- COPY OF LETTER FROM ADEC AUTHORIZING COVERAGE
- ADEC NOI TRACKING NUMBER
- NOTICE OF TERMINATION
- COPY OF ALASKA CONSTRUCTION GENERAL PERMIT



**ALASKA POLLUTANT DISCHARGE ELIMINATION SYSTEM  
GENERAL PERMIT FOR DISCHARGES FROM LARGE AND  
SMALL CONSTRUCTION ACTIVITIES  
(Construction General Permit) – Final**

Permit Number: **AKR100000**

DEPARTMENT OF ENVIRONMENTAL CONSERVATION  
Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, AK 99501

In compliance with the provisions of the Clean Water Act (CWA), 33 U.S.C. §1251 et. seq., as amended by the Water Quality Act of 1987, P.L. 100-4, this permit is issued under provisions of Alaska Statutes 46.03, the Alaska Administrative Code (AAC) as amended, and other applicable State laws and regulations.

Operators of large and small construction activities described in Part 1.4 of this Alaska Pollutant Discharge Elimination System (APDES) general permit, except for those activities excluded from authorization to discharge in Part 1.4.4 of this permit, are authorized to discharge storm water associated with construction activity to waters of the U.S., in accordance with the conditions and requirements set forth herein. Permit authorization is required from the “commencement of construction activities” until “final stabilization” as defined in Appendix C.

This permit shall become effective on 2/1/2021.

This permit and the authorization to discharge shall expire at midnight, 1/31/2026.

Signature

Gene McCabe

December 17, 2020

Date

Program Manager



## TABLE OF CONTENTS

<b>1.0</b>	<b>COVERAGE UNDER THIS PERMIT.....</b>	<b>9</b>
1.1	Introduction.....	9
1.2	Person(s) Responsible for Obtaining Authorization under this Permit .....	9
1.3	Permit Area .....	10
1.4	Eligibility .....	10
	• <i>Allowable Storm Water Discharges.....</i>	<i>10</i>
	• <i>Authorized Non-Storm Water Discharges .....</i>	<i>11</i>
	• <i>Limitations on Coverage.....</i>	<i>11</i>
	• <i>Emergency Repairs or Reconstruction of a Facility.....</i>	<i>12</i>
1.5	Waivers for Certain Small Construction Activities .....	12
<b>2.0</b>	<b>AUTHORIZATION UNDER THIS GENERAL PERMIT .....</b>	<b>13</b>
2.1	Submittal Requirements Prior to Construction .....	13
2.2	How to Obtain Authorization.....	16
2.3	How to Submit an Notice of Intent (NOI) .....	17
2.4	Submission Deadlines.....	17
	• <i>New Projects .....</i>	<i>17</i>
	• <i>Permitted Ongoing Projects .....</i>	<i>17</i>
	• <i>Change of Permittee for a Permitted Ongoing Project .....</i>	<i>18</i>
	• <i>Unpermitted Ongoing Project.....</i>	<i>18</i>
2.5	Date of Authorization to Begin Discharge.....	18
2.6	Continuation of Expired General Permit .....	18
2.7	Submittal of a Modification to Original NOI .....	19
2.8	Alternative Permits .....	19
	• <i>DEC Requiring Authorization under an Alternative Permit .....</i>	<i>19</i>
	• <i>Operator Requesting Authorization under an Alternative Permit.....</i>	<i>20</i>
<b>3.0</b>	<b>COMPLIANCE WITH STANDARDS AND LIMITS.....</b>	<b>20</b>
3.1	Requirements for all Projects.....	20
3.2	Discharge to Impaired Water Body .....	20
	• <i>Discharging into a Receiving Water Body with an Approved or Established TMDL     (Category 4a or 4b) (e.g., Turbidity or Sediment).....</i>	<i>21</i>
3.3	Protection of Endangered Species .....	22
<b>4.0</b>	<b>CONTROL MEASURES .....</b>	<b>22</b>
4.1	Control Measure Selection and Design Considerations.....	22
4.2	Erosion Control Measures.....	24
	• <i>Delineation of Site.....</i>	<i>24</i>
	• <i>Minimize the Amount of Soil Exposed during Construction Activity.....</i>	<i>24</i>
	• <i>Maintain Natural Buffer Areas .....</i>	<i>24</i>
	• <i>Clearing Vegetation.....</i>	<i>24</i>
	• <i>Control Storm Water Discharges and Flow Rates .....</i>	<i>25</i>
	• <i>Protect Steep Slopes.....</i>	<i>25</i>
4.3	Sediment Control Measures.....	25
	• <i>Storm Water Inlet Protection Measures .....</i>	<i>26</i>

- *Water Body Protection Measures* ..... 26
- *Down-Slope Sediment Controls* ..... 26
- *Stabilized Construction Vehicle Access and Exit Points* ..... 26
- *Vehicle Trackout* ..... 26
- *Dust Generation*..... 26
- *Stockpile Management*..... 26
- *Authorized Non-Storm Water Discharges* ..... 26
- *Sediment Basins* ..... 26

4.4 Dewatering ..... 27

4.5 Soil Stabilization ..... 28

- *Minimum Requirements for Soil Stabilization* ..... 28
  - *Deadline to Initiate Stabilization* .....28
  - *Deadline to Complete Temporary Stabilization Activities*.....29
  - *Exceptions to the Deadlines for Initiating and Completing Stabilization*.....29
  - *Deadline to Complete Final Stabilization*.....30
- *Stabilization Requirements for Terminating Permit Authorization* ..... 30

4.6 Treatment Chemicals ..... 30

4.7 Prohibited Discharge..... 32

4.8 Good Housekeeping Measures ..... 32

- *Washing of Equipment and Vehicles and Wheel Wash-Down*..... 32
- *Fueling and Maintenance Areas*..... 32
- *Staging and Material Storage Areas*..... 33
- *Washout of Applicators/Containers used for Paint, Concrete, and Other Materials*..... 33
- *Fertilizer or Pesticide Use*..... 33
- *Storage, Handling, and Disposal of Construction Waste* ..... 33

4.9 Spill Notification..... 34

4.10 Projects near a Public Water System (PWS) ..... 34

4.11 Permanent Storm Water Management Control..... 34

4.12 Winter Considerations ..... 35

- *Winter Shutdown*..... 35
- *Winter Construction*..... 35

4.13 Maintenance of Control Measures ..... 35

4.14 Storm Water Lead and Training of Employees ..... 36

4.15 Applicable Federal, State, Tribal, or Local Requirements..... 36

**5.0 STORM WATER POLLUTION PREVENTION PLAN ..... 36**

5.1 Storm Water Pollution Prevention Plan (SWPPP)..... 36

5.2 Deadlines for SWPPP Preparation..... 36

5.3 SWPPP Contents..... 36

- *Permittee* ..... 37
- *Storm Water Contact(s)* ..... 37
- *Project Site-Specific Conditions* ..... 37
- *Nature of Construction Activity* ..... 37
- *Site Map(s)*..... 37
- *Control Measures*..... 38
- *Construction and Waste Materials* ..... 39
- *Locations of Other Industrial Storm Water Discharges*..... 39

- *Non-Storm Water Discharges*..... 39
- 5.4 Inspections ..... 39
- 5.5 Monitoring Plan (if applicable)..... 40
- 5.6 Documentation of Permit Eligibility Related to a Total Maximum Daily Load ..... 40
- 5.7 Documentation of Permit Eligibility Related to Endangered Species ..... 40
- 5.8 Post-Authorization Records ..... 41
  - *Copy of Permit Requirements* ..... 41
  - *Additional Documentation Requirements* ..... 41
- 5.9 Maintaining an Updated SWPPP ..... 41
  - *SWPPP Modifications*..... 41
  - *SWPPP Amendment Log*..... 42
  - *Deadlines for SWPPP Modifications*..... 42
- 5.10 Additional SWPPP Requirements..... 42
  - *Retention of the SWPPP*..... 42
  - *Main Entrance Signage*..... 42
  - *Availability of SWPPP* ..... 42
  - *Signature and Certification*..... 43
- 5.11 Requirements for Different Types of Operators ..... 43
- 6.0 INSPECTIONS ..... 44**
- 6.1 Inspection Frequency ..... 44
- 6.2 Case-by-Case Reductions in Inspection Frequency ..... 44
- 6.3 Qualified Person..... 45
- 6.4 Site Inspection..... 45
  - *Location of Inspections* ..... 45
  - *Scope of Inspection* ..... 45
- 6.5 Linear Project Inspections..... 46
- 6.6 Inspections by DEC or Applicable Government Authority..... 46
- 6.7 Inspection Report ..... 46
- 7.0 MONITORING ..... 47**
- 7.1 General Requirements..... 47
- 7.2 Qualified Person..... 47
- 7.3 Discharge Monitoring Requirements ..... 47
  - *Sampling Parameter* ..... 47
  - *Sampling Frequency* ..... 47
  - *Sampling Locations*..... 48
  - *Representative Discharge Point for a Linear Project* ..... 48
  - *Commingled Discharges*..... 48
  - *Sample Type*..... 48
  - *Sampling and Analysis Methods* ..... 48
  - *Rainfall Monitoring* ..... 49
  - *Recording Monitoring Data*..... 49
  - *Reporting Monitoring Results*..... 49
- 7.4 Visual Monitoring for a Linear Project..... 49
  - *Visual Monitoring Frequency*..... 49
  - *Visual Monitoring Locations* ..... 50

- *Visual Monitoring Parameters* ..... 50
- *Recording Visual Monitoring Data* ..... 50

**8.0 CORRECTIVE ACTIONS** ..... **50**

- 8.1 Corrective Action Conditions ..... 50
- 8.2 Deadlines for Corrective Actions..... 51
- 8.3 Corrective Action Log ..... 51
- 8.4 Corrective Action Report..... 51
- 8.5 Substantially Identical Outfalls..... 52

**9.0 REPORTING AND RECORDKEEPING**..... **52**

- 9.1 Annual Report..... 52
- 9.2 Corrective Action Report..... 52
- 9.3 Spill of Hazardous Substances Report..... 52
- 9.4 Retention of Records..... 53
- 9.5 Request for Submittal of Records..... 53

**10.0 TERMINATION OF PERMIT AUTHORIZATION** ..... **53**

- 10.1 Submitting a Notice of Termination (NOT) ..... 53
- 10.2 When to Submit a Notice of Termination..... 53
- 10.3 Submitting a Notice of Termination ..... 54

**11.0 PERMIT REOPENER CLAUSE** ..... **54**

- 11.1 Procedures for Modification or Revocation..... 54
- 11.2 Water Quality Protection ..... 54
- 11.3 Timing of Permit Modification..... 55

**Appendix A Standard Permit Conditions**

**Appendix B Acronyms**

**Appendix C Definitions**

**Appendix D Small Construction Waivers and Instructions**

**Appendix E Forms**

- Notice of Intent (NOI)
- Notice of Termination (NOT)
- Notice of Intent Modification
- Low Erosivity Waiver
- Annual Report

**TABLES**

Table 1: Schedule of Submissions ..... 6

Table 2: Summary of Permit Required On-Site Documentation ..... 8

Table 3: SWPPP Submittal within Municipality of Anchorage MS4 area. .... 15

Table 4: Recommended Experience or Required Training for Specific Roles..... C-13

## SCHEDULE OF SUBMISSIONS

The Schedule of Submissions (Table 1) summarizes the required submissions and activities the permittee must complete and/or submit to the Alaska Department of Environmental Conservation (DEC or the Department) during the terms of this permit. The operator is responsible for all submissions and activities even if they are not summarized below.

Table 1: Schedule of Submissions

Permit Part	Type of Project	Submittal Requirement	Frequency	Due Date	Submit to <sup>1</sup>
<b>Prior to Construction</b>					
1.4.4.7, 2.1.1, 2.1.2, and 4.11	Projects that will construct Permanent Storm Water Management Controls	Engineering Plans	Once	At least 30 calendar days before the start of construction or as required by the MS4 Operator	Permitting Program or MS4 Operator
1.5	Small construction activities that use a waiver in lieu of CGP authorization	Waiver Certification	Once	At least five business days before proposed start of construction	Permitting Program
2.1.3	Projects that disturb greater than or equal to 5 acres of land and are outside an MS4 area	SWPPP <sup>2</sup>	Once	With NOI	Permitting Program
2.1.4	Projects inside an MS4 area	SWPPP	Once	Depends on requirements of MS4 operator	MS4 Operator
2.1.5 and 4.6.7	Project that use Cationic Treatment Chemicals	Engineering Plans and Project Details	Once	At least 14 calendar days before use of the system	Permitting Program
2.1.6	Projects that discharge to an Outstanding Natural Resource Water	Site-Specific Antidegradation Analysis	Once	At least 14 calendar days before filing NOI	Permitting Program
2.3	Projects that disturb greater than or equal to 1 acre of land	Notice of Intent	Once	At least five business days before the start of construction	Permitting Program

Table 1: Schedule of Submissions

Permit Part	Type of Project	Submittal Requirement	Frequency	Due Date	Submit to <sup>1</sup>
<b>During Construction</b>					
2.4.2 2.6	For an authorized permittee if the permittee intends to continue operations and discharges beyond the term of this permit	Submit a complete and accurate new NOI according to Part 2.3	Once	Within 90 calendar days of the effective date of this permit	Permitting Program
2.7	To update or correct information on the original NOI	NOI Modification	As needed	As needed	Permitting Program
3.2, 8.4, and 9.2	If the difference between upstream and downstream samples exceed WQS for turbidity	Corrective Action Report	As necessary	At least 14 calendar days after receiving monitoring results	Compliance Program
9.1	Projects that disturb greater than or equal to 20 acres of land	Annual Report	As needed for sites meeting Part 3.2	By December 31st or with NOT	Compliance Program
9.5	All projects with an active NOI	Request for Submittal of Records	As requested by DEC	At least 30 calendar days after receipt of request	As requested by DEC
<b>Post Construction</b>					
10.2	All projects with an active NOI	Notice of Termination (NOT)	Once	Within 30 calendar days of completion of the project	Permitting Program
<p>Note:</p> <p>1 See Appendix A, Part 1.1 for Permitting and Compliance Program contact information and addresses</p> <p>2 All projects that require an NOI must prepare a SWPPP. However, only operators who are developing projects that disturb greater than or equal to five (5) acres of land and are outside an MS4 area are required to submit a SWPPP to DEC.</p>					

## REQUIRED ON-SITE DOCUMENTATION

The Summary of Required On-Site Documentation (Table 2) lists the documents the permittee must have available at the project site or the project management office. The permittee is responsible for all documentation even if they are not summarized below.

Table 2: Summary of Permit Required On-Site Documentation

Permit Part	Document	Frequency	Purpose of Document
2.3	NOI	Once at start of project	Applicant request for authorization to discharge under permit coverage
2.5	DEC NOI Reply Letter	Once at start of project	To provide permittee with DEC project tracking number indicating project is covered by CGP
2.7	NOI Modification	As needed	To modify the original NOI if project conditions, personnel, or SWPPP location change
5.0	SWPPP	Developed prior to submitting the NOI. Updated as necessary.	To describe the project and the control measures to minimize the discharge of pollutants into waters of the U.S.
5.4; 6.7	Inspection Reports	Conducted at frequency specified in SWPPP	To monitor compliance with SWPPP and CGP
5.5; 7.0	Monitoring Plan (if required)	As needed	To describe monitoring of storm water discharge for those projects that disturb more than threshold requirement
5.6	Permit Eligibility related to Total Maximum Daily Load (TMDL)	Once at start of project	To document compliance with TMDL requirements
5.7	Permit Eligibility related to Endangered Species Act (ESA)	Once at start of project	To document compliance with ESA requirements
5.8.1	Copy of this permit	Once at start of project	To include in SWPPP
5.8.2	Additional Documentation in the SWPPP	Updated as necessary	To maintain summaries of various specific activities at the site to document they were accomplished.
8.3	Corrective Action Log (if necessary)	Updated as necessary	To list the corrective actions taken at a site
8.4; 9.2	Corrective Action Report (if necessary)	As needed	To report exceeding the turbidity requirement and describe
9.1	Annual Report (if required)	Annually or at NOT	To report result of discharge monitoring
9.4	Records	As needed	To maintain project records
10.2	NOT	Once at completion of project	To notify DEC that the permittee is terminating permit coverage

## 1.0 COVERAGE UNDER THIS PERMIT

### 1.1 Introduction

The Alaska Construction General Permit (CGP) authorizes storm water discharges from large and small construction-related activities that result in a total land disturbance of equal to or greater than one acre and where those discharges enter waters of the U.S. (directly or through a storm water conveyance system) or a municipal separate storm sewer system (MS4) leading to waters of the U.S. subject to the conditions set forth in this permit. This permit also authorizes storm water discharges from certain construction support activities and some non-storm water discharges commonly associated with construction sites.

The goal of this permit is to minimize erosion and reduce or eliminate the discharge of pollutants, such as sediment carried in storm water runoff from construction sites through implementation of appropriate control measures. Polluted storm water runoff can adversely affect fish, animals, plants, and humans. In order to ensure protection of water quality and human health, this permit describes control measures that must be used to manage storm water runoff during construction activities. This permit replaces the CGP that became effective February 1, 2016 and expired on January 31, 2021.

### 1.2 Person(s) Responsible for Obtaining Authorization under this Permit

1.2.1 All operators of large or small construction activities that meet the conditions in Part 1.4 must obtain authorization under this permit. For the purposes of this permit, an “operator” is any party associated with a construction project that meets either of the following two criteria:

- 1.2.1.1 The party has operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications, or
- 1.2.1.2 The party has day-to-day operational control of those activities at a project that are necessary to ensure compliance with the permit conditions (e.g., they are authorized to direct workers at a site to carry out activities required by the permit)

*Note: Subcontractors generally are not considered operators for the purposes of this permit.*

*Note: Where there are multiple operators associated with the same project, all operators are required to obtain permit authorization. The following applies in these situations:*

- *If one operator has control over plans and specifications and a different operator has control over activities at the project site, they may divide responsibility for compliance with the terms of this permit as long as they develop a group storm water pollution prevention plan (SWPPP) (see Part 5.1), which documents which operator has responsibility for each requirement of the permit.*
- *If an operator only has operational control over a portion of a larger project (e.g., one of four homebuilders in a subdivision), the operator is responsible for compliance with all applicable effluent limits, terms, and conditions of this permit as it relates to the activities on their portion of the construction site, including protection of endangered species, critical habitat, and historic properties, and implementation of control measures described in the SWPPP in the areas under their control.*
- *An operator must ensure either directly or through coordination with other permittees, that their activities do not render another permittee’s pollutant discharge controls ineffective.*



### 1.3 Permit Area

This general permit covers the State of Alaska, except lands within the Metlakatla Indian Reservation and the Denali National Park and Preserve.

### 1.4 Eligibility

- 1.4.1 **Eligibility Requirements.** To be authorized under this permit, the project must meet the following conditions or be notified by DEC that the site is eligible for permit coverage.
- 1.4.1.1 The project will disturb one or more acres of land, or will disturb less than one acre of land but is part of a common plan of development or sale that will ultimately disturb one or more acres of land;
  - 1.4.1.2 The site will discharge storm water to waters of the U.S. (directly or through a storm water conveyance system) or a MS4 leading to a waters of the U.S.;
  - 1.4.1.3 The project area is located in an area where DEC is the permitting authority;
  - 1.4.1.4 The project is not already covered under a different APDES permit;
  - 1.4.1.5 The project does not discharge to an impaired waterway with an EPA-approved or established Total Maximum Daily Load (TMDL) that specifically precludes such discharges; and
  - 1.4.1.6 The project is not likely to jeopardize the continued existence or cause a take of any threatened or endangered species protected under the Endangered Species Act (ESA) or their designated critical habitat.
- 1.4.2 **Authorized Storm Water Discharges.** Subject to compliance with the terms and conditions of this permit, the following discharges are authorized under this permit:
- 1.4.2.1 Storm water discharges associated with large and small construction activities, including those that are part of a common plan of development or sale that will ultimately disturb one or more acres of land.
  - 1.4.2.2 Storm water discharges designated by DEC as needing a storm water permit under 40 CFR §122.26(a)(1)(v) or §122.26(b)(15)(ii).
  - 1.4.2.3 Storm water discharges from support activities (such as concrete or asphalt batch plants, equipment staging yards, material storage areas, excavated material disposal areas, borrow areas) (as defined in Appendix C), whether on-site, adjacent to, or off-site, provided:
    - 1.4.2.3.1 The support activity is directly related to the construction site required to have permit authorization for discharges of storm water associated with construction activity under this permit;
    - 1.4.2.3.2 The support activity is not a commercial operation serving multiple unrelated construction projects by different permittees;
    - 1.4.2.3.3 The support activity does not operate beyond the completion of the construction activity at the project it supports; and
    - 1.4.2.3.4 Appropriate control measures are identified in the Storm Water Pollution Prevention Plan (SWPPP) and pollutant discharges are minimized in compliance with Parts 3.0 and 4.0 of the permit.
  - 1.4.2.4 Discharges composed of allowable discharges listed in Parts 1.4.2 and 1.4.3 commingled with a discharge authorized by a different APDES permit and/or a discharge that does not require APDES permit authorization.

**1.4.3 Authorized Non-Storm Water Discharges.** Subject to compliance with the terms and conditions of this permit, the following non-storm water discharges are authorized under this general permit, provided the non-storm water component of that the discharge is in compliance with the SWPPP requirements in Part 5.3.9:

- 1.4.3.1 Discharges from fire-fighting activities;
- 1.4.3.2 Fire hydrant flushings;
- 1.4.3.3 Waters used to wash vehicles where detergents are not used;
- 1.4.3.4 Water used to control dust;
- 1.4.3.5 Potable water including uncontaminated water line flushings;
- 1.4.3.6 Routine external building wash down where detergents are not used;
- 1.4.3.7 Pavement wash waters where spills or leaks of toxic or hazardous materials have not occurred (unless all spilled material has been removed) and where detergents are not used;
- 1.4.3.8 Uncontaminated air conditioning or compressor condensate;
- 1.4.3.9 Uncontaminated, non-turbid discharges of ground water or spring water;
- 1.4.3.10 Foundation or footing drains where flows are not contaminated with process materials such as solvents or contaminated groundwater;
- 1.4.3.11 Uncontaminated construction dewatering waters that are treated by an appropriate control measure in compliance with Part 4.4.2, or have been treated with treatment chemicals in compliance with Part 4.6; and
- 1.4.3.12 Landscape irrigation.

**1.4.4 Limitations on Coverage.** The following discharges are not authorized under this permit:

- 1.4.4.1 **Post-Construction Discharges.** Discharges that originate from the project after construction activities have ceased and a Notice of Termination (NOT) has been submitted in accordance to Part 10.0, including any temporary support activity.
- 1.4.4.2 **Discharges that May Exceed Water Quality Standards.** Discharges that DEC, prior to authorization under this permit, determines will cause, have the reasonable potential to cause, or contribute to an excursion above any applicable water quality standard (WQS). Where such a determination is made prior to authorization, DEC may notify the applicant that an individual permit application is necessary in accordance with Part 2.8. However, DEC may provide permit authorization after the applicant has included appropriate controls and implementation procedures designed to bring the discharge into compliance with WQS's in accordance with Part 3.1.
- 1.4.4.3 **Discharges to Water Quality Impaired Waters.** Discharges into receiving waters that are listed as impaired waters in the report *Alaska's Final 2018 Integrated Water Quality Monitoring and Assessment Report*, dated March 26, 2020 (or the most current EPA-approved version), or with an approved or established TMDL analysis, unless the discharges are in accordance with Part 3.2.
- 1.4.4.4 **Comingled Discharges.** Discharges that are mixed with non-storm water, unless they are listed as allowable non-storm water discharges in Part 1.4.3.
- 1.4.4.5 **Discharges Currently or Previously Covered by another Permit.** Unless the permittee received written notification from DEC specifically allowing these discharges to be authorized under this permit, the permittee is not eligible for coverage under this permit for any of the following:

- 1.4.4.5.1 Storm water discharges associated with construction activity that have been covered under an individual permit, an alternative APDES general permit, or are required to obtain authorization under an alternative general permit in accordance with Part 2.8.
  - 1.4.4.5.2 Discharges from sites where any APDES permit has been or is in the process of being denied, terminated, or revoked by DEC (*this does not apply to the routine reissuance of permits every five years*).
  - 1.4.4.6 **Discharges of Dredged or Fill Material.** Discharges of dredged or fill material into waters of the U.S. requiring federal authorization through the U.S Army Corps of Engineers CWA Section 404 Regulatory Program.
  - 1.4.4.7 **Discharges from Nondomestic Treatment Works.** Discharges of storm water to the land or groundwater from a nondomestic wastewater treatment works (as defined in 18 AAC 72) using permanent storm water management controls unless they are in compliance with 18 AAC 72.600 and EPA Underground Injection Control regulations<sup>1</sup>.
- 1.4.5 Emergency Repairs or Reconstruction of a Facility**
- 1.4.5.1 Discharges from construction activities conducted in response to a disaster (as defined in Alaska Statute 26.23.900) are conditionally authorized, provided that the operator does the following:
    - 1.4.5.1.1 Submits a Notice of Intent (NOI) and SWPPP (if project disturbs five or more acres in accordance with Part 2.1) to the Department in accordance with Part 2.3 and 2.4 within 30 calendar days of initiating construction activities.
    - 1.4.5.1.2 Implements appropriate control measures as soon as possible after initiating construction activities. For discharges occurring during the initial 30 day period, the permittee must demonstrate compliance with the terms and conditions of this permit to the extent practicable depending on the disaster.

## 1.5 Waivers for Certain Small Construction Activities

- 1.5.1 **Waiver Criteria.** An operator of a small construction activity may qualify for a waiver in lieu of obtaining authorization under this permit if one of the following three criteria are met. Details of the three waiver options and procedures for requesting a waiver are provided in Appendix D:
  - 1.5.1.1 The project has a low rainfall erosivity factor;
  - 1.5.1.2 DEC or EPA has established or approved a TMDL that addresses the pollutant(s) of concern and has determined storm water control measures are not needed to protect water quality;
  - 1.5.1.3 The operator develops an equivalent analysis that determined allocations for pollutant(s) of concern are not needed to protect water quality. This waiver is only available for non-impaired waters.

---

<sup>1</sup> For additional information refer to DEC's Engineered Wastewater Disposal System web page at <http://dec.alaska.gov/water/wastewater/engineering/engineered-systems> and EPA's Underground Injection Control web page at <http://www.epa.gov/uic/underground-injection-control-region-10-ak-id-or-and-wa>

## 2.0 AUTHORIZATION UNDER THIS GENERAL PERMIT

**2.1 Submittal Requirements Prior to Construction** Depending on the type and location of the project, the operator may be required to submit information to the DEC and/or an MS4 operator for review prior to filing the NOI and commencement of construction activities. The following is a summary of the information to be submitted to each agency by project type and area of jurisdiction.

- 2.1.1 Permanent Storm Water Management Controls (Outside MS4).** An operator installing permanent storm water management controls in accordance with Part 4.11 and where the project is located outside of an APDES permitted MS4, must submit information required by the DEC in Part 4.11 at least thirty (30) calendar days prior to filing the NOI for the project. The operator must receive the DEC's written reply prior to the commencement of construction activities.
- 2.1.2 Permanent Storm Water Management Controls (Inside MS4).** An operator installing permanent storm water management controls in accordance with Part 4.11 and where the project is located inside the area of an APDES permitted MS4 must submit information required by the MS4 operator for the project and must receive the MS4 operator's approval prior to the commencement of construction activities. Check with the respective MS4 operator for their particular submittal requirements. (See <http://dec.alaska.gov/water/wastewater/stormwater/swppp-submittal-rqmts> for further MS4 operator contact information.)
- 2.1.2.1** Operators of construction activity within the Municipality of Anchorage (with the exception of ADOT&PF, see 2.1.2.2) shall submit information to:
- Municipality of Anchorage  
Public Works Department  
4700 South Elmore Rd.  
P.O. Box 196650  
Anchorage, AK 99519-6650
- 2.1.2.2** Operators of construction activities for Alaska Department of Transportation & Public Facilities (ADOT&PF) construction projects within the Municipality of Anchorage shall submit information to:
- ADOT&PF  
Construction and Operations, Central Region  
4111 Aviation Ave.  
P.O. Box 196900  
Anchorage, AK 99519
- 2.1.2.3** Operators of construction activity within the Fairbanks North Star Borough shall submit information to:
- Fairbanks North Star Borough  
Department of Public Works  
P.O. Box 71267  
Fairbanks, AK 99707

- 2.1.2.4 Operators of construction activity within the City of Fairbanks shall submit information to:
- City of Fairbanks
  - Engineering Division
  - 800 Cushman St.
  - Fairbanks, AK 99701
- 2.1.2.5 Operators of construction activity within the City of North Pole shall submit information to:
- City of North Pole
  - Department of Public Works
  - 125 Snowman Lane
  - North Pole, AK 99705
- 2.1.2.6 Operators of construction activity within the Joint Base Elmendorf-Richardson shall submit information to:
- Storm Water Lead
  - 673<sup>rd</sup> CES/CEIEC
  - 724 Quartermaster Drive
  - Joint Base Elmendorf-Richardson
- 2.1.2.7 Operators of construction activity within the Port of Anchorage shall submit information to:
- Port of Anchorage
  - Operations and Maintenance
  - 2000 Anchorage Port Road
  - Anchorage, AK 99501
- 2.1.2.8 Operators of construction activity within Fort Wainwright shall submit information to:
- Water Quality Program
  - US Army Garrison, Alaska DPW, Environmental Division
  - 3023 Engineer Place
  - Fort Wainwright, AK 99703
- 2.1.3 **SWPPP Submittal to DEC.** An operator developing a project that disturbs five or more acres of land must submit a copy of the SWPPP to the DEC (Appendix A, Part 1.1.1) at the time the NOI is filed (electronic attachments to the eNOI are preferred).
- 2.1.4 **SWPPP Submittal to MS4.** An operator developing a project that is located inside the area of an APDES permitted MS4 must submit a copy of the SWPPP to the respective MS4 operator. Check with the respective MS4 operator for their particular submittal requirements. (<http://dec.alaska.gov/water/wastewater/stormwater/swppp-submittal-rqmts> for further MS4 operator contact information.)
- 2.1.4.1 Within the Municipality of Anchorage
- 2.1.4.1.1 An operator of construction projects disturbing one or more acres of land shall submit a copy of the SWPPP to either DEC or the Municipality based on the project type and operator as shown in the following table.

**Table 3: SWPPP Submittal within Municipality of Anchorage MS4 area.**

Project Type	Submit SWPPP to
Government (Federal, state, or Port of Anchorage) road projects and other government sponsored transportation projects such as ports, railroads, or airports	DEC
Government (municipal) road projects and other government transportation projects	Municipality
Public or private utility projects when the utility is initiating the work	Municipality
Work that requires a building permit	Municipality
Non-publicly funded transportation projects	Municipality

2.1.4.1.2 Submittal of the SWPPP to the Municipality shall be made according to the most recent Municipality requirements and be submitted to the address given in Part 2.1.2.1

2.1.4.1.3 Submittal of the SWPPP to the DEC shall be to the address in Appendix A, Part 1.1.1.

2.1.4.2 Within the road service areas of the Fairbanks North Star Borough, check with the Borough for the latest SWPPP submittal requirements at the address given in Part 2.1.2.3. An operator of a publicly-funded project disturbing one or more acres of land shall submit a copy of the SWPPP to the DEC for review at the address in Appendix A, Part 1.1.1.

2.1.4.3 Within the City of Fairbanks, check with the City for the latest SWPPP submittal requirements at the address given in Part 2.1.2.4. An operator of a public-funded project disturbing one or more acres of land shall submit a copy of the SWPPP to the DEC for review at the address in Appendix A, Part 1.1.1.

2.1.4.4 Within the City of North Pole, check with the City for the latest SWPPP submittal requirements at the address given in Part 2.1.2.5. An operator of a public-funded project disturbing one or more acres of land shall submit a copy of the SWPPP to the DEC for review at the address in Appendix A, Part 1.1.1.

2.1.4.5 Within the Joint Base Elmendorf-Richardson, check with the latest SWPPP submittal requirements at the address given in Part 2.1.2.6.

2.1.4.6 Within the Port of Anchorage, check with the latest SWPPP submittal requirements at the address given in Part 2.1.2.7.

2.1.4.7 Within the Fort Wainwright installation boundary, check with the latest SWPPP submittal requirements at the address given in Part 2.1.2.8.

2.1.5 **Projects Using Cationic Treatment Chemicals or an Active Treatment System.** Submit engineering plans and projects details listed in Part 4.6.7 to DEC (Appendix A, Part 1.1.1) at least 14 calendar days prior to use at the construction site.

2.1.6 **Projects that Discharge to an Outstanding Natural Resource Water.** Contact DEC at least 30 calendar days prior to commencement of construction activities that may discharge to a high quality water that constitutes an outstanding national resource, such as a water of a national or state park or wildlife refuge or a water of “exceptional recreational or ecological significance” (as described in Appendix C), to discuss the need to conduct a site-specific antidegradation analysis. If an antidegradation analysis is required, it must be submitted at least 14 calendar days prior to filing the NOI. Before beginning construction activities, operators must receive a written approval of the analysis from the DEC.

*Note: No Outstanding Natural Resource Waters are designated in Alaska as of the date of this permit issuance.*

## 2.2 How to Obtain Authorization

- 2.2.1 To obtain authorization under this permit, an operator must:
- 2.2.1.1 Be responsible for a project located in the area where DEC is the permitting authority;
  - 2.2.1.2 Meet the eligibility requirements of Part 1.4;
  - 2.2.1.3 Develop a SWPPP according to the requirements in Part 5.0 prior to filing for an NOI and submit a copy of the SWPPP as specified in Part 2.1;
  - 2.2.1.4 Select, design, install, and implement control measures in accordance with Part 4.0 to meet non-numeric effluent limits;
  - 2.2.1.5 Submit a complete and accurate NOI either using DEC's electronic system or using a paper form in accordance with Part 2.3 prior to commencing construction activities;
  - 2.2.1.6 Pay the general permit authorization fees in accordance with 18 AAC 72.956;
  - 2.2.1.7 Submit any additional information requested by the DEC or MS4 Operator (if applicable); and
  - 2.2.1.8 Be granted authorization to discharge by the DEC.
- 2.2.2 Submission of the NOI demonstrates the operator's intent to be covered by this permit; it is not a determination by DEC that the operator meets the eligibility requirements for the permit. A discharge is **not authorized** if:
- 2.2.2.1 The operator's NOI is incomplete or inaccurate;
  - 2.2.2.2 DEC requires the operator to obtain authorization under an individual permit or an alternative general permit; or
  - 2.2.2.3 The discharge does not meet the eligibility requirements under Part 1.4.
- 2.2.3 If the information on the NOI is incorrect or is missing, the NOI will be deemed incomplete and permit authorization will not be granted. A complete NOI shall include the following information:
- 2.2.3.1 **Operator:** organization name, contact person and title, complete mailing address, telephone number, fax number (optional), and email address;
  - 2.2.3.2 **Billing Contact:** organization name, contact person and title, complete mailing address, telephone number and fax number and email address. If the billing contact information is the same as the operator information, check the box on the NOI indicating that it is the same;
  - 2.2.3.3 **Project/site:** project/site name, a physical location, the nearest city and zip code, the borough, latitude and longitude, how the latitude and longitude were determined, and estimated project start date and completion date, and an estimate of the area to be disturbed;
  - 2.2.3.4 **SWPPP:** acknowledgement of whether a SWPPP has been prepared in advance of filing the NOI, the location of the SWPPP – either with the operator, the project/site, or other location, SWPPP contact if different than the operator contact;
  - 2.2.3.5 **Discharge:** the name(s) of the waterbody to which the project discharges, identification if the project/site discharges to a waterbody that is impaired or has a TMDL, if so, confirmation that the discharge is consistent with the assumptions and requirements of the TMDL;

2.2.3.6 Signatory information in compliance with Appendix A, Part 1.12.

## 2.3 How to Submit an Notice of Intent (NOI)

2.3.1 **Submittal Options.** Each operator must submit an NOI to be authorized to discharge under this permit at least five business days prior to commencement of construction activities. DEC may need additional time for manual processing of NOIs. The complete and accurate NOI can be submitted either:

2.3.1.1 Electronically (*strongly encouraged*): Go to DEC's Water Online Application System (OPA) web page at <http://dec.alaska.gov/water/oasys/index.html> to prepare and submit electronic NOI (eNOI). *Note the eNOI will likely be processed more quickly and result in faster receipt of an authorization to discharge.*

2.3.1.2 Paper NOI Form: Complete the CGP NOI form on DEC's APDES Storm Water Forms web page at <http://dec.alaska.gov/water/wnpssc/stormwater/2016CGPForms.htm>. Once the form is complete, scan and email the entire form (5 pages) to the permitting email address in Appendix A, Section 1.1.1 or submit a paper copy to DEC at the address listed in Appendix A, Section 1.1.1.

2.3.1.3 Applicants must pay the general permit authorization fee (in accordance with 18 AAC 72.956) before their NOI is considered complete.

## 2.4 Submission Deadlines

2.4.1 **New Projects.** The operator must submit a complete and accurate NOI and SWPPP (if project disturbs five or more acres in accordance with Part 2.1) prior to commencement of construction activities consistent with Parts 2.2.1 and 2.3 to obtain authorization under this permit.

### 2.4.2 Permitted Ongoing Projects.

2.4.2.1 An ongoing permitted project is one that commenced construction activities prior to the effective date of this permit and where the discharges from that project were authorized under the 2016 CGP (AKR100000). To continue coverage, a permittee must:

2.4.2.1.1 Continue to comply with the terms and conditions of the 2016 CGP until the permittee has been granted authorization under this permit or an alternative APDES permit, or submits a NOT;

2.4.2.1.2 Update the existing SWPPP as necessary to comply with the requirements of Part 3.0, Part 4.0 and Part 5.0 before submitting a new NOI, as described in Part 2.4.2.1.3; and

2.4.2.1.3 Submit a complete and accurate new NOI within 90 calendar days of the effective date of this permit according to Part 2.3. A copy of the updated SWPPP and permit fee is not required to be submitted with the NOI to DEC for permitted ongoing projects.

2.4.2.2 If the permittee is eligible to submit a NOT (e.g., construction is finished and final stabilization has been achieved) before the 90th day, a new NOI is not required to be submitted provided a NOT is submitted within 90 calendar days after the effective date of this permit.



### 2.4.3 **Change of Permittee for an Authorized Ongoing Project.**

- 2.4.3.1 A permittee of an ongoing project who transfers ownership of the project, or a portion thereof, to a different operator, the new operator will be required to submit a complete and accurate new NOI for a new project in accordance with Part 2.3.1 and the original permittee must file a NOT in accordance with Part 2.7.5.

### 2.4.4 **Unpermitted Ongoing Project/Late Notification.**

An operator who commences construction activities without authorization to discharge for a project that requires submission of a NOI consistent with Part 2.2 must develop and/or update a project-specific SWPPP and submit a complete and accurate NOI consistent with Part 2.3 as soon as practicable. The applicant is authorized to discharge in accordance with Part 2.5. The DEC reserves the right to take enforcement action for any unpermitted discharges or permit non-compliance that occurs between the commencement of construction and discharge authorization.

## 2.5 **Date of Authorization to Begin Discharge**

Authorization to discharge under this general permit requires the operator seeking authorization to submit to DEC a complete and accurate NOI and payment of fee. If the project disturbs five or more acres, a copy of the SWPPP must be submitted in accordance with Part 2.1 prior to commencement of construction activities consistent with Parts 2.2.1 and 2.3.. The operator must receive written notification of authorization from DEC that coverage has been granted, and that a specific authorization number has been assigned prior to construction activities.

A permittee is authorized to discharge storm water from construction activities under the terms and conditions of this general permit upon the date specified in the issuance of the DEC authorization letter, which is posted on DEC's water permit search website (<http://dec.alaska.gov/Applications/Water/WaterPermitSearch/Search.aspx>).

## 2.6 **Continuation of Expired General Permit**

If this permit is not reissued prior to the expiration date, it will be administratively continued in accordance with 18 AAC 83.155(c) and remain in force and effect for discharges that were covered prior to expiration.

- 2.6.1 The permittee is required to abide by all limitations, monitoring, and reporting included herein if the permit enters administrative extension until such time a permit is reissued authorizing the discharge or an NOT is submitted by the permittee.
- 2.6.2 A permittee who is authorized to discharge under this permit prior to the expiration date, any discharges authorized will automatically remain covered by this permit until the earliest of:
- 2.6.2.1 Authorization for coverage under a reissued permit or replacement of this permit following a permittee's timely and appropriate submittal of a complete NOI requesting authorization to discharge under the new permit and compliance with the requirements of the new permit;
- 2.6.2.1.1 If a permittee fails to submit a timely NOI for coverage under the reissued or replacement permit, the permittee's coverage will expire at midnight on the date that the NOI is due.
- 2.6.2.2 Submittal of a NOT;
- 2.6.2.3 Issuance of an individual permit for the project's discharges; or

- 2.6.2.4 A formal permit decision by DEC to not reissue this general permit or not cover a particular discharger previously covered by the general permit, at which time DEC will identify a reasonable time period for covered dischargers to seek coverage under an alternative general permit or an individual permit. Coverage under this permit will cease at the end of this time period.

## 2.7 Submittal of a Modification to Original NOI

- 2.7.1 **Modification.** A permittee must file an NOI modification form to DEC (see Part 2.3) to update or correct the following information on the original NOI within 30 calendar days of the change:
- 2.7.1.1 Owner/Operator address and contact information;
  - 2.7.1.2 Site information;
  - 2.7.1.3 Estimated start or end dates;
  - 2.7.1.4 Number of acres to be disturbed; or
  - 2.7.1.5 SWPPP location and contact information.
- 2.7.2 Continuation of expired permit in accordance with Part 2.6.
- 2.7.3 If the original project disturbance was between one and less than five acres, and will now disturb five acres or more, a SWPPP must be submitted with the NOI modification.
- 2.7.4 No general permit authorization fee is required when submitting an NOI modification.
- 2.7.5 **NOT Instead of Modification.** The permittee must submit a NOT instead of an NOI modification form to DEC within 30 calendar days when the operator has changed. A change of operator in this case means when an organization changes control of the project. It does not mean when a corporate officer of the organization changes while the organization continues with the project. The new owner/operator must file a new NOI to obtain coverage under the CGP. Coverage is not transferrable.

## 2.8 Alternative Permits

### 2.8.1 DEC Requiring Authorization under an Alternative Permit

DEC may terminate or revoke a permittee's authorization under this permit and may require a permittee to apply for and/or obtain authorization to discharge under an alternative permit (i.e., an APDES individual permit or an alternative APDES general permit in accordance with 40 CFR §122.64 and §124.5). If DEC requires a permittee to apply for an alternative permit, DEC will notify the permittee in writing that a permit application is required. This notification will include a brief statement of the reasons for this decision, alternative permit application requirements, and an application form. In addition, the notice will set a deadline to file the application, and will include a statement that on the effective date of issuance or denial of the APDES individual permit, or the effective date of authorization or denial of authorization under the alternative general permit as it applies to the permittee, authorization under this general permit will automatically terminate. An application must be submitted to DEC at the address in Appendix A, Section 1.1.1. DEC may grant additional time to submit the application upon a written request by the permittee provided the request is received prior to expiration of the deadline. If the permittee is covered under this permit and fails to submit an alternative permit application in a timely manner as required by DEC, then the authorization under this permit will automatically terminate at the end of the day specified by DEC as the deadline for application submittal. The DEC may take appropriate enforcement action for any unpermitted discharge.

### 2.8.2 Operator Requesting Authorization under an Alternative Permit

An operator may request to be excluded from coverage under this general permit by applying for an individual permit. The operator must submit an individual permit application in accordance with 18 AAC 83.305 – 83.385 to DEC no later than ninety (90) days after publication of the general permit to the address in Appendix A, Part 1.1.1. DEC may grant the request by issuing an individual permit or authorization under an alternative general permit if DEC deems that the reasons cited are adequate to support the request.

- 2.8.3 When a permittee is issued an APDES individual permit or is authorized to discharge under an alternative APDES general permit, the authorization under this permit is automatically terminated on the effective date of the individual permit or the date of authorization under the alternative general permit, whichever the case may be. If the permittee is denied an APDES individual permit or an alternative APDES general permit, the authorization under this permit is automatically terminated on the date of such denial, unless otherwise specified by DEC.

## 3.0 COMPLIANCE WITH STANDARDS AND LIMITS

### 3.1 Requirements for all Projects

- 3.1.1 A permittee must select, install, implement, and maintain control measures (described in Part 4.0) at the construction site to minimize the discharge of pollutants as necessary to meet WQS's (18 AAC 70). A permittee must comply with all permit conditions with respect to installation and maintenance of control measures, inspections, monitoring (if necessary), corrective actions, reporting and recordkeeping.
- 3.1.2 In general, except in situations explained in Part 3.1.3, the storm water controls planned, developed, implemented, maintained, and updated by the permittee that are consistent with the provisions of Parts 3.0 through 9.0 are considered to meet the stringent requirements of this permit to ensure that the discharges do not cause or contribute to an excursion above any WQS (18 AAC 70).
- 3.1.3 At any time after authorization, DEC may determine that the permittee's storm water discharges will cause, have reasonable potential to cause, or contribute to an excursion above any applicable WQS. If such a determination is made, DEC may require the permittee to:
- 3.1.3.1 Take corrective actions and modify storm water controls in accordance with Part 8.0 to adequately address the identified water quality concerns;
  - 3.1.3.2 Submit valid and verifiable data and information that are representative of ambient conditions and indicate that the receiving water is attaining WQSs; or
  - 3.1.3.3 Minimize discharges of storm water from the construction project and submit an individual permit application in accordance with Part 2.8.
- 3.1.4 All written responses required under this part must include a signed certification consistent with Appendix A, Part 1.12.

### 3.2 Discharge to Impaired Water Body

If the permittee is discharging into a water body with an EPA-established or approved TMDL, the permittee must implement measures to ensure that the discharge of pollutants from the site is consistent with the assumptions and requirements of the EPA-established or approved TMDL, including ensuring that the discharge does not exceed specific wasteload or load allocation that has been established that would apply to the discharge. The permittee

must also evaluate the recommendation in the Implementation Section of the TMDL and incorporate applicable measures into the operation.

### **3.2.1 Discharging to an Impaired Water Body for Turbidity or Sediment (Category 5)**

3.2.1.1 Permittees who (1) discharge into a water body that is listed on Alaska's 303(d) List of Impaired Waters (Category 5) for turbidity or sediment (<http://dec.alaska.gov/water/water-quality/impaired-waters>) and (2) disturbs 20 or more acres of land at one time (including non-contiguous land disturbances that take place at the same time and are part of a larger common plan of development or sale) that drains to an impaired water must:

3.2.1.1.1 Develop, implement, and modify as necessary a written site-specific monitoring plan consistent with Part 7.0 that specifies the sampling frequency and location.

3.2.1.1.2 Conduct turbidity sampling at the following locations to evaluate compliance with the WQS for turbidity;

3.2.1.1.2.1 Upstream turbidity in the impaired water at a representative location (upgradient) from the point of storm water discharge into the impaired water or outside the area of influence of the storm water discharge; and

3.2.1.1.2.2 Downstream turbidity at a representative location downstream from the point of discharge into the impaired water, inside the area of influence of the storm water discharge. Alternatively, the discharge turbidity may be measured at the point where the storm water discharge leaves the construction site, rather than when it is in the receiving water body.

3.2.1.1.3 Based on the sampling (as described in Part 3.2.1.1.2), the resulting water quality must meet the state WQS for turbidity, as follows:

3.2.1.1.3.1 The downstream sample may not exceed 5 nephelometric turbidity units (NTU) above the upstream sample when the upstream turbidity is 50 NTU or less; and

3.2.1.1.3.2 The downstream sample may not have more than 10% increase in turbidity when the upstream turbidity is more than 50 NTU, not to exceed a maximum increase of 25 NTU.

3.2.1.1.4 If the difference between the upstream and downstream sample exceeds the WQS for turbidity, the permittee must:

3.2.1.1.4.1 Review the SWPPP and the control measures selected for the project and make appropriate improvements and corrections to the control measures within seven calendar days of the date the discharge exceeds the WQS;

3.2.1.1.4.2 Update the SWPPP with the improvements and changes to the control measures;

3.2.1.1.4.3 Submit a corrective action report consistent with Part 9.2; and

3.2.1.1.4.4 Continue to sample daily until the discharged storm water is less than the WQS for turbidity for the receiving water.

### **3.2.2 Discharging to an Impaired Water Body with an Approved or Established TMDL for Turbidity or Sediment (Category 4a or 4b)**

3.2.2.1 Operators are not eligible for authorization under this permit if:

3.2.2.1.1 An EPA-approved or established TMDL specifically precludes such discharges; or

- 3.2.2.1.2 The project involves a discharge of pollutants of concern (e.g. turbidity, sediment, debris, etc.) to waters with an EPA-approved or established TMDL for turbidity or sediment, unless control measures are implemented as necessary for consistency with the assumptions and requirements of the TMDL.
- 3.2.2.2 If a specific wasteload or load allocation has been established for turbidity or sediment that would apply to the discharge of storm water from the construction site, the permittee must implement necessary steps to meet that allocation. The permittee must also evaluate the implementation measures recommended in the TMDL and incorporate them as appropriate.
- 3.2.2.3 In a situation where an EPA-approved or established TMDL for turbidity or sediment has specified a general wasteload or load allocation for a pollutant of concern (e.g. turbidity, sediment, debris, etc.) that is applicable to construction storm water discharges, but no specific requirements for construction sites have been identified in the TMDL, the permittee should consult with DEC to confirm that meeting the standards in Parts 3.0 and 4.0 will be consistent with the approved TMDL.
- 3.2.2.4 Where an EPA-approved or established TMDL has not specified a wasteload or load allocation applicable to construction storm water discharges, but has not specifically excluded these discharges, compliance with the requirements in Parts 3.0 and 4.0 of this permit will generally be assumed to be consistent with the approved TMDL.

### **3.3 Protection of Endangered Species**

A permittee must protect federally-listed endangered or threatened species, or federally-designated critical habitat.

- 3.3.1 An applicant is not eligible to discharge if the storm water discharges, allowable non-storm water discharges, and storm water discharge-related activities (as defined in Appendix C) are likely to jeopardize the continued existence of any species that are federally-listed as endangered or threatened (listed) under the ESA or result in the adverse modification or destruction of federally-designated critical habitat under the ESA.
- 3.3.2 An applicant is not eligible to discharge if the storm water discharges, allowable non-storm water discharges, and storm water discharge-related activities (as defined in Appendix C) would cause a prohibited take of federally-listed endangered or threatened species (as defined under Section 3 of the ESA and 50 CFR §17.3), unless such takes are authorized under Sections 7 or 10 of the ESA.

## **4.0 CONTROL MEASURES**

### **4.1 Control Measure Selection and Design Considerations**

- 4.1.1 Permittees must select, design, install, and implement the control measures in this Part to the extent practicable. The specific control measures are based on the requirements of the national effluent limitation guidelines (ELG) that apply to the construction and development industry (40 CFR §450).

- 4.1.2 The selection, design, installation, maintenance, and removal of control measures must be in accordance with good engineering practices manufacturer specifications and address site-specific conditions such as precipitation, site topography, soil characteristics, and growing season. Permittees may deviate from such manufacturer's specifications where the permittee provides justification for such deviation and includes documentation of their rationale in the SWPPP. If a permittee finds that their control measures are not achieving their intended effect of minimizing pollutant discharges, the permittee must modify these control measures in accordance with the corrective action requirements set forth in Part 8.0.
- 4.1.3 Erosion and Sediment Controls. A permittee must design, install, and maintain effective erosion and sediment controls to minimize the discharge of pollutants. At a minimum, such controls must be designed, installed, and maintained to:
- 4.1.3.1 Control storm water volume and velocity to minimize soil erosion and pollutant discharges;
  - 4.1.3.2 Control storm water discharges, including both peak flowrates and total storm water volume, to minimize channel and streambank erosion and scour in the immediate vicinity of discharge points;
  - 4.1.3.3 Minimize the amount of soil exposed during construction activity;
  - 4.1.3.4 Minimize the disturbance of steep slopes;
  - 4.1.3.5 Minimize sediment discharges from the site. The design, installation, and maintenance of erosion and sediment controls must address factors such as the amount, frequency, intensity, duration of precipitation; the nature of resulting storm water runoff; and soil characteristics, including the range of soil particle sizes expected to be present on the site;
  - 4.1.3.6 Provide and maintain natural buffers around waters of the U.S., direct storm water to vegetated areas and maximize storm water infiltration to reduce pollutant discharges, unless infeasible;
  - 4.1.3.7 Minimize soil compaction. Minimizing soil compaction is not required where the intended function of a specific area of the site dictates it be compacted.
  - 4.1.3.8 Unless infeasible, preserve topsoil. Preserving topsoil is not required where the intended function of a specific area of the site dictates that the topsoil be disturbed or removed.
- 4.1.4 Additional Erosion and Sediment Controls Selection and Design Considerations:
- 4.1.4.1 Preventing storm water from coming into contact with polluting materials is generally more effective, and less costly, than removing pollutants from storm water;
  - 4.1.4.2 Using a combination of control measures is more effective than using control measures in isolation for minimizing pollutants in the storm water discharge;
  - 4.1.4.3 Using technologically available, economically practicable, and achievable methods in light of best industry practices;
  - 4.1.4.4 Assessing the type and quantity of pollutants, including their potential to impact receiving water quality, is critical to designing effective control measures that will achieve the limits in this permit;

- 4.1.4.5 Minimizing impervious areas at the permittees facility and infiltrating runoff onsite (including bioretention cells, green roofs, and pervious pavement, among other approaches) can reduce runoff and improve groundwater recharge and stream base flows in local streams, although care must be taken to avoid ground water contamination;
- 4.1.4.6 Dissipate storm water runoff into open vegetated swales and natural depressions to reduce in stream impacts of erosive flows;
- 4.1.4.7 Conserving and/or restoring of riparian buffers will help protect streams from storm water runoff and improve water quality; and
- 4.1.4.8 Using treatment interceptors (e.g., sand filters) may be appropriate in some instances to minimize the discharge of pollutants.

## 4.2 Erosion Control Measures

A permittee must comply with the erosion control measures in this Part to minimize soil exposure on the site during construction.

### 4.2.1 Delineation of Site

A permittee must generally delineate (e.g., with flags, stakes, signs, silt fence, etc.) the location of any of the following that apply to the site:

- 4.2.1.1 All areas where soil disturbing construction activities will occur; and
- 4.2.1.2 Specific areas that will be left undisturbed such as trees, boundaries of sensitive areas, or buffers established under Part 4.2.3.

### 4.2.2 Minimize the Amount of Soil Exposed during Construction Activity

A permittee must include the following in the selection of control measures and the sequence of project construction as they apply to the project site:

- 4.2.2.1 Preserve native topsoil for later use with on-site stockpiles, unless deemed infeasible by space constraints or site design creates impervious surfaces; and
- 4.2.2.2 Sequence or phase construction activities to minimize the extent and duration of exposed soils.

### 4.2.3 Maintain Natural Buffer Areas

A permittee must maintain natural buffer areas at stream crossings and around the edge of any waters of the U.S. that are located within or immediately adjacent to the construction activity in accordance with the following:

- 4.2.3.1 The buffer must be a minimum of 25 feet wide, or the width as required by local ordinance, unless infeasible based on site dimensions;
- 4.2.3.2 Exceptions are allowed for water dependent activities, specific water access activities, or necessary water crossings;
- 4.2.3.3 A permittee should, to the extent practicable, use perimeter controls adjacent to buffers and direct storm water sheet flow to buffer areas to increase sediment removal and maximize storm water infiltration.

### 4.2.4 Clearing Vegetation

- 4.2.4.1 Clearing of vegetation that disturbs the vegetative mat and exposes soil is **prohibited** prior to obtaining authorization under this permit.

4.2.4.2 Cutting of trees and brush while the ground is frozen without disturbing the vegetative mat early in the springtime to avoid adversely affecting migratory birds or their nests in accordance with the U.S. Fish & Wildlife Service's "Nesting Birds: Timing Recommendations to Avoid Land Disturbance & Vegetation Clearing"<sup>2</sup> is allowed prior to the submittal of a project NOI. If vegetation clearing that disturbs the vegetative mat and occurs after the onset of spring thaw (as defined in Appendix C) or conditions that consist of above freezing temperatures that cause melting of snow, the permittee must develop a SWPPP and file an NOI. Operators must receive authorization under this permit and otherwise comply with the terms of this permit prior to such clearing.

#### 4.2.5 Control Storm Water Discharges and Flow Rates

A permittee must include the following control measures to handle storm water and total storm water volume discharges as they apply to the site:

- 4.2.5.1 Divert storm water around the site so that it does not flow onto the project site and cause erosion of exposed soils (diverting storm water around the site can be effective measure as long as it does not cause flooding and/or erosion offsite);
- 4.2.5.2 Slow down or contain storm water that may collect and concentrate within a site and cause erosion of exposed soils;
- 4.2.5.3 Avoid placement of structural control measures in active floodplains to the degree technologically and economically practicable and achievable;
- 4.2.5.4 Place velocity dissipation devices (e.g., check dams, sediment traps, or riprap) along the length of any conveyance channel (of erodible materials) to provide a non-erosive flow velocity. Also place velocity dissipation devices where discharges from the conveyance channel or structure join a water course to prevent erosion and to protect the channel embankment, outlet, adjacent stream bank slopes, and downstream waters; and
- 4.2.5.5 Install permanent storm water management controls, where practical, so that they are functional prior to construction of site improvements (e.g., impervious surfaces).

#### 4.2.6 Protect Steep Slopes

A permittee must consider the following in the selection of control measures as they apply to the project site:

- 4.2.6.1 Design and construct cut-and-fill slopes in a manner that will minimize erosion. Applicable practices include, but are not limited to, reducing continuous length of slope with terracing and diversions, reducing slope steepness, and roughening slope surfaces (e.g., track walking);
- 4.2.6.2 Divert concentrated flows of storm water away from and around the disturbed portion of the slope. Applicable practices include, but are not limited to interceptor dikes and swales, grass-lined channels, pipe slope drains, subsurface drains, check dams; and
- 4.2.6.3 Stabilize exposed areas of the slope in accordance with Part 4.5.

### 4.3 Sediment Control Measures

Sediment control measures (e.g. sediment ponds, traps, filters, etc.) must be constructed as one of the first steps in grading. These control measures must be functional before other land

---

<sup>2</sup> <https://www.fws.gov/alaska/pages/nesting-birds-timing-recommendations-avoid-land-disturbance-vegetation-clearing>



disturbing activities take place. A permittee must install, establish, and use any of the following control measures that apply to the project site.

#### 4.3.1 **Storm Water Inlet Protection**

A permittee must install appropriate protection measures (e.g. filter berms, perimeter controls, temporary diversion dikes, etc.) to minimize the discharge of sediment prior to entry into storm water inlets located on site or immediately downstream of the site.

#### 4.3.2 **Water Body Protection**

A permittee must install appropriate protection measures (e.g. velocity dissipation devices in accordance with Part 4.2.5.4) to minimize the discharge of sediment prior to entry into the water body for water bodies located on site or immediately downstream of the site.

#### 4.3.3 **Down-Slope Sediment Controls**

A permittee must establish and use down-slope sediment controls (e.g., silt fence or temporary diversion dike) for any portion of the down-slope and side-slope perimeter where storm water will be discharged from disturbed areas of the site.

#### 4.3.4 **Stabilized Construction Vehicle Access and Exit Points**

A permittee must establish construction vehicle access and exit points. Access and exit points should be limited to one route, if possible. If sediment escapes the construction site, off-site accumulations of sediment must be removed at a frequency sufficient to minimize off-site impacts.

#### 4.3.5 **Vehicle Track-Out**

A permittee must provide an effective way of minimizing off-site vehicle tracking of sediment from wheels to prevent track-out onto paved surfaces. Where sediment has been tracked-out from a site onto paved roads, sidewalks, or other paved areas outside of the site, remove the deposited sediment by the end of the same business day in which the track-out occurs or by the end of the next business day if track-out occurs on a non-business day. Remove the track-out by sweeping, shoveling, or vacuuming these surfaces, or by using other similarly effective means of sediment removal.

#### 4.3.6 **Dust Generation**

A permittee must minimize the generation of dust through the application of water or other dust suppression techniques and prior to vehicle exit.

#### 4.3.7 **Stockpile Management**

In accordance with Part 4.5.1, a permittee must stabilize or cover stockpiles, protect with sediment control measures. Locate soil stockpiles away from storm water inlets, water bodies, and conveyance channels, if possible. Install a sediment control measure along all downgradient perimeter areas.

#### 4.3.8 **Authorized Non-Storm Water Discharges**

A permittee must minimize any non-storm water authorized by this permit.

#### 4.3.9 **Sediment Basins**, where applicable:

- 4.3.9.1 For common drainage locations that serve an area with 10 or more acres disturbed at one time, a temporary (or permanent) sediment basin that provides storage for a calculated volume of runoff from the drainage area from a 2-year, 24-hour storm, or equivalent sediment control measures, must be installed, maintained, and used where practicable until final stabilization of the site.

- 4.3.9.1.1 Where no such calculation has been performed, a temporary (or permanent) sediment basin providing 3,600 cubic feet of storage per acre drained, or equivalent sediment control measures, must be installed and used where practicable until final stabilization of the site. When computing the number of acres draining into a common location, it is not necessary to include flows from offsite areas and flows from on-site areas that are either undisturbed or have undergone final stabilization where such flows are diverted around both the disturbed area and the sediment basin.
- 4.3.9.1.2 In determining whether installing a sediment basin is practicable, the permittee may consider factors such as site soils, slope, available area on-site, etc. In any event, the permittee must consider public safety, especially as it relates to children, as a design factor for the sediment basin, and alternative sediment control measures must be used where site limitations would preclude a safe design.
- 4.3.9.2 For drainage locations which serve 10 or more disturbed acres at one time and where a temporary sediment basin or equivalent controls is not practicable, smaller sediment basins and/or sediment traps should be used. Silt fences, vegetative buffer strips, or equivalent sediment control measures are required for all down slope boundaries (and for those side slope boundaries deemed appropriate as dictated by individual site conditions).
- 4.3.9.3 For drainage locations serving less than 10 acres, sediment traps should be used. Silt fences, vegetative buffer strips, or equivalent sediment control measures are required for all down slope boundaries (and for those side slope boundaries deemed appropriate as dictated by individual site conditions) of the construction area unless a sediment trap providing storage for a calculated volume of runoff from a 2-year, 24-hour storm event or 3,600 cubic feet of storage per acre drained is provided.
- 4.3.9.4 Surface outlets. When discharging from basins and impoundments, utilize outlet structures that withdraw water from the surface, unless infeasible.

*Note: No installation of sediment basins should be installed in permafrost areas. Installing sediment basins in the presence of permafrost is challenging and might not be practicable in some instances because permafrost creates poor surface drainage that hinders the infiltration of runoff. Also, the excavation of permafrost in summer can trigger thawing and instability.*

#### **4.4 Dewatering**

- 4.4.1 If a construction activity includes excavation dewatering that may adversely impact a local drinking water well, a DEC-identified contaminated site or groundwater plume, or waters of the U.S., the permittee may be required to obtain authorization under the DEC General Permit for Excavation Dewatering (AKG002000 or most current version) in addition to this permit.
- 4.4.2 A discharge from eligible dewatering activities, including discharges from dewatering of trenches and excavations, are prohibited unless treated by appropriate control measures. Appropriate control measures include, but are not limited to, sediment basins or traps, dewatering tanks, weir tanks, or filtration systems designed to remove sediment. To the extent feasible, use vegetated, upland areas of the site to infiltrate dewatering water before discharge.

## 4.5 Soil Stabilization

A permittee must stabilize all disturbed areas of the site to minimize erosion and sedimentation and the resulting discharge of pollutants according to the requirements of this Part. A permittee must ensure that existing vegetation is preserved and a natural buffer is maintained wherever possible, and disturbed portions of the site are stabilized (Part 4.2.3). A permittee should avoid using impervious surfaces for stabilization. Applicable stabilization control measures include, but are not limited to:

- Temporary and permanent seeding;
- Sodding;
- Mulching;
- Rolled erosion control product;
- Compost blanket;
- Soil application of Polyacrylamide (PAM);
- Early application of gravel base on areas to be paved; and
- Dust control.

4.5.1 **Minimum Requirements for Soil Stabilization.** A permittee must consider the selection and implementation of control measures and the sequence of project construction as they apply to the project site.

4.5.1.1 **Deadline to Initiate Stabilization.** Stabilization of disturbed areas must, at a minimum, be initiated immediately whenever any clearing, grading, excavating, or other earth disturbing activities have permanently ceased on any portion of the site or temporarily ceased on any portion of the site and will not resume for a period exceeding:

4.5.1.1.1 Seven (7) calendar days for those areas of the state with a mean annual precipitation of forty (40) inches or greater; or

4.5.1.1.2 Fourteen (14) calendar days for those areas of the state with a mean annual precipitation less than forty (40) inches.

*Note: In the context of this provision, “immediately” means no later than the end of the next work day, following the day when the earth-disturbing activities have temporarily or permanently ceased.*

*Note: Earth-disturbing activities have temporarily ceased when clearing, grading, and excavation within any area of the site that will not include permanent structures will not resume (i.e., the land will be idle) for a period of seven or 14 or more calendar days (dependent on mean annual precipitation from above), but such activities will resume in the future.*

*The timeframe above begins counting as soon as you know that construction work on a portion of your site will be temporarily ceased. In circumstances where you experience unplanned or unanticipated delays in construction due to circumstances beyond your control (e.g., sudden work stoppage due to unanticipated problems associated with construction labor, transportation difficulties delays due to weather and site or soil conditions, funding, or other issues related to the ability to work on the site; weather conditions rendering the site unsuitable for the continuation of construction work) and you do not know at first how long the work stoppage will continue, your requirement to immediately initiate stabilization is triggered as soon as you know with reasonable certainty that work will be stopped for the time period above. At that point, you must comply with Parts 4.5.1.1 and 4.5.1.2.*

4.5.1.1.3 Types of activities considered to constitute initiation of stabilization, but is not limited to:

- 4.5.1.1.3.1 Prepping the soil for vegetative stabilization by performing all activities necessary to initially seed or plant the area to be stabilized or for non-vegetative stabilization by installing or application of physical, structural, or mechanical measures;
- 4.5.1.1.3.2 Applying mulch or other non-vegetative product to the exposed area;
- 4.5.1.1.3.3 Seeding or planting the exposed area;
- 4.5.1.1.3.4 Starting any of the activities in Part 4.5.1.1.3.1 - 4.5.1.1.3.3 on a portion of the area to be stabilized, but not on the entire area; or
- 4.5.1.1.3.5 Finalizing arrangements (e.g., delivery of stabilization products, scheduling the installation of the products) to have stabilization product fully installed in compliance with the applicable deadline for completing stabilization in Parts 4.5.1.1 and 4.5.1.2.

4.5.1.2 **Deadline to Complete Temporary Stabilization Activities.** As soon as practicable, but no later than 14 calendar days after the initiation of soil stabilization measures consistent with Part 4.5.1.1, the following are required to be completed:

- 4.5.1.2.1 For vegetative stabilization, all activities necessary to initially seed or plant the area to be stabilized; and/or
- 4.5.1.2.2 For non-vegetative stabilization, the installation or application of all such non-vegetative measures.

*Note: DEC may determine, based on an inspection carried out under Part 6.6 and corrective actions required under Part 8.1.1.4 Corrective Action Required by DEC, that the level of sediment discharge on the site makes it necessary to require a faster schedule for completing stabilization. For instance, if sediment discharges from an area of exposed soil that is required to be stabilized are compromising the performance of existing storm water controls, DEC may require stabilization to correct this problem and may take appropriate enforcement action.*

4.5.1.3 **Exceptions to the Deadlines for Initiating and Completing Stabilization.**

- 4.5.1.3.1 *Projects in Arid or Semi-Arid, or Drought-Stricken Areas.* For those areas of the state with a mean annual precipitation is less than or equal to 20 inches and where initiating perennial vegetative stabilization measures is infeasible within 14 calendar days after construction activity has temporarily ceased, vegetative or non-vegetative stabilization measures must be initiated immediately.

*Note: In the context of this provision, "immediately" means no later than the end of the next work day, following the day when the earth-disturbing activities have temporarily or permanently ceased.*

- 4.5.1.3.1.1 Immediately initiate, and within 14 calendar days complete, the installation of non-vegetative stabilization measures to prevent erosion.
- 4.5.1.3.1.2 If construction is occurring during a drought-stricken period, indicate in the SWPPP the beginning and ending dates of the drought-stricken period and your site conditions. Include the schedule for initiating and completing vegetative stabilization.

4.5.1.3.2 *Deadlines for projects that are affected by circumstances beyond the control of the permittee that delay the initiation and/or completion of vegetative stabilization as required in Parts 4.5.1.1 and/or 4.5.1.2.* If the permittee is unable to meet the deadlines in Parts 4.5.1.1 and/or 4.5.1.2 due to circumstances beyond the permittee's control<sup>3</sup>, and is using vegetative cover for temporary stabilization, the permittee may comply with the following stabilization deadlines instead:

4.5.1.3.2.1 Immediately initiate, and within 14 calendar days complete, the installation of temporary non-vegetative stabilization measures to prevent erosion;

4.5.1.3.2.2 Complete all soil conditioning, seeding, watering or irrigation installation, mulching, and other required activities related to the planting and initial establishment of vegetation as soon as conditions or circumstances allow it on the site; and

4.5.1.3.2.3 Document the circumstances in the SWPPP that prevent meeting the deadlines required in Parts 4.5.1.1 and/or 4.5.1.2 and the proposed schedule for initiating and completing stabilization.

4.5.1.3.3 Winter Considerations, see Part 4.12.

4.5.1.3.4 In limited circumstances, stabilization may not be required if the intended function of a specific area of the site necessitates that it remain disturbed.

4.5.1.4 **Deadline to Complete Final Stabilization Activities.** A permittee must consider the selection and implementation of control measures and the sequence of project construction as they apply to the project site.

4.5.1.5 The permittee must within seven (7) calendar days of initiating final stabilization complete or continue maintenance for the following on any portion of the site that has reached final grading and for areas where clearing, grading, excavating, or other earth disturbing activities have permanently ceased:

4.5.1.5.1 All soil conditioning, seeding, watering, mulching, and any other required activities for the establishment of vegetative cover;

4.5.1.5.2 The installation or application of all such measures for vegetative cover; and/or

4.5.1.5.3 The placement of non-vegetative final stabilization measures.

#### 4.5.2 **Stabilization Requirements for Terminating Permit Authorization**

To terminate authorization under this permit, final stabilization (as defined in Appendix C), must be achieved on all portions of the site for which a permittee is responsible and all ground disturbing construction activity or use of related support activities must be completed, in accordance with Part 10.2.1.1.

## 4.6 Treatment Chemicals

4.6.1 The use of treatment chemicals to reduce sediment in a storm water discharge is allowed provided that all the requirements of this Part are met. Use conventional sediment controls before and after the application of treatment chemicals. Chemicals may only be applied where storm water is treated upstream and is directed to a sediment control (e.g., sediment trap, sediment basin) before discharge.

---

<sup>3</sup> Examples include problems with the supply of seed stock or with the availability of specialized equipment, unsuitability of soil conditions due to excessive precipitation and/or flooding.

- 4.6.2 Select appropriate treatment chemicals. Chemicals must be appropriately suited to the types of soils likely to be exposed during construction and present in the discharges being treated (i.e., the expected turbidity, pH, and flow rate of storm water flowing into the chemical treatment system or area, etc.)
- 4.6.3 Minimize discharge risk from stored chemicals. Store all treatment chemicals in leak-proof containers that are kept under storm-resistant cover and surrounded by secondary containment structures (e.g., spill berms, decks, spill containment pallets), with adequate spill kits available on-site to respond in the event of a discharge of treatment chemicals.
- 4.6.4 Use chemicals in accordance with good engineering practices and specifications of the chemical provider/supplier, and with dosing specifications and sediment removal design specifications provided by the provider/supplier of the applicable chemicals, or document in your SWPPP specific departures from these specifications and how they reflect good engineering practice.
- 4.6.5 Application of treatment chemicals through the use of manufactured products (e.g., gel bars, gel logs, floc blocks, etc.) must be used in combination with adequate ditch check dams, sediment traps, sediment basins, or physical control measure designed to settle out chemically treated storm water and minimize the presence of treatment chemicals before discharges reach waters of the U.S. At a minimum there must be adequate ditch length downstream of the last manufactured product prior to reaching the discharge point into a water of the U.S. to provide a place for sedimentation to occur.
- 4.6.6 Ensure proper training. Ensure that all persons who handle and use treatment chemicals at the construction site are provided with appropriate product-specific training, including but not limited to proper dosing requirements, handling, storage, and disposal.
  - 4.6.6.1 Document the following in the SWPPP:
    - 4.6.6.1.1 Specific chemicals and chemical treatment systems used;
    - 4.6.6.1.2 Names and titles of person(s) who handle and apply treatment chemicals;
    - 4.6.6.1.3 Title of training conducted, date, instructor name, and attendees.
- 4.6.7 If the permittee plans to use cationic treatment chemicals or an active treatment system (as defined in Appendix C) they must submit a request to the Department (Permitting Program, Appendix A part 1.1.1) fourteen (14) calendar days in advance of proposed usage. The request must include the following:
  - 4.6.7.1 Operator Name, mailing address, phone number, and email address;
  - 4.6.7.2 Project/Site name, physical address, contact name, phone number, email address and permit authorization number;
  - 4.6.7.3 Site Map with all receiving waterbodies, proposed location of chemical treatment system, and proposed point of discharge into receiving waterbodies;
  - 4.6.7.4 Schematic drawing of the proposed treatment system; and
  - 4.6.7.5 Description of the proposed treatment system including; type of system being used, chemicals being used, estimated start and finish date, sampling and recordkeeping schedule and reporting, and name of treatment system operator or company.
- 4.6.8 The permittee must perform all additional measures as conditioned by the Department authorization to ensure that the use of such chemicals will not cause an exceedance of water quality standards.

## 4.7 Prohibited Discharge

### 4.7.1 A permittee is prohibited from discharging the following from the site:

- 4.7.1.1 Wastewater from concrete washout, unless managed by an appropriate control measure;
- 4.7.1.2 Wastewater from washout and cleanout of stucco, paint, form release oils, curing compounds and other hazardous construction materials;
- 4.7.1.3 Fuels, oils, or other pollutants used in vehicle and equipment operation and maintenance; and
- 4.7.1.4 Soaps or solvents used in vehicle and equipment washing.

## 4.8 Good Housekeeping Measures

A permittee must design, install, implement, and maintain effective good housekeeping measures to prevent and/or minimize the discharge of pollutants. At a minimum, such measures must be designed, installed, implemented, and maintained to:

- Minimize the discharge of pollutants from equipment and vehicle washing, wheel wash water, and other waters. Wash waters must be treated in a sediment basin or alternative control that provides equivalent or better treatment prior to discharge;
- Minimize the exposure of building materials, building products, construction wastes, trash, landscape materials, fertilizers, pesticides, herbicides, detergents, sanitary waste and other materials present on the site to precipitation and to storm water. Minimization of exposure is not required in cases where the exposure to precipitation and to storm water will not result in a discharge of pollutants, or where exposure of a specific material or product poses little risk of storm water contamination (such as final products and materials intended for outdoor use); and
- Minimize the discharge of pollutants from spills and leaks and implement chemical spill and leak prevention and response procedures.

A permittee must include appropriate measures for any of the following activities that are used at the site.

### 4.8.1 **Washing of Equipment and Vehicles and Wheel Wash-Down.** If a permittee conducts washing of equipment or vehicles and/or wheel wash-down at the site the permittee must comply with the following requirements:

- 4.8.1.1 Designate areas to be used for washing of equipment and vehicles and/or wheel wash-down and conduct such activities only in these areas;
- 4.8.1.2 Locate such activities, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.;
- 4.8.1.3 Treat all wash water in a sediment basin or use alternative control measures that provide equivalent or better treatment prior to discharge; and
- 4.8.1.4 To comply with the prohibition in Part 4.7.1.4, the discharge of soaps and solvents used in equipment and vehicle washing and/or wheel wash-down is strictly prohibited.

### 4.8.2 **Fueling and Maintenance Areas.** If a permittee conducts fueling and/or maintenance activities for equipment and vehicles at the site the permittee must comply with the following requirements:

- 4.8.2.1 Designate areas to be used for fueling and/or maintenance of equipment and vehicles and conduct such activities only in these areas (the designated area may move from one location to another on linear projects);

- 4.8.2.2 Locate such activities, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.;
- 4.8.2.3 Minimize the exposure to precipitation and storm water or use secondary containment structures designed to eliminate the potential for spills or leaked chemicals; and
- 4.8.2.4 To comply with the prohibition in Part 4.7.1.3, a permittee must:
  - 4.8.2.4.1 Clean up spills or contaminated surfaces immediately;
  - 4.8.2.4.2 Ensure adequate clean up supplies are available at all times to handle spills, leaks, and disposal of used liquids;
  - 4.8.2.4.3 Use drip pans or absorbents under or around leaky equipment and vehicles; and
  - 4.8.2.4.4 Dispose of liquid wastes or materials used for fueling and maintenance in accordance with Part 4.8.6.
- 4.8.3 **Staging and Material Storage Areas.** If a permittee maintains staging and material storage areas at the site the permittee must comply with the following requirements:
  - 4.8.3.1 Designate areas to be used for staging and material storage areas;
  - 4.8.3.2 Locate such activities, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.; and
  - 4.8.3.3 Minimize the exposure to precipitation and storm water and vandalism for all chemicals, treatment chemicals, liquid products, petroleum products, and other materials that have the potential to pose a threat to human health or the environment.
- 4.8.4 **Washout of Applicators/Containers used for Paint, Concrete, and Other Materials.** If a permittee conducts washing of applicators and/or containers used for paint, concrete, and other materials at the site, the permittee must comply with the following requirements:
  - 4.8.4.1 Designate areas to be used for washout;
  - 4.8.4.2 Locate such activities, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.;
  - 4.8.4.3 Direct all concrete, paint, and other material washout activities into a lined, water-tight container or pit to ensure there is no discharge into the underlying soil and onto the surrounding areas;
  - 4.8.4.4 Dispose of liquid wastes in accordance with Part 4.8.6; and
  - 4.8.4.5 For concrete washout areas, remove hardened concrete waste when it has reached one-half (1/2) the height of the container or pit and dispose of in accordance with Part 4.8.6.
- 4.8.5 **Fertilizer or Pesticide Use.** If a permittee uses fertilizers or pesticides the permittee must comply with the following requirements:
  - 4.8.5.1 Application of fertilizers and pesticides in a manner and at application rates that will minimize the loss of chemical to storm water runoff. Manufacturers' label requirements for application rates and disposal requirements must be followed; and
  - 4.8.5.2 Use pesticides in compliance with federal, state, and local requirements.
- 4.8.6 **Storage, Handling, and Disposal of Construction Waste.** If a permittee stores, handles and/or disposes of construction waste at the site, the permittee must comply with the following requirements:
  - 4.8.6.1 Locate areas dedicated for management of construction waste, to the extent practicable, away from storm water conveyance channels, storm water inlets, and waters of the U.S.;



- 4.8.6.2 Dispose of all collected sediment, asphalt and concrete millings, floating debris, paper, plastic, fabric, construction and demolition debris and other domestic wastes according to federal, state and local requirements;
- 4.8.6.3 Store hazardous or toxic waste in appropriate sealed containers and dispose of these wastes in accordance with manufacture's recommended method of disposal or federal, state or local requirements; and
- 4.8.6.4 Provide containment of sanitation facilities (e.g., use of portable toilets) to prevent discharges of pollutants to the storm water drainage system or receiving water. Clean or replace sanitation facilities and inspect them regularly for leaks and spills.

#### **4.9 Spill Notification**

- 4.9.1 A permittee is prohibited from discharging hazardous substance or oil from a spill or other release. Upon discovery of a spill of a reportable quantity, a permittee must report the spill in accordance with Part 9.3.

#### **4.10 Projects near a Public Water System (PWS)**

- 4.10.1 Where the project intersects a PWS drinking water protection area (DWPA) (see Part 5.3.5.15), notify the PWS contact. PWS contact information can be obtained using the online application, Drinking Water Watch, <http://dec.alaska.gov:8080/DWW> by entering the appropriate 6-digit PWS ID (e.g., 225025).
- 4.10.2 Within the identified DWPA, restrict project activities that could significantly change the natural surface water drainage or groundwater gradient.
- 4.10.3 Immediately notify the nearby PWS of any identified potential contamination, such as spills or excess erosion.

#### **4.11 Permanent Storm Water Management Control**

A permittee must comply with applicable APDES MS4 permit requirements, local requirements, and the applicable requirements under 18 AAC 72.600 (i.e., Nondomestic Wastewater System Plan Review) regarding the design and installation of permanent storm water management controls. Structural measures should be placed on upland soils to the degree practicable and achievable.

- 4.11.1 A permittee who constructs, alters, installs, modifies, or operates any part of a permanent storm water management control at a site and is located outside a municipality operating under an APDES MS4 permit must submit a copy of the engineering plans in accordance with 18 AAC 72.600 to DEC for review to the Permitting Program in Appendix A Part 1.1.1 at least 30 calendar days before the commencement of construction.
- 4.11.2 A permittee who constructs, alters, installs, modifies, or operates any part of a permanent storm water management control measure at a site and is located inside a municipality operating under an APDES MS4 permit must submit a copy of the required submittal information to the respective MS4 operator for review. Permittees must contact the MS4 Operator for submittal deadlines. See <http://dec.alaska.gov/water/wastewater/stormwater/sw-municipal> for a list of MS4 Operators and their contact information

## 4.12 Winter Considerations

4.12.1 **Winter Shutdown.** A permittee who plans to cease construction during the winter and resume construction the next summer must plan for winter shutdown and prepare their site to manage storm water flows until construction activities resume. The permittee must identify the anticipated dates of fall freeze-up and spring thaw (see Appendix C) for their site and use these dates to plan for winter shutdown. **Frozen ground by itself is not considered an acceptable control measure for stabilization.**

4.12.1.1 A permittee must ensure the following measures are complete prior to fall freeze-up until construction activities resume:

4.12.1.1.1 Temporary or final stabilization for conveyance channels;

4.12.1.1.2 Temporary or final stabilization for disturbed slopes, disturbed soils, and soil stockpiles; and

4.12.1.1.3 Proper installation of erosion and sediment control measures in anticipation of spring thaw.

4.12.1.2 Where temporary stabilization is precluded by snow cover or frozen ground conditions prior to the anticipated date of Fall Freeze-up, stabilization measures must be initiated as soon as practicable following the actual spring thaw.

4.12.2 **Winter Construction.** A permittee conducting winter construction activities that may extend beyond spring thaw must install appropriate control measures to minimize erosion and sediment runoff during spring thaw and summer rainfall<sup>4</sup>.

Permit authorization is not required for the construction of ice roads or the placement of sand or gravel on frozen tundra with no excavation or potential to pollute waters of the U.S.

## 4.13 Maintenance of Control Measures

4.13.1 A permittee must maintain all control measures, good housekeeping measures, and other protective measures in effective operating condition. If site inspections required by Part 6.0 identify control measures, good housekeeping measures, or other protective measures that are not operating effectively, the permittee must implement corrective actions in accordance with Part 8.0.

4.13.2 If existing control measures need to be modified or if additional control measures are necessary for any reason, the permittee must complete any corrective action in accordance with the deadlines stated in Part 8.2.

4.13.3 A permittee must remove sediment from silt fences, check dams, berms or other controls before the accumulated sediment reaches:

4.13.3.1 One-third ( $\frac{1}{3}$ ) the distance up the above-ground height (or it reaches a lower height based on manufacturer's specifications) for silt fences;

4.13.3.2 One-half ( $\frac{1}{2}$ ) the distance up the above-ground height (or it reaches a lower height based on manufacturer's specifications or BMP guidance manuals) for storm water inlets, check dams, berms, or other control measure; or

4.13.3.3 For sediment traps or sediment ponds, the permittee must remove accumulated sediment when the design capacity has been reduced by fifty (50%) percent.

---

<sup>4</sup> The Alaska Storm Water Guide, Chapters 3 and 4, provide guidance on the selection, design, and installation of winter construction practices and controls.

#### **4.14 Storm Water Lead and Training of Employees**

A permittee must identify one “qualified person” (as defined in Appendix C) as the storm water lead/SWPPP Manager to ensure the control measures described in the SWPPP are implemented as written, or modified as necessary, during construction. The qualifications and training for the storm water lead/SWPPP Manager, SWPPP preparer, storm water inspector, and monitoring person for a site varies with the size of the project. A permittee must ensure that employees and subcontractors receive adequate training to ensure proper installation, maintenance, and removal of the control measures described in the SWPPP for the project.

#### **4.15 Applicable Federal, State, Tribal, or Local Requirements**

A permittee must ensure that the storm water control measures implemented at the site are consistent with all applicable federal, state, tribal, or local requirements for soil and erosion control and storm water management.

### **5.0 STORM WATER POLLUTION PREVENTION PLAN**

#### **5.1 Storm Water Pollution Prevention Plan (SWPPP)**

- 5.1.1 A permittee must prepare a SWPPP for each site before submitting their NOI for permit coverage and document the control measures implemented at the site. The SWPPP is intended to document the selection, design, installation, and implementation of control measures that are being used to comply with the requirements set forth in Parts 3.0 and 4.0.
- 5.1.2 The SWPPP must, at a minimum:
  - 5.1.2.1 Include the information described in Part 5.3.
  - 5.1.2.2 Be implemented as written, including any modifications for changes in design or field conditions, until the submittal of the NOT.
  - 5.1.2.3 Be developed by a “qualified person” (as defined in Appendix C).
  - 5.1.2.4 Be signed, dated, and certified in accordance with Appendix A, Part 1.12.

#### **5.2 Deadlines for SWPPP Preparation**

- 5.2.1 An operator must prepare a SWPPP before submitting the NOI for authorization under this permit.
- 5.2.2 A permittee with an ongoing project with authorization under a previous construction general permit and a SWPPP that was developed based on that permit must review and update the SWPPP prior to submitting the NOI for authorization under this permit (see Part 2.4.2.1.2).
- 5.2.3 A permittee must provide a copy of the applicable portions of the SWPPP, or site-specific training to each subcontractor who engages in soil disturbing activities prior to the subcontractor conducting any soil disturbing activity. Revisions to the SWPPP that affect the subcontractor’s soil disturbing activities must be provided to the subcontractor in a timely manner.

#### **5.3 SWPPP Contents**

At a minimum, the SWPPP must include the following:

**5.3.1 Permittee(s)**

Identify the permittee(s) for the site and any subcontractors that may work on the site, including the areas where the subcontractors may be or are expected to conduct activities covered by this permit.

**5.3.2 Storm Water Contact(s)**

Identify the following qualified person(s) responsible for the following (Note: A small project may have all these responsibilities carried out by one person):

- 5.3.2.1 Storm Water Lead;
- 5.3.2.2 Updating the SWPPP according to Part 5.9;
- 5.3.2.3 Conducting inspections according to Part 6.0;
- 5.3.2.4 Conducting monitoring (if applicable) according to Part 7.0; and
- 5.3.2.5 Operating an Active Treatment System (if applicable) according to 4.6.7.

**5.3.3 Project Site-Specific Conditions.** Briefly describe the existing site-specific conditions, including:

- 5.3.3.1 The mean annual precipitation based on the nearest weather station;
- 5.3.3.2 Site conditions such as soils, topography, drainage patterns, approximate growing season, and vegetation; and
- 5.3.3.3 Receiving waters such as impaired waters or waters listed in the Alaska Department of Fish & Game (ADF&G) Anadromous Waters Catalog.

**5.3.4 Nature of Construction Activity.** Briefly describe the nature of the construction activity, including:

- 5.3.4.1 The function of the project (e.g., low density residential, shopping mall, subdivision, airport, highway, etc.);
- 5.3.4.2 The intended sequence and timing of activities that disturb soils at the site;
- 5.3.4.3 Size of the property including support activities described in Part 1.4.2.3 (in acres) and the total area expected to be disturbed by excavation, grading, or other construction activities (in acres);
- 5.3.4.4 A general location map (e.g., USGS quadrangle map, a portion of a city or county map, or other map) with enough detail to identify the location of the construction site and waters of the U.S. within one mile of the site; and
- 5.3.4.5 Identification of all potential sources of pollutants that may reasonably be expected to affect the quality of the storm water discharges from the site.

**5.3.5 Site Map(s).** The SWPPP must contain a legible site map (or set of maps for large projects) showing the entire site and identifying the following site-specific information:

- 5.3.5.1 North Arrow and bar scale;
- 5.3.5.2 Boundaries of the property where construction activities will occur;
- 5.3.5.3 Locations where earth-disturbing activities will occur, noting any phasing of construction activities;
- 5.3.5.4 Location of areas that will not be disturbed and natural features to be preserved;
- 5.3.5.5 Location of all storm water conveyances including ditches, pipes, and swales;
- 5.3.5.6 Locations of storm water inlets and outfalls, with a unique identification code for each outfall;

- 5.3.5.7 Municipal separate storm sewer systems, if present;
  - 5.3.5.8 Direction(s) of storm water flow and approximate slopes anticipated after grading activities;
  - 5.3.5.9 Locations where control measures will be or have been installed;
  - 5.3.5.10 Locations where exposed soils will be stabilized or have been stabilized;
  - 5.3.5.11 Locations where post-construction storm water controls will be or have been installed;
  - 5.3.5.12 Locations of support activities described in Part 1.4.2.3;
  - 5.3.5.13 Locations where authorized non-storm water will be used, including the types that will be used on-site;
  - 5.3.5.14 Locations of all waters of the U.S. (including significant wetland areas 10,000 square feet or greater) on the site and those located within 2,500 feet of the site boundary that may be affected by storm water discharges from the site;
  - 5.3.5.15 Location of existing public water system (PWS) drinking water protection areas (DWPA) for PWS sources (e.g. springs, wells, or surface water intakes) that intersect the boundary of the proposed project/permit area. The DWPAs can be found using the interactive web map application, “*Alaska DEC Drinking Water Protection Areas*”, located at <http://dec.alaska.gov/das/GIS/apps.htm>.
  - 5.3.5.16 Locations where storm water and/or authorized non-storm water discharges to waters of the U.S. (including wetlands) or an MS4;
  - 5.3.5.17 Sampling Point(s) (if applicable): A permittee subject to the requirements of Parts 3.2 must include the location(s) of the storm water discharge sampling point(s). For a linear project, indicate which sampling points are considered substantially identical, in accordance with Part 7.3.5; and
  - 5.3.5.18 Areas where final stabilization has been accomplished and no further construction-phase permit requirements apply.
- 5.3.6 **Control Measures.** The SWPPP must describe and document the location of all control measures that will be installed and maintained to meet the requirements in Parts 3.0 and 4.0. For each major activity identified in the project description, the SWPPP must clearly document the following.
- 5.3.6.1 The type of control measure to be installed and maintained and the location on the site for installation.
  - 5.3.6.2 The general sequence during the construction process in which the control measures will be installed and made operational, as well as the manufacturer’s or BMP manual specifications for installation.
  - 5.3.6.3 The general sequence of the stabilization practices that will be used to achieve temporary or final stabilization on exposed portions of the site as required in Part 4.5.
  - 5.3.6.4 The type of treatment chemicals used on the site and a description of the general location of their use at the site, in accordance with in Part 4.6.
  - 5.3.6.5 The information submitted to DEC for an active treatment system, in accordance with Part 4.6.7.
  - 5.3.6.6 The good housekeeping measures that will be used at the site, if any, in accordance with Part 4.8.

- 5.3.6.7 A description of spill prevention and response measures that will be used at the site, in accordance with Part 4.9. The permittee may reference the existence of other plans for Spill Prevention and Control and Countermeasure (SPCC) for the project, provided that a copy of the other plan(s) is kept with the SWPPP.
- 5.3.6.8 A description of all permanent storm water management controls that will be installed at the site, including their location, in accordance with Part 4.11.
- 5.3.6.9 For projects that expect a winter shutdown, the SWPPP must provide a description of the following:
  - 5.3.6.9.1 Anticipated dates of fall freeze-up and spring thaw (as defined in Appendix C); and
  - 5.3.6.9.2 The methods the permittee will use to address winter considerations in accordance with Part 4.12.
- 5.3.6.10 A description of maintenance procedures for the control measures in accordance with Part 4.13.
- 5.3.6.11 A description of the training relevant to the construction activity and control measures used at the site in accordance with Part 4.14.
- 5.3.7 **Construction and Waste Materials.** The SWPPP must describe in general terms the type of construction and waste materials expected to be stored at the site with updates as appropriate and describe the measures for the handling and disposal of all wastes generated at the site, including clearing and demolition debris or other waste soils removed from the site, construction and domestic waste, hazardous or toxic waste, and sanitary waste.
- 5.3.8 **Locations of Other Industrial Storm Water Discharges.** The SWPPP must describe and identify the location of any storm water discharge associated with support activities described in Part 1.4.2.3. This includes storm water discharges from dedicated asphalt plants and dedicated concrete plants that are covered by this permit.
- 5.3.9 **Non-Storm Water Discharges.** The SWPPP must identify all authorized sources of non-storm water discharges listed in Part 1.4.3 of this permit, except for flows from fire-fighting activities that are combined with storm water discharges associated with construction activity at the site. The SWPPP must also describe the good housekeeping measures used to control or reduce non-storm water discharges.

## 5.4 Inspections

- 5.4.1 The SWPPP must document the procedures for performing site inspections specified by Part 6.0 of this permit, and where necessary, procedures for taking corrective actions in accordance with Part 8.0. At a minimum, the SWPPP must document the following:
  - 5.4.1.1 Person(s) or positions of person(s) responsible for conducting site inspections;
  - 5.4.1.2 Schedules to be followed for conducting inspections;
  - 5.4.1.3 Any inspection checklist or form that will be used to collect and summarize data and observations; and
  - 5.4.1.4 How conditions found that require corrective action will be addressed.
- 5.4.2 A record of each inspection and of any corrective actions taken in accordance with Part 8.0 must be retained with the SWPPP for at least three years from the date that permit authorization expires or is terminated.

## 5.5 Monitoring Plan (if applicable)

- 5.5.1 A permittee subject to the monitoring requirements in Part 3.2 must include a copy of the monitoring plan that complies with Part 7.0. At a minimum the SWPPP must document the following:
- 5.5.1.1 Person(s) or positions of person(s) responsible for conducting monitoring;
  - 5.5.1.2 Schedules to be followed for conducting the monitoring;
  - 5.5.1.3 Any monitoring checklist or form that will be used to record monitoring results; and
  - 5.5.1.4 How conditions found that require corrective action will be addressed.
  - 5.5.1.5 A record of each monitoring event,
  - 5.5.1.6 The annual report submitted to DEC in accordance with Part 9.1, and
  - 5.5.1.7 Any corrective actions taken in accordance with Part 8.0.
- 5.5.2 A record of each monitoring event and of any corrective actions taken in accordance with Part 7.0 and 8.0 must be retained with the SWPPP for at least three years from the date permit authorization expires or is terminated.

## 5.6 Documentation of Permit Eligibility Related to a Total Maximum Daily Load

The SWPPP must include documentation supporting a determination of permit eligibility with regards to waters that have an EPA-established or approved TMDL. See Part 3.2 for additional information to determine eligibility related to a TMDL. The SWPPP must include the following:

- 5.6.1 Identification of whether the discharge is identified, either specifically or generally, in an EPA-established or approved TMDL and any associated allocations, requirements, and assumptions identified for the discharge;
- 5.6.2 Summaries of consultation with state or federal TMDL authorities on consistency of SWPPP conditions with the approved TMDL; and
- 5.6.3 Measures taken by the permittee to ensure that the discharge of pollutants from the site is consistent with the assumptions and requirements of the EPA-established or approved TMDL, including any specific wasteload or load allocation that has been established that would apply to the discharge.

## 5.7 Documentation of Permit Eligibility Related to Endangered Species

The SWPPP must include documentation supporting a determination of permit compliance with regard to the Endangered Species Act (ESA), including:

- 5.7.1 Information on whether federally-listed endangered or threatened species or designated critical habitat may be in the project area;
- 5.7.2 Whether such species or critical habitat may be adversely affected by storm water discharges or storm water discharge-related activities from the project;
- 5.7.3 Results of the listed species and critical habitat screening determinations;
- 5.7.4 Any correspondence between the U.S. Fish and Wildlife Service (USFWS), EPA, National Marine Fisheries Service (NMFS), or others and the permittee regarding listed species and critical habitat, including any notification that delays the permittee's authorization to discharge under this permit; and
- 5.7.5 A summary description of measures necessary to protect federally-listed endangered or threatened species or federally-designated critical habitat.

## 5.8 Post-Authorization Records

5.8.1 **Copy of Permit Requirements.** The SWPPP must contain the following documents:

- 5.8.1.1 A copy of this permit;
- 5.8.1.2 A copy of the signed and certified NOI form submitted to DEC; and
- 5.8.1.3 Upon receipt, a copy of the letter from DEC authorizing permit coverage and providing the permit tracking number.

5.8.2 **Additional Documentation Requirements.** Summaries of the following information, or copies of the reports, must be maintained with the SWPPP by the permittee following authorization under this permit:

### 5.8.2.1 Grading and Stabilization Activities Log

- 5.8.2.1.1 Date(s) when grading activities occur;
  - 5.8.2.1.2 Description of Grading Activity and Location
  - 5.8.2.1.3 Date(s) when construction activities temporarily or permanently cease on a portion of the site;
  - 5.8.2.1.4 Date(s) when stabilization measures are initiated;
  - 5.8.2.1.5 Description of Stabilization Measure.
- 5.8.2.2 Date of beginning and ending period for winter shutdown;
  - 5.8.2.3 Copies of inspection reports as required in Part 5.4.2;
  - 5.8.2.4 Copies of rainfall monitoring as required in Part 7.3.9.2;
  - 5.8.2.5 Copies of monitoring reports or annual reports (if applicable) as required in Part 5.5.2 and 9.1.
  - 5.8.2.6 Log of SWPPP modifications;
  - 5.8.2.7 Documentation required in Part 4.6 (i.e. Material Safety Data Sheet, manufacturer and/or supplier test results, or employee training information)
  - 5.8.2.8 Records of employee training, including the date(s) training was received;
  - 5.8.2.9 Documentation of maintenance and repairs of control measures, including date(s) of regular maintenance, date(s) of discovery of areas in need of repair/maintenance, and date(s) that the control measure(s) returned to full function; and
  - 5.8.2.10 Description of any corrective action taken at the site, including the Corrective Action Log (Required in Permit Part 8.3) that records event(s) that caused the need for corrective action and dates when problems were discovered and modifications occurred, in accordance with Part 8.0.

## 5.9 Maintaining an Updated SWPPP

5.9.1 **SWPPP Modifications.** A permittee must modify the SWPPP, including site map(s) in response to any of the following:

- 5.9.1.1 Whenever changes are made to construction plans, control measures, good housekeeping measures, monitoring plan (if applicable), or other activities at the site that are no longer accurately reflected in the SWPPP. This includes changes made in response to corrective actions triggered under Part 8.0 and notifications by the permittee(s);
- 5.9.1.2 If inspections or investigations by site staff or by local, state, tribal or federal officials determine that SWPPP modifications are necessary for compliance with this permit; or



- 5.9.1.3 To reflect any revisions to applicable federal, state, tribal, or local law that affect the control measure implemented at the construction site.
- 5.9.2 **SWPPP Amendment Log.** A permittee must keep a log showing dates, name of person authorizing the change, and a brief summary of changes for all SWPPP modifications (e.g., adding new control measures, changes in project design, or storm events that cause for the replacement of control measures).
- 5.9.3 **Deadlines for SWPPP Modifications.** Revisions to the SWPPP must be completed within seven days of the inspection that identified the need for a SWPPP modification or within seven days of substantial modifications to the construction plans or changes in site conditions.

## 5.10 Additional SWPPP Requirements

### 5.10.1 Retention of the SWPPP

- 5.10.1.1 A copy of the SWPPP (including a copy of the permit), NOI, and acknowledgement letter from DEC must be retained at the construction site or other location easily accessible during normal business hours. If the permittee has day-to-day operational control over SWPPP implementation, the permittee must have a copy of the SWPPP available at a central location at the site for the use of all those identified as having responsibilities under the SWPPP whenever they are on the construction site. If an on-site location is unavailable to store the SWPPP when no personnel are present, notice of the plan's location must be posted near the main entrance at the site.

### 5.10.2 Main Entrance Signage

A sign or other notice must be posted conspicuously near the main entrance of the site. If there is insufficient space near the main entrance to post a sign or notice, the notice can be posted in a local public building such as the town hall or public library. For linear projects (e.g. highways or utilities) the sign or other notice must be posted at a location near the main entrance of the construction project (such as where a pipeline project crosses a public road) where the public may read it during non-business hours. At a minimum, the sign or other notice must contain the following information:

- 5.10.2.1 Permit authorization number assigned to the NOI,
- 5.10.2.2 Operator contact name and phone number for obtaining additional construction site information, and
- 5.10.2.3 The location of the SWPPP or the name and telephone number of the contact person for scheduling SWPPP viewing times. If the location of the SWPPP or the name and telephone number of the contact person for scheduling SWPPP viewing times has changed (i.e., is different than that submitted to DEC in the NOI), the current location of the SWPPP or name and telephone number of a contact person for scheduling viewing times.

### 5.10.3 Availability of SWPPP

- 5.10.3.1 A permittee is required to keep a current copy of the SWPPP at the site or other location easily accessible during normal business hours.
- 5.10.3.2 A permittee may move the location where the SWPPP is available during the winter shut down for a site that is expected to have a winter shutdown provided that the winter SWPPP location conforms to the requirements of Part 5.10.2.

- 5.10.3.3 A permittee must ensure that each subcontractor who engages in soil disturbing activities is provided access to a copy of the SWPPP and is familiar with relevant portion(s) thereof that relate to the subcontractor's activities at the project.
- 5.10.3.4 The SWPPP must be made available upon request by: DEC; EPA; a state, tribal or local agency approving sediment and erosion plans, grading plans, or storm water management plans; local government officials; the operator of a MS4 receiving discharges from the site; and representatives of the ADF&G, USFWS or the NMFS. An electronic or hard copy of the SWPPP must be made available in its entirety to DEC staff for review and copying upon request.
- 5.10.3.5 DEC may provide access to portions of the SWPPP to a member of the public upon request. Confidential Business Information (CBI) may be withheld from the public per Appendix A, Part 1.13, but may not be withheld from those staff cleared for CBI review within DEC, EPA, USFWS, or NMFS.

#### 5.10.4 Signature and Certification

The SWPPP must be dated, signed, and certified in accordance with the requirements of Appendix A, Part 1.12.

### 5.11 Requirements for Different Types of Operators

The permittee may meet one or both of the operational control components in the definition of operator found in Appendix C. Part 5.11.3 applies to all permittees having control over only a portion of a construction site.

- 5.11.1 If the permittee has operational control over construction plans and specifications, the permittee must ensure that:
  - 5.11.1.1 The project specifications meet the minimum requirements of this Part and all other applicable permit conditions;
  - 5.11.1.2 The SWPPP indicates the areas of the project where the permittee has operational control over project specifications, including the ability to make modifications in specifications;
  - 5.11.1.3 All other permittees implementing portions of the SWPPP (or their own SWPPP) who may be impacted by a change to the construction plan are notified of such changes in a timely manner; and
  - 5.11.1.4 The SWPPP indicates the name of the party(ies) with day-to-day operational control of those activities necessary to ensure compliance with the SWPPP or other permit conditions.
- 5.11.2 If the permittee has operational control over day-to-day activities, the permittee must ensure that:
  - 5.11.2.1 The SWPPP meets the minimum requirements of this Part and identifies the parties responsible for implementation of control measures identified in the plan;
  - 5.11.2.2 The SWPPP indicates areas of the project where the permittee has operational control over day-to-day activities; and
  - 5.11.2.3 The SWPPP indicates the name of the parties with operational control over project specifications (including the ability to make modifications in specifications).
- 5.11.3 If the permittee has operational control over only a portion of a larger common plan of development (e.g., one of four homebuilders in a subdivision), the permittee must ensure that:

- 5.11.3.1 They comply with all applicable control measures, terms, and conditions of this permit as it relates to the activities on the permittee's portion of the construction site, including, but not limited to: monitoring (if applicable), inspections, and protection of endangered species, and critical habitat..
- 5.11.3.2 They implement a portion of a comprehensive SWPPP or develop and implement a separate SWPPP that covers only their portion of the project in compliance with Part 5.1.
- 5.11.3.3 Activities on their portion of the site do not render another party's control measures ineffective.

## **6.0 INSPECTIONS**

### **6.1 Inspection Frequency**

- 6.1.1 A permittee must conduct inspections at one of the following schedules:
  - 6.1.1.1 Once every seven calendar days; or
  - 6.1.1.2 Once every 14 calendar days and within 24 hours of the end of a storm event that resulted in a discharge from the site; or
  - 6.1.1.3 For areas of the state where the mean annual precipitation is forty (40) inches or greater, or relatively continuous precipitation or sequential storm events, inspect at least once every seven (7) calendar days.
- 6.1.2 A permittee must specify in the SWPPP which schedule will be followed.

### **6.2 Case-by-Case Reductions in Inspection Frequency**

A permittee may reduce inspection frequency in the following situations:

- 6.2.1 If the entire site is stabilized in accordance with Part 4.5, a permittee may reduce the frequency of inspections to at least once every calendar month (minimum of 7 days separation between inspections) and within two business days of the end of a storm event at actively staffed sites that resulted in a discharge from the site;
- 6.2.2 If portions of the site have achieved final stabilization in accordance with Part 4.5 but construction activity remains on other portions of the site, a permittee may suspend inspections for those portions that have achieved final stabilization; however, the permittee must conduct subsequent inspections within two business days of the end of a storm event that results in a discharge from that portion of the site previously considered finally stabilized;
- 6.2.3 If the project is undergoing winter shutdown (as defined in Appendix C), implemented control measures with Part 4.12 Winter Considerations, and is documented in accordance with Part 5.3.6.9, a permittee may stop inspections 14 calendar days after the anticipated fall freeze-up and must resume inspections in accordance with Part 6.1 at least 21 calendar days prior to the anticipated spring thaw;
- 6.2.4 If the project is undergoing winter construction the inspection frequency can be reduced to once per month if runoff is unlikely due to continuous frozen conditions that are likely to continue at the site for at least three (3) months based on historic seasonal averages. If unexpected weather conditions (such as above freezing temperatures or rain events) make discharges likely, the permittee must immediately resume a regular inspection frequency; or

- 6.2.5 If the entire site has achieved final stabilization (as defined in Appendix C) and a NOT has been submitted, no further inspection requirements apply to the site.

### 6.3 Qualified Person

An inspection must be conducted by a qualified person (as defined in the Appendix C) provided by a permittee.

### 6.4 Site Inspection

- 6.4.1 **Location of Inspections.** During a site inspection, a permittee must at a minimum inspect the following areas of the site:
- 6.4.1.1 Areas of the site disturbed by construction activity (e.g., areas cleared, graded, or excavated);
  - 6.4.1.2 Areas used for storage of materials that are exposed to precipitation;
  - 6.4.1.3 Areas where control measures are installed and maintained at the site;
  - 6.4.1.4 Areas where sediment and other pollutants have accumulated or been deposited and may have the potential for or are entering the storm water conveyance system;
  - 6.4.1.5 Locations where vehicles enter or exit the site;
  - 6.4.1.6 Areas where storm water typically flows, including the storm water conveyance system;
  - 6.4.1.7 Points of discharge from the site. Where such discharge locations are inaccessible, the nearest downstream location must be inspected to the extent that such inspections are practicable; and
  - 6.4.1.8 Portions of the site where temporary or final stabilization measures have been initiated.
- 6.4.2 **Scope of Inspection.** At a minimum, the scope of the site inspection must include the following:
- 6.4.2.1 Check whether all control measures are installed and operating as intended and determine if any control measures need to be replaced, repaired, or maintained;
  - 6.4.2.2 Check for the presence of accumulated sediment near the project area boundary that has a potential for being washed outside of the project boundary on locations such as roadways or parking lots, storm water conveyance systems, storm water inlets, and discharge points;
  - 6.4.2.3 Check for the evidence of, or the potential for spills, leaks, or other accumulations of pollutants on the site entering the storm water conveyance system or waters of the U.S.;
  - 6.4.2.4 Describe visible areas where erosion has occurred near the project area boundary that has a potential for being washed outside of the project boundary;
  - 6.4.2.5 Identify any locations where new or modified control measures are necessary to meet the requirements in Part 4.0;
  - 6.4.2.6 Identify all points where there is a discharge from the site and describe the conditions that are contributing to that discharge (e.g., recent storm event with failure of a control measure); and
  - 6.4.2.7 Any incidents of noncompliance observed and corrective actions taken pursuant to Part 8.0.

## 6.5 Linear Project Inspections

- 6.5.1 Representative inspections may be performed at linear projects if the areas described in Part 6.4 are inaccessible, unsafe for personnel, would compromise stabilized areas, or would cause additional disturbance of soils.
- 6.5.2 Representative inspections must be performed by a qualified person (as defined in Appendix C).
- 6.5.3 To conduct representative inspections, a qualified person must inspect control measures along the site 0.25 mile above and below each access point where a roadway, undisturbed right-of-way, or other similar feature intersects the site and allows access to the areas described in Part 6.4. The conditions of the control measures along each inspected 0.25 mile segment may be considered as representative of the condition of control measures along that reach extending from the end of the 0.25 mile segment to either the end of the next 0.25 mile inspected segment, or to the end of the project, whichever occurs first.
- 6.5.4 If treatment chemicals are used then inspections must be conducted of all areas using the treatment chemicals.

## 6.6 Inspections by DEC or Applicable Government Authority

- 6.6.1 A permittee must allow an authorized representative of DEC, EPA, or the MS4 operator at any reasonable time to:
  - 6.6.1.1 Enter onto the site where a regulated construction activity is conducted or where records are kept under the conditions of this permit;
  - 6.6.1.2 Access and copy any records that must be kept under the conditions of this permit;
  - 6.6.1.3 Inspect any portion of the site, including any off-site staging areas or material storage areas and the erosion and/or sediment control measures; and
  - 6.6.1.4 Sample or monitor for the purpose of ensuring compliance.

## 6.7 Inspection Report

For each inspection required by this Part, the permittee must complete an inspection report.

- 6.7.1 At a minimum, the inspection report must include:
  - 6.7.1.1 The inspection date;
  - 6.7.1.2 Names, titles, and qualifications of personnel conducting the inspection;
  - 6.7.1.3 Weather information for the period since the last inspection (or since commencement of construction activity if the first inspection) including a general estimate of the beginning day of each storm event, duration of each storm event, and whether any discharges occurred (information from the nearest National Weather Service Station within 20 miles may be adequate provided it is representative of the actual site location if the permittee does not maintain a rain gauge on site);
  - 6.7.1.4 Weather information and a description of any discharges occurring at the time of the inspection;
  - 6.7.1.5 Location(s) of discharges of sediment or other pollutants from the site;
  - 6.7.1.6 Location(s) of control measures that need to be maintained;
  - 6.7.1.7 Location(s) of control measures that failed to operate as designed or proved inadequate for a particular location;

- 6.7.1.8 Location(s) where additional control measures are needed that did not exist at the time of inspection; and
- 6.7.1.9 Corrective action required, if any, including complete-by dates.
- 6.7.2 The inspection report must be signed in accordance with Appendix A, Part 1.12.

## 7.0 MONITORING

### 7.1 General Requirements

- 7.1.1 A permittee whose project is subject to Part 3.2 Discharge to Impaired Water Body is required to develop, implement, and modify a written site-specific plan for analytical monitoring that includes all the requirements of this Part and follows the applicable DEC Quality Assurance Guidance for a Water Quality Monitoring Plan<sup>5</sup>.
- 7.1.2 The DEC may notify the permittee of additional discharge monitoring requirements. Any such notice will briefly state the reasons for the monitoring, locations, and parameters to be monitored, frequency and period of monitoring, sample types, and reporting requirements.

### 7.2 Qualified Person

Monitoring must be conducted by a qualified person (as defined in Appendix C) provided by a permittee.

### 7.3 Discharge Monitoring Requirements

#### 7.3.1 Sampling Parameter

A permittee must sample for turbidity if the construction activity meets the requirements of Part 7.1.

#### 7.3.2 Sampling Frequency

- 7.3.2.1 Sampling must be conducted during or immediately following any storm event (as defined in Appendix C) or snowmelt event that results in a discharge from the site. For areas of the state described in Part 6.1.1.3, sample once per week following any storm event that results in a discharge from the site.
- 7.3.2.2 A permittee must collect at least two representative samples of the discharge. In the monitoring plan the permittee must characterize the number and frequency of samples to be measured/collected per discharge so as to represent the water quality conditions in the discharge (at minimum two samples per day per storm event).
- 7.3.2.3 A permittee is only required to collect samples during normal business hours and when conditions are safe for sampling personnel. When unsafe conditions (i.e., those that are dangerous or create inaccessibility for personnel) prevent the collection of samples, the permittee must conduct sampling of the discharge from the site as soon as the conditions are safe for sampling.
- 7.3.2.4 If a permittee is unable to collect a sample of the discharge due to unsafe conditions, the reason must be documented and attached to all required reports and records of the sampling activity.

---

<sup>5</sup> Detailed requirements can be accessed at the following web page: <http://dec.alaska.gov/water/water-quality/quality-assurance/>

### 7.3.3 Sampling Locations

- 7.3.3.1 The permittee is required to conduct sampling at all discharge points where storm water or authorized non-storm water is discharged to an impaired water body or as per Part 7.1.2.
- 7.3.3.2 Linear Projects are also subject to the visual monitoring requirements in Part 7.4.
- 7.3.3.3 All sampling locations must be identified on the SWPPP site map and be clearly marked in the field with a flag, tape, stake, or other visible marker.

### 7.3.4 Discharging to an Impaired Water body. If the project is subject to Part 3.2, the permittee is required to conduct sampling at the following locations:

- 7.3.4.1 At a representative location upstream from the point of discharge into receiving water body or outside the area of influence of the discharge; and
- 7.3.4.2 At a representative location downstream from the point of discharge into the receiving water body, inside the area of influence of the discharge. Alternatively, the sample may be taken at the point it leaves the construction site, rather than when it is in the receiving water body.

### 7.3.5 Representative Discharge Point for a Linear Project. If a linear project has two or more outfalls that discharge substantially identical effluents, based on similarities of the soil disturbance and construction activity occurring within the drainage areas of the discharge point, the permittee may collect a representative sample of the storm water discharge at one of the discharge points and report that the quantitative data also apply to the substantially identical discharge point(s). For this to be permissible, the permittee must describe the following in the monitoring plan:

- 7.3.5.1 Locations of the discharge points;
- 7.3.5.2 Why the discharge points are expected to discharge substantially identical pollutants; and
- 7.3.5.3 Estimates of the size of the drainage area (in square feet) for each of the discharge points.

### 7.3.6 Commingled Discharges. If, prior to discharging, storm water flow commingles with sources of storm water that originate outside of the construction site or on property that is not owned or operated by the permittee, the following applies:

- 7.3.6.1 A permittee is required to collect samples of discharges from the construction site that consist in part of storm water that originates outside of the construction site and discharges from the site; or
- 7.3.6.2 If storm water originates outside of the construction site then discharges from the permittee's property but does not come into contact with the site construction activities, the permittee is not required to sample this discharge.

### 7.3.7 Sample Type. All sampling performed by the permittee must be representative of the flow and characteristics of the discharge.

### 7.3.8 Sampling and Analysis Methods

- 7.3.8.1 Turbidity analysis must be performed with an EPA-approved field-calibrated nephelometer or turbidity meter (turbidimeter) for water quality measurements.
- 7.3.8.2 Samples required by this permit should be analyzed immediately.
- 7.3.8.3 Automatic sampling may be used; however, samples from automatic samplers must be collected no later than the next business day after their accumulation, unless flow through automated analysis is used and analyzed consistent with Part 7.3.8.2.

7.3.8.4 If the permittee cannot conduct field turbidity measurements, then all laboratory analysis must be conducted according to test procedures specified in 40 CFR §136, unless other test procedures have been specified in this permit. Samples must be preserved as required by the appropriate EPA-approved method of analysis and analyzed within specified holding times.

### 7.3.9 Rainfall Monitoring

7.3.9.1 A permittee must use a rain gauge on site or utilize the nearest National Weather Service (NWS) precipitation gauge station to determine the amount of rainfall during a storm event if the NWS gauge used is located within 20 miles of the site.

7.3.9.2 A permittee must maintain daily records of the rainfall amounts and dates of rainfall events as part of the SWPPP, in accordance with Part 9.4.

7.3.10 **Recording Monitoring Data.** A permittee must retain records of all sampling information and reports as part of the SWPPP, in accordance with Part 9.4. For each sample collected, the permittee must record the following:

7.3.10.1 The date, monitoring location, method, and time of sampling;

7.3.10.2 The name and title of the individual(s) who performed the sampling and analyses;

7.3.10.3 The date(s) analyses were performed;

7.3.10.4 The analytical techniques or methods used; and

7.3.10.5 The results of such analyses in nephelometric turbidity units (NTU) and all calibration and quality control information used to validate the measurement(s).

### 7.3.11 Reporting Monitoring Results

7.3.11.1 All monitoring data collected pursuant to Part 7.0 must be submitted to DEC, in accordance with Part 9.1, Annual Reports. (Note: The monitoring data collected under this Part does not need to conform to Appendix A Part 3.2.)

7.3.11.2 For each discharge point, a permittee must submit the following information:

7.3.11.2.1 Name of discharge point. If the discharge point is on a linear project and is representative of one or more substantially similar discharge points, include the names of the other discharge points;

7.3.11.2.2 Date sample(s) collected;

7.3.11.2.3 Result of each individual sample collected in NTUs, or, if no discharge occurred during the sampling period for that discharge point indicate no discharge;

7.3.11.2.4 The arithmetic mean of all samples collected for each day; and

7.3.11.2.5 If the sample result(s) are from a representative discharge point, indicate representative sample.

7.3.11.3 A permittee is required to report all sampling results, including those that reflect samples collected beyond the minimum frequency required in Part 7.3.2.

## 7.4 Visual Monitoring for a Linear Project

A permittee for a linear project subject to the monitoring requirements in Part 3.2 or Part 7.1 are also required to visually monitor drainage areas and discharge locations in portions of the site where temporary or final stabilization has been initiated and document monitoring activities with the procedures described in this Part.

7.4.1 **Visual Monitoring Frequency.** Visual monitoring must be conducted at least once every seven calendar days, and the permittee may choose to do it more frequently.



- 7.4.2 **Visual Monitoring Locations.** The inspector must visually observe discharge points in portions of the site where temporary or final stabilization has been initiated and each drainage area associated with the linear project for the presence of current (and indications of prior) discharges and their sources.
- 7.4.3 **Visual Monitoring Requirements.** During conditions at the project in which a discharge is occurring, the permittee must:
- 7.4.3.1 Observe and document the visual quality and characteristics of the discharge, including color, odor, floating, settled, or suspended solids, foam, oil sheen, and other obvious indicators of storm water pollutants; and
  - 7.4.3.2 Document whether control measures are operating effectively or are in need of maintenance.
- 7.4.4 **Recording Visual Monitoring Data.** A permittee must document the results of the visual monitoring and maintain this documentation with the SWPPP as required in Part 9.4. A permittee is not required to submit the visual monitoring findings to DEC, unless specifically requested to do so. At a minimum, the documentation of the visual monitoring must include:
- 7.4.4.1 The visual monitoring date;
  - 7.4.4.2 Name and title of personnel conducting the visual monitoring;
  - 7.4.4.3 Observations and documentation of the visual monitoring; and
  - 7.4.4.4 Any conditions requiring corrective action and a description of the corrective action.

## 8.0 CORRECTIVE ACTIONS

A permittee must take corrective actions as identified through the inspections conducted under Part 6.0 or as indicated by monitoring conducted under Part 7.0. This includes addressing the performance of control measures, including modifications to the selection, design, installation, and/or implementation of those control measures or to address permit violations.

### 8.1 Corrective Action Conditions

- 8.1.1 A permittee must review and revise the selection, design, installation, and implementation of their control measures whenever any of the following conditions are identified, discovered, or made aware of at the site:
- 8.1.1.1 An unauthorized release or prohibited discharge (e.g., spill, leak, or discharge of non-storm water not authorized by this or another APDES permit);
  - 8.1.1.2 Control measures are not designed, installed, and/or maintained as required in Part 4.0;
  - 8.1.1.3 The permittee becomes aware, or DEC determines that the control measures are not operating as intended or are not effective enough to meet the requirements of Part 3.1.2;
  - 8.1.1.4 An inspection by DEC or EPA official determines that modification to the control measures are necessary to meet the requirements of this permit;
  - 8.1.1.5 The accumulation or tracking of sediment in or near any storm water conveyance channels, storm water inlet, on roadways or parking lots outside the project area and adjacent to the site, in the immediate vicinity of control measures, at discharge points or entry points into the storm sewer system, or in other areas of the site; or

- 8.1.1.6 Pollutants (other than sediment such as trash or litter) have accumulated in or near any storm water conveyance channels, on roadways or parking lots within and adjacent to the site, in the immediate vicinity of control measures, at discharge points or entry points into the storm sewer system, or in other areas of the site.

## 8.2 Deadlines for Corrective Actions

- 8.2.1 A permittee must review the design, installation, and maintenance of control measures upon detecting any condition in Part 8.1.1 and document any corrective action(s) to be taken to eliminate or further investigate the deficiency and comply with the following:
  - 8.2.1.1 For conditions that are easily remedied (i.e., removal of tracked sediment, maintenance of control measures, or spill clean-up), the permittee must initiate appropriate steps to correct the problem within 24 hours from the time of discovery and correct the problem as soon as practicable; or
  - 8.2.1.2 If installation of a new control measure is needed or an existing control measure requires redesign and reconstruction or replacement, the permittee must install the new or modified measure and make it operational within seven calendar days from the time of discovery of the need for the corrective action, unless infeasible;
  - 8.2.1.3 If a discharge occurs during a local 2-year, 24-hour storm event, a corrective action as described in Part 8.1.1 must be initiated within 24 hours from the time of discovery of a discharge from the storm event;
  - 8.2.1.4 Monitoring, if required, must continue while corrective actions are being carried out.
- 8.2.2 Where a permittee takes corrective actions that could affect a subcontractor, the permittee must provide notification to the subcontractor within three calendar days of taking the corrective action.
- 8.2.3 Subcontractors must notify the permittee within 24 hours of becoming aware of any of conditions listed in Part 8.1.1.

## 8.3 Corrective Action Log

- 8.3.1 A permittee must document the following information in the corrective action log, within 24 hours of discovery of any condition listed in Part 8.1 or upon notification from a subcontractor:
  - 8.3.1.1 Date the problem was identified;
  - 8.3.1.2 Summary of corrective action taken or to be taken (or, for conditions triggering corrective actions identified in Part 8.1, where the determination is made that action is not necessary, the basis for this determination);
  - 8.3.1.3 Notice of whether SWPPP modifications were required as a result of this discovery or corrective action; and
  - 8.3.1.4 Date corrective action completed.
- 8.3.2 A permittee must retain a copy of the corrective action log on-site with the SWPPP as required in Part 9.4.

## 8.4 Corrective Action Report

If monitoring pursuant to Part 3.2 Discharge to Impaired Water Body exceeds a WQS, the permittee must submit a corrective action report consistent with Part 9.2; except when there is a discharge that results from a storm event in that same day that is larger than the local 2-year, 24-hour storm.

## 8.5 Substantially Identical Outfalls

- 8.5.1 If the event triggering correction action is linked to an outfall that represents other substantially identical outfalls, the permittees review must assess the need for corrective action for each outfall represented by the outfall that triggered the review. Any necessary changes to control measures that affect these other outfalls must also be made before the next storm event if possible, or as soon as practicable following that storm event.

## 9.0 REPORTING AND RECORDKEEPING

### 9.1 Annual Report

- 9.1.1 All water quality monitoring data collected by the permittee pursuant to Part 3.2 Discharge to Impaired Water Body or Part 7.0 Monitoring must be submitted to DEC in an annual report. The annual report form must be submitted to the appropriate address in Appendix A, Part 1.1.2 by December 31 of each year during construction and upon submittal of the NOT (see Part 10.0). (Note: The monitoring data reported under this part does not need to conform to Appendix A Part 3.2.)
- 9.1.2 Monitoring results must be presented in a clearly legible format in tabular form. Upon written notification, DEC may require the permittee to submit the monitoring results on a more frequent basis. Monitoring and analysis of any storm water discharge(s) or the receiving water(s) beyond the minimum frequency stated in this permit must be reported in a similar manner to DEC.
- 9.1.3 A permittee must sign and certify all annual reports in accordance with the requirements of Appendix A, Part 1.1.12, Signature Requirement and Penalties. All signed and certified legible original annual reports and all other reports and documents must be submitted to DEC Compliance and Enforcement Program address in Appendix A, Part 1.1.2.

### 9.2 Corrective Action Report

If a corrective action report is required by Part 8.4 or Appendix A, Part 3.5, a permittee must submit a corrective action report to DEC Compliance and Enforcement Program address in Appendix A, Part 1.1.2 no later than 14 calendar days after receiving the monitoring results. The report must include the following:

- 9.2.1 APDES Permit Tracking Number;
- 9.2.2 Project name, physical address and location;
- 9.2.3 Name of receiving water;
- 9.2.4 Monitoring data from the event that exceeded a WQS;
- 9.2.5 An explanation of the conditions that caused the excursion;
- 9.2.6 Steps taken or planned (should corrective actions not yet be complete) to correct the violation; and
- 9.2.7 An appropriate contact name, telephone number and e-mail address.

### 9.3 Spill of Hazardous Substances Report

- 9.3.1 A permittee is prohibited from discharging hazardous substances or oil from a spill or other release. Alaska state law (18 AAC 75.300) and Part 4.9 requires all oil and hazardous substance release be reported to DEC Spill Prevention and Response program. Spill reporting placards can be found at the following webpage:  
<http://dec.alaska.gov/spar/ppr/spill-information/reporting>.

9.3.2 To report a spill, call the nearest DEC Area Response Team Office and follow their reporting requirements:

- Southeast (Juneau) – 465-5340
- Central (Anchorage) – 269-3063
- Northern (Fairbanks) – 451-2121

9.3.3 Outside of normal business hours, the permittee must call (800) 478-9300 to report the spill as soon as the permittee has knowledge of the discharge.

#### **9.4 Retention of Records**

A permittee must retain the following records at the site or the records must be readily available at a designated alternate location during the life of the construction activity and for a minimum of three years from the date that authorization under this permit expires or is terminated. This period may be extended by request of DEC at any time.

9.4.1 Records of all data used to complete the NOI to be covered by this permit;

9.4.2 A copy of the SWPPP (including any modifications made during the term of this permit);

9.4.3 A copy of all monitoring information (if applicable) and reports required by this permit;

9.4.4 A copy of all inspection reports generated in accordance with Part 6.0;

9.4.5 Documentation related to noncompliance and corrective actions taken pursuant to Part 8.0; and

9.4.6 Any other reports and certifications required by this permit.

#### **9.5 Request for Submittal of Records**

The DEC may request copies of all or a portion of the information collected and maintained in the SWPPP. A permittee must provide a response to written requests for records to the Department within 30 calendar days of receipt of a written request.

### **10.0 TERMINATION OF PERMIT AUTHORIZATION**

#### **10.1 Submitting a Notice of Termination (NOT)**

10.1.1 To terminate permit coverage, a permittee must submit a complete and accurate NOT to DEC that certifies that one or more of the conditions in Part 10.2 have been met to terminate permit coverage. A permittee must comply with this permit until an NOT is submitted.

#### **10.2 When to Submit a Notice of Termination**

10.2.1 A permittee must submit an NOT within 30 calendar days after one or more of the following conditions have been met:

10.2.1.1 Final stabilization has been achieved on all portions of the site, in accordance with Part 4.5.2, for which a permittee is responsible, all ground disturbing construction activity or use of support activities has been completed, and all temporary BMP's have been removed;

10.2.1.2 A new permittee has assumed control according to Appendix A, Part 2.3, over all areas of the site that have not been finally stabilized;

- 10.2.1.3 Authorization under an individual permit or alternative APDES general permit has been obtained, unless DEC has required that a permittee obtain such coverage under authority of Part 2.8, in which case authorization under this permit will automatically terminate;
  - 10.2.1.4 For residential construction only, temporary stabilization has been completed and the residence has been transferred to the homeowner; or
  - 10.2.1.5 The planned construction activity identified on the original NOI was never initiated (e.g., no grading or earthwork was ever started) and plans for the construction have been permanently abandoned or indefinitely postponed.
- 10.2.2 A permittee subject to pending state or federal enforcement actions, including citizen suits brought under state or federal law, may not submit a NOT. The permittee must certify that it is not subject to any pending state or federal enforcement actions, including citizen suites brought under state or federal law<sup>6</sup>.

### 10.3 Submitting a Notice of Termination

- 10.3.1 A permittee must submit a NOT to terminate authorization under this permit. The complete and accurate NOT can be submitted either:
- 10.3.1.1 Electronically (strongly encouraged): Go to DEC's Water Online Application System (OASys) web page at <http://dec.alaska.gov/water/wastewater/stormwater/apdesenoi/> to prepare and submit electronic NOT (eNOT). Note: the eNOT will likely be processed more quickly.
  - 10.3.1.2 Paper NOT Form: Complete the form in Appendix E or access the form on DEC's APDES Storm Water Forms web page at <http://dec.alaska.gov/water/wastewater/stormwater/forms#CGP>. Once the form is complete, scan and email the entire form to DEC OPA. Submit a paper copy to DEC Permitting Program at the address listed in Appendix A, Section 1.1.1.
- 10.3.2 A permittee's authorization to discharge terminates at 11:59 pm of the day the NOT is signed.
- 10.3.3 If a permittee submits a NOT without meeting one or more of the conditions identified in Part 10.2, then the NOT is invalid and a permittee remains responsible for meeting the requirements of this permit until authorization is terminated pursuant to Part 10.3.2.

## 11.0 PERMIT REOPENER CLAUSE

### 11.1 Procedures for Modification or Revocation

Permit modification or revocation will be conducted according 18 AAC 83.130, 18 AAC 83.135, 18 AAC 83.140, or 18 AAC 83.145.

### 11.2 Water Quality Protection

If there is evidence indicating that the storm water discharges authorized by this permit cause, have the reasonable potential to cause or contribute to an excursion above any applicable WQS, the permittee may be required to obtain an individual permit in accordance with Part 2.8 of this permit, or the permit may be modified to include different limitations and/or requirements.

---

<sup>6</sup> [18 AAC 83.130\(k\)](#).

### **11.3 Timing of Permit Modification**

DEC may elect to modify the permit prior to its expiration (rather than waiting for the new permit cycle) to comply with any new statutory or regulatory requirements.

### **12.0 Electronic Reporting (E-Reporting) Rule (Phase II)**

Phase II of the E-Reporting rule will integrate electronic reporting for all reports required by the Permit (e.g., Annual Reports and Certifications) and implementation is expected to begin December 2023. Permittees should monitor DEC's E-Reporting Information website (<http://dec.alaska.gov/water/compliance/electronic-reporting-rule/>) for updates on Phase II of the E-Reporting Rule and will be notified when they must begin submitting all other reports electronically. Until such time, other reports by the Permit may be submitted in accordance with Appendix A – Standard Conditions.

### **13.0 Standard Conditions Applicable to Recording and Reporting**

The permittee must comply with the following recording and reporting requirements, as described in Appendix A, Standard Conditions unless specified in the body of the permit:

- Retention of Records, Part 1.11.2;
- Records Contents, Part 1.11.3
- Special Reporting Obligations, Part 2.0; and
- Monitoring, Recording, and Reporting Requirements, Part 3.0.

**Appendix A** Standard Permit Conditions  
APDES PERMIT  
NONDOMESTIC DISCHARGES

## TABLE OF CONTENTS

<b>1.0 Standard Conditions Applicable to All Permits.....</b>	<b>A-3</b>
1.1 Contact Information and Addresses .....	A-3
1.2 Duty to Comply.....	A-3
1.3 Duty to Reapply .....	A-4
1.4 Need to Halt or Reduce Activity Not a Defense.....	A-4
1.5 Duty to Mitigate.....	A-4
1.6 Proper Operation and Maintenance .....	A-4
1.7 Permit Actions .....	A-4
1.8 Property Rights .....	A-4
1.9 Duty to Provide Information.....	A-4
1.10 Inspection and Entry .....	A-5
1.11 Monitoring and Records .....	A-5
1.12 Signature Requirement and Penalties .....	A-6
1.13 Proprietary or Confidential Information .....	A-7
1.14 Oil and Hazardous Substance Liability.....	A-8
1.15 Cultural and Paleontological Resources .....	A-8
1.16 Fee.....	A-8
1.17 Other Legal Obligations.....	A-8
<b>2.0 Special Reporting Obligations .....</b>	<b>A-8</b>
2.1 Planned Changes.....	A-8
2.2 Anticipated Noncompliance.....	A-8
2.3 Transfers .....	A-9
2.4 Compliance Schedules .....	A-9
2.5 Corrective Information.....	A-9
2.6 Bypass of Treatment Facilities.....	A-9
2.7 Upset Conditions.....	A-10
2.8 Existing Manufacturing, Commercial, Mining, and Silvicultural Discharges.....	A-10
<b>3.0 Monitoring, Recording, and Reporting Requirements .....</b>	<b>A-11</b>
3.1 Representative Sampling .....	A-11
3.2 Reporting of Monitoring Results .....	A-11
3.3 Additional Monitoring by Permittee.....	A-11
3.4 Twenty-four Hour Reporting .....	A-11
3.5 Other Noncompliance Reporting .....	A-12
<b>4.0 Penalties for Violations of Permit Conditions.....</b>	<b>A-12</b>
4.1 Civil Action.....	A-12
4.2 Injunctive Relief.....	A-13
4.3 Criminal Action .....	A-13
4.4 Other Fines.....	A-13



Appendix A of the permit contains standard regulatory language that must be included in all APDES permits. These requirements are based on the regulations and cannot be challenged in the context of an individual APDES permit action. The standard regulatory language covers requirements such as monitoring, recording, reporting requirements, compliance responsibilities, and other general requirements. Appendix A, Standard Conditions is an integral and enforceable part of the permit. Failure to comply with a Standard Condition in this Appendix constitutes a violation of the permit and is subject to enforcement.

## 1.0 Standard Conditions Applicable to All Permits

### 1.1 Contact Information and Addresses

#### 1.1.1 Permitting Program

Documents, reports, and plans required under the permit and Appendix A are to be sent to the following address:

State of Alaska  
Department of Environmental Conservation  
Division of Water  
Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, Alaska 99501  
Telephone (907) 269-6285  
Fax (907) 269-3487  
Email: [DEC.Water.WQPermit@alaska.gov](mailto:DEC.Water.WQPermit@alaska.gov)

#### 1.1.2 Compliance and Enforcement Program

Documents and reports required under the permit and Appendix A relating to compliance are to be sent to the following address:

State of Alaska  
Department of Environmental Conservation  
Division of Water  
Compliance and Enforcement Program  
555 Cordova Street  
Anchorage, Alaska 99501  
Telephone Nationwide (877) 569-4114  
Anchorage Area / International (907) 269-4114  
Fax (907) 269-4604  
Email: [dec-wqreporting@alaska.gov](mailto:dec-wqreporting@alaska.gov)

### 1.2 Duty to Comply

A permittee shall comply with all conditions of the permittee's APDES permit. Any permit noncompliance constitutes a violation of 33 U.S.C 1251-1387 (Clean Water Act) and state law and is grounds for enforcement action including termination, revocation and reissuance, or modification of a permit, or denial of a permit renewal application. A permittee shall comply with effluent standards or prohibitions established under 33 U.S.C. 1317(a) for toxic pollutants within the time provided in the regulations that establish those effluent standards or prohibitions even if the permit has not yet been modified to incorporate the requirement.

### **1.3 Duty to Reapply**

If a permittee wishes to continue an activity regulated by this permit after its expiration date, the permittee must apply for and obtain a new permit. In accordance with 18 AAC 83.105(b), a permittee with a currently effective permit shall reapply by submitting a new application at least 180 days before the existing permit expires, unless the Department has granted the permittee permission to submit an application on a later date. However, the Department will not grant permission for an application to be submitted after the expiration date of the existing permit.

### **1.4 Need to Halt or Reduce Activity Not a Defense**

In an enforcement action, a permittee may not assert as a defense that compliance with the conditions of the permit would have made it necessary for the permittee to halt or reduce the permitted activity.

### **1.5 Duty to Mitigate**

A permittee shall take all reasonable steps to minimize or prevent any discharge in violation of this permit that has a reasonable likelihood of adversely affecting human health or the environment.

### **1.6 Proper Operation and Maintenance**

1.6.1 A permittee shall at all times properly operate and maintain all facilities and systems of treatment and control and related appurtenances that the permittee installs or uses to achieve compliance with the conditions of the permit. The permittee's duty to operate and maintain properly includes using adequate laboratory controls and appropriate quality assurance procedures. However, a permittee is not required to operate back-up or auxiliary facilities or similar systems that a permittee installs unless operation of those facilities is necessary to achieve compliance with the conditions of the permit.

1.6.2 Operation and maintenance records shall be retained and made available at the site.

### **1.7 Permit Actions**

A permit may be modified, revoked and reissued, or terminated for cause as provided in 18 AAC 83.130. If a permittee files a request to modify, revoke and reissue, or terminate a permit, or gives notice of planned changes or anticipated noncompliance, the filing or notice does not stay any permit condition.

### **1.8 Property Rights**

A permit does not convey any property rights or exclusive privilege.

### **1.9 Duty to Provide Information**

A permittee shall, within a reasonable time, provide to the Department any information that the Department requests to determine whether a permittee is in compliance with the permit, or whether cause exists to modify, revoke and reissue, or terminate the permit. A permittee shall also provide to the Department, upon request, copies of any records the permittee is required to keep under the permit.

## 1.10 Inspection and Entry

A permittee shall allow the Department, or an authorized representative, including a contractor acting as a representative of the Department, at reasonable times and on presentation of credentials establishing authority and any other documents required by law, to:

- 1.10.1 Enter the premises where a permittee's regulated facility or activity is located or conducted, or where permit conditions require records to be kept;
- 1.10.2 Have access to and copy any records that permit conditions require the permittee to keep;
- 1.10.3 Inspect any facilities, equipment, including monitoring and control equipment, practices, or operations regulated or required under a permit; and
- 1.10.4 Sample or monitor any substances or parameters at any location for the purpose of assuring permit compliance or as otherwise authorized by 33 U.S.C. 1251-1387 (Clean Water Act).

## 1.11 Monitoring and Records

A permittee must comply with the following monitoring and recordkeeping conditions:

- 1.11.1 Samples and measurements taken for the purpose of monitoring must be representative of the monitored activity.
- 1.11.2 The permittee shall retain records in Alaska of all monitoring information for at least three years, or longer at the Department's request at any time, from the date of the sample, measurement, report, or application. Monitoring records required to be kept include:
  - 1.11.2.1 All calibration and maintenance records,
  - 1.11.2.2 All original strip chart recordings or other forms of data approved by the Department for continuous monitoring instrumentation,
  - 1.11.2.3 All reports required by a permit,
  - 1.11.2.4 Records of all data used to complete the application for a permit,
  - 1.11.2.5 Field logbooks or visual monitoring logbooks,
  - 1.11.2.6 Quality assurance chain of custody forms,
  - 1.11.2.7 Copies of discharge monitoring reports, and
  - 1.11.2.8 A copy of this APDES permit.
- 1.11.3 Records of monitoring information must include:
  - 1.11.3.1 The date, exact place, and time of any sampling or measurement;
  - 1.11.3.2 The name(s) of any individual(s) who performed the sampling or measurement(s);
  - 1.11.3.3 The date(s) and time any analysis was performed;
  - 1.11.3.4 The name(s) of any individual(s) who performed any analysis;
  - 1.11.3.5 Any analytical technique or method used; and
  - 1.11.3.6 The results of the analysis.
- 1.11.4 Monitoring Procedures

Analyses of pollutants must be conducted using test procedures approved under 40 CFR Part 136, adopted by reference at 18 AAC 83.010, for pollutants with approved test procedures, and using test procedures specified in the permit for pollutants without approved methods.

## 1.12 Signature Requirement and Penalties

- 1.12.1 Any application, report, or information submitted to the Department in compliance with a permit requirement must be signed and certified in accordance with 18 AAC 83.385. Any person who knowingly makes any false material statement, representation, or certification in any application, record, report, or other document filed or required to be maintained under a permit, or who knowingly falsifies, tampers with, or renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be subject to penalties under 33 U.S.C. 1319(c)(4), AS 12.55.035(c)(1)(B), (c)(2) and (c)(3), and AS 46.03.790(g).
- 1.12.2 In accordance with 18 AAC 83.385, an APDES permit application must be signed as follows:
  - 1.12.2.1 For a corporation, a responsible corporate officer shall sign the application; in this subsection, a responsible corporate officer means:
    - 1.12.2.1.1 A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation; or
    - 1.12.2.1.2 The manager of one of more manufacturing, production, or operating facilities, if
      - 1.12.2.1.2.1 The manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations;
      - 1.12.2.1.2.2 The manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
      - 1.12.2.1.2.3 Authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
  - 1.12.2.2 For a partnership or sole proprietorship, by the general partner or the proprietor, respectively, shall sign the application.
  - 1.12.2.3 For a municipality, state, federal, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means:
    - 1.12.2.3.1 The chief executive officer of the agency; or
    - 1.12.2.3.2 A senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
- 1.12.3 Any report required by an APDES permit, and a submittal with any other information requested by the Department, must be signed by a person described in Appendix A, Part 1.12.2, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
  - 1.12.3.1 The authorization is made in writing by a person described in Appendix A, Part 1.12.2;

- 1.12.3.2 The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity, including the position of plant manager, operator of a well or a well field, superintendent, or position of equivalent responsibility; or an individual or position having overall responsibility for environmental matters for the company; and
- 1.12.3.3 The written authorization is submitted to the Department to the Permitting Program address in Appendix A, Part 1.1.1.
- 1.12.4 If an authorization under Appendix A, Part 1.12.3 is no longer effective because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Appendix A, Part 1.12.3 must be submitted to the Department before or together with any report, information, or application to be signed by an authorized representative.
- 1.12.5 Any person signing a document under Appendix A, Part 1.12.2 or Part 1.12.3 shall certify as follows:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

### **1.13 Proprietary or Confidential Information**

- 1.13.1 A permit applicant or permittee may assert a claim of confidentiality for proprietary or confidential business information by stamping the words "confidential business information" on each page of a submission containing proprietary or confidential business information. The Department will treat the stamped submissions as confidential if the information satisfies the test in 40 CFR §2.208, adopted by reference at 18 AAC 83.010, and is not otherwise required to be made public by state law.
- 1.13.2 A claim of confidentiality under Appendix A, Part 1.13.1 may not be asserted for the name and address of any permit applicant or permittee, a permit application, a permit, effluent data, sewage sludge data, and information required by APDES or NPDES application forms provided by the Department, whether submitted on the forms themselves or in any attachments used to supply information required by the forms.
- 1.13.3 A permittee's claim of confidentiality authorized under Appendix A, Part 1.13.1 is not waived if the Department provides the proprietary or confidential business information to the EPA or to other agencies participating in the permitting process. The Department will supply any information obtained or used in the administration of the state APDES program to the EPA upon request under 40 CFR §123.41, as revised as of July 1, 2005. When providing information submitted to the Department with a claim of confidentiality to the EPA, the Department will notify the EPA of the confidentiality claim. If the Department provides the EPA information that is not claimed to be confidential, the EPA may make the information available to the public without further notice.

### **1.14 Oil and Hazardous Substance Liability**

Nothing in this permit shall be construed to preclude the institution of any action or relieve a permittee from any responsibilities, liabilities, or penalties to which the permittee is or may be subject to under state laws addressing oil and hazardous substances.

### **1.15 Cultural and Paleontological Resources**

If cultural or paleontological resources are discovered because of this disposal activity, work that would disturb such resources is to be stopped, and the Office of History and Archaeology, a Division of Parks and Outdoor Recreation of the Alaska Department of Natural Resources (<http://www.dnr.state.ak.us/parks/oha/>), is to be notified immediately at (907) 269-8721.

### **1.16 Fee**

A permittee must pay the appropriate permit fee described in 18 AAC 72.

### **1.17 Other Legal Obligations**

This permit does not relieve the permittee from the duty to obtain any other necessary permits from the Department or from other local, state, or federal agencies and to comply with the requirements contained in any such permits. All activities conducted and all plan approvals implemented by the permittee pursuant to the terms of this permit shall comply with all applicable local, state, and federal laws and regulations.

## **2.0 Special Reporting Obligations**

### **2.1 Planned Changes**

2.1.1 The permittee shall give notice to the Department as soon as possible of any planned physical alteration or addition to the permitted facility if:

2.1.1.1 The alteration or addition may make the facility a “new source” under one or more of the criteria in 18 AAC 83.990(44); or

2.1.1.2 The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged if those pollutants are not subject to effluent limitations in the permit or to notification requirements under 18 AAC 83.610.

2.1.2 If the proposed changes are subject to plan review, then the plans must be submitted at least 30 days before implementation of changes (see 18 AAC 15.020 and 18 AAC 72 for plan review requirements). Written approval is not required for an emergency repair or routine maintenance.

2.1.3 Written notice must be sent to the Permitting Program address in Appendix A, Part 1.1.1.

### **2.2 Anticipated Noncompliance**

2.2.1 A permittee shall give seven days’ notice to the Department before commencing any planned change in the permitted facility or activity that may result in noncompliance with permit requirements.

2.2.2 Written notice must be sent to the Compliance and Enforcement Program address in Appendix A, Part 1.1.2.

## **2.3 Transfers**

- 2.3.1 A permittee may not transfer a permit for a facility or activity to any person except after notice to the Department in accordance with 18 AAC 83.150. The Department may modify or revoke and reissue the permit to change the name of the permittee and incorporate such other requirements under 33 U.S.C. 1251-1387 (Clean Water Act) or state law.
- 2.3.2 Written notice must be sent to the Permitting Program address in Appendix A, Part 1.1.1.

## **2.4 Compliance Schedules**

- 2.4.1 A permittee must submit progress or compliance reports on interim and final requirements in any compliance schedule of a permit no later than 14 days following the scheduled date of each requirement.
- 2.4.2 Written notice must be sent to the Compliance and Enforcement Program address in Appendix A, Part 1.1.2.

## **2.5 Corrective Information**

- 2.5.1 If a permittee becomes aware that it failed to submit a relevant fact in a permit application or submitted incorrect information in a permit application or in any report to the Department, the permittee shall promptly submit the relevant fact or the correct information.
- 2.5.2 Information must be sent to the Permitting Program address in Appendix A, Part 1.1.1.

## **2.6 Bypass of Treatment Facilities**

### **2.6.1 Prohibition of Bypass**

Bypass is prohibited. The Department may take enforcement action against a permittee for any bypass, unless:

- 2.6.1.1 The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
- 2.6.1.2 There were no feasible alternatives to the bypass, including use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. However, this condition is not satisfied if the permittee, in the exercise of reasonable engineering judgment, should have installed adequate back-up equipment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance; and
- 2.6.1.3 The permittee provides notice to the Department of a bypass event in the manner, as appropriate, under Appendix A, Part 2.6.2.

### **2.6.2 Notice of bypass**

- 2.6.2.1 For an anticipated bypass, the permittee submits notice at least 10 days before the date of the bypass. The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the conditions of Appendix A, Parts 2.6.1.1 and 2.6.1.2.
  - 2.6.2.2 For an unanticipated bypass, the permittee submits 24-hour notice, as required in 18 AAC 83.410(f) and Appendix A, Part 3.4, Twenty-four Hour Reporting.
  - 2.6.2.3 Written notice must be sent to the Compliance and Enforcement Program address in Appendix A, Part 1.1.2.
- 2.6.3 Notwithstanding Appendix A, Part 2.6.1, a permittee may allow a bypass that:

- 2.6.3.1 Does not cause an effluent limitation to be exceeded, and
- 2.6.3.2 Is for essential maintenance to assure efficient operation.

## 2.7 Upset Conditions

- 2.7.1 In any enforcement action for noncompliance with technology-based permit effluent limitations, a permittee may claim upset as an affirmative defense. A permittee seeking to establish the occurrence of an upset has the burden of proof to show that the requirements of Appendix A, Part 2.7.2 are met.
- 2.7.2 To establish the affirmative defense of upset, the permittee must demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that:
  - 2.7.2.1 An upset occurred and the permittee can identify the cause or causes of the upset;
  - 2.7.2.2 The permitted facility was at the time being properly operated;
  - 2.7.2.3 The permittee submitted 24-hour notice of the upset, as required in 18 AAC 83.410(f) and Appendix A, Part 3.4, Twenty-four Hour Reporting; and
  - 2.7.2.4 The permittee complied with any mitigation measures required under 18 AAC 83.405(e) and Appendix A, Part 1.5, Duty to Mitigate.
- 2.7.3 Any determination made in administrative review of a claim that noncompliance was caused by upset, before an action for noncompliance is commenced, is not final administrative action subject to judicial review.

## 2.8 Existing Manufacturing, Commercial, Mining, and Silvicultural Discharges

- 2.8.1 In addition to the reporting requirements under 18 AAC 83.410, an existing manufacturing, commercial, mining, and silvicultural discharger shall notify the Department as soon as that discharger knows or has reason to believe that any activity has occurred or will occur that would result in:
  - 2.8.1.1 The discharge, on a routine or frequent basis, of any toxic pollutant that is not limited in the permit, if that discharge will exceed the highest of the following notification levels:
    - 2.8.1.1.1 One hundred micrograms per liter (100 µg/L);
    - 2.8.1.1.2 Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile, 500 micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4,6-dinitrophenol, and one milligram per liter (1 mg/L) for antimony;
    - 2.8.1.1.3 Five times the maximum concentration value reported for that pollutant in the permit application in accordance with 18 AAC 83.310(c)-(g); or
    - 2.8.1.1.4 The level established by the Department in accordance with 18 AAC 83.445.
  - 2.8.1.2 Any discharge, on a non-routine or infrequent basis, of a toxic pollutant that is not limited in the permit, if that discharge will exceed the highest of the following notification levels:
    - 2.8.1.2.1 Five hundred micrograms per liter (500 µg/L);
    - 2.8.1.2.2 One milligram per liter (1 mg/L) for antimony;
    - 2.8.1.2.3 Ten times the maximum concentration value reported for that pollutant in the permit application in accordance with 18 AAC 83.310(c)-(g); or
    - 2.8.1.2.4 The level established by the Department in accordance with 18 AAC 83.445.



### **3.0 Monitoring, Recording, and Reporting Requirements**

#### **3.1 Representative Sampling**

A permittee must collect effluent samples from the effluent stream after the last treatment unit before discharge into the receiving waters. Samples and measurements must be representative of the volume and nature of the monitored activity or discharge.

#### **3.2 Reporting of Monitoring Results**

The permittee shall summarize monitoring results on the annual report form or approved equivalent. The permittee shall submit its annual report at the interval specified in the permit. The permittee shall sign and certify all annual reports and other reports in accordance with the requirements of Appendix A, Part 1.12, Signature Requirement and Penalties. The permittee shall submit the legible originals of these documents to the ADEC Compliance and Enforcement Program at the address in Appendix A, Part 1.1.2.

#### **3.3 Additional Monitoring by Permittee**

If the permittee monitors any pollutant more frequently than the permit requires using test procedures approved in 40 CFR Part 136, adopted by reference at 18 AAC 83.010, or as specified in this permit, the results of that additional monitoring must be included in the calculation and reporting of the data submitted in the DMR or annual report required by Appendix A, Part 3.2. All limitations that require averaging of measurements must be calculated using an arithmetic means unless the Department specifies another method in the permit. Upon request by the Department, the permittee must submit the results of any other sampling and monitoring regardless of the test method used.

#### **3.4 Twenty-four Hour Reporting**

A permittee shall report any noncompliance event that may endanger health or the environment as follows:

##### 3.4.1 A report must be made:

- 3.4.1.1 Orally within 24 hours after the permittee becomes aware of the circumstances, and
- 3.4.1.2 In writing within five days after the permittee becomes aware of the circumstances.

##### 3.4.2 A report must include the following information:

- 3.4.2.1 A description of the noncompliance and its causes, including the estimated volume or weight and specific details of the noncompliance;
- 3.4.2.2 The period of noncompliance, including exact dates and times;
- 3.4.2.3 If the noncompliance has not been corrected, a statement regarding the anticipated time the noncompliance is expected to continue; and
- 3.4.2.4 Steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.

##### 3.4.3 An event that must be reported within 24 hours includes:

- 3.4.3.1 An unanticipated bypass that exceeds any effluent limitation in the permit (see Appendix A, Part 2.6, Bypass of Treatment Facilities).
- 3.4.3.2 An upset that exceeds any effluent limitation in the permit (see Appendix A, Part 2.7, Upset Conditions).

- 3.4.3.3 A violation of a maximum daily discharge limitation for any of the pollutants listed in the permit as requiring 24-hour reporting.
- 3.4.4 The Department may waive the written report on a case-by-case basis for reports under Appendix A, Part 3.4 if the oral report has been received within 24 hours of the permittee becoming aware of the noncompliance event.
- 3.4.5 The permittee may satisfy the written reporting submission requirements of Appendix A, Part 3.4 by submitting the written report via e-mail, if the following conditions are met:
  - 3.4.5.1 The Noncompliance Notification Form or equivalent form is used to report the noncompliance;
  - 3.4.5.2 The written report includes all the information required under Appendix A, Part 3.4.2;
  - 3.4.5.3 The written report is properly certified and signed in accordance with Appendix A, Parts 1.12.3 and 1.12.5.;
  - 3.4.5.4 The written report is scanned as a PDF (portable document format) document and transmitted to the Department as an attachment to the e-mail; and
  - 3.4.5.5 The permittee retains in the facility file the original signed and certified written report and a printed copy of the conveying email.
- 3.4.6 The e-mail and PDF written report will satisfy the written report submission requirements of this permit provided the e-mail is received by the Department within five days after the time the permittee becomes aware of the noncompliance event and the e-mail and written report satisfy the criteria of Part 3.4.5. The e-mail address to report noncompliance is: [dec-wqreporting@alaska.gov](mailto:dec-wqreporting@alaska.gov)

### **3.5 Other Noncompliance Reporting**

A permittee shall report all instances of noncompliance not required to be reported under Appendix A, Parts 2.4 (Compliance Schedules), 3.3 (Additional Monitoring by Permittee), and 3.4 (Twenty-four Hour Reporting) at the time the permittee submits monitoring reports under Appendix A, Part 3.2. (Reporting of Monitoring Results). A report of noncompliance under this part must contain the information listed in Appendix A, Part 3.4.2 and be sent to the Compliance and Enforcement Program address in Appendix A, Part 1.1.2.

## **4.0 Penalties for Violations of Permit Conditions**

Alaska laws allow the State to pursue both civil and criminal actions concurrently. The following is a summary of Alaska law. Permittees should read the applicable statutes for further substantive and procedural details.

### **4.1 Civil Action**

Under AS 46.03.760(e), a person who violates or causes or permits to be violated a regulation, a lawful order of the Department, or a permit, approval, or acceptance, or term or condition of a permit, approval or acceptance issued under the program authorized by AS 46.03.020 (12) is liable, in a civil action, to the State for a sum to be assessed by the court of not less than \$500 nor more than \$100,000 for the initial violation, nor more than \$10,000 for each day after that on which the violation continues, and that shall reflect, when applicable:

- 4.1.1 Reasonable compensation in the nature of liquated damages for any adverse environmental effects caused by the violation, that shall be determined by the court according to the toxicity, degradability, and dispersal characteristics of the substance discharged, the sensitivity of the receiving environment, and the degree to which the discharge degrades existing environmental quality;
- 4.1.2 Reasonable costs incurred by the State in detection, investigation, and attempted correction of the violation;
- 4.1.3 The economic savings realized by the person in not complying with the requirements for which a violation is charged; and
- 4.1.4 The need for an enhanced civil penalty to deter future noncompliance.

## **4.2 Injunctive Relief**

- 4.2.1 Under AS 46.03.820, the Department can order an activity presenting an imminent or present danger to public health or that would be likely to result in irreversible damage to the environment be discontinued. Upon receipt of such an order, the activity must be immediately discontinued.
- 4.2.2 Under AS 46.03.765, the Department can bring an action in Alaska Superior Court seeking to enjoin ongoing or threatened violations for Department-issued permits and Department statutes and regulations.

## **4.3 Criminal Action**

Under AS 46.03.790(h), a person is guilty of a Class A misdemeanor if the person negligently:

- 4.3.1 Violates a regulation adopted by the Department under AS 46.03.020(12);
- 4.3.2 Violates a permit issued under the program authorized by AS 46.03.020(12);
- 4.3.3 Fails to provide information or provides false information required by a regulation adopted under AS 46.03.020(12);
- 4.3.4 Makes a false statement, representation, or certification in an application, notice, record, report, permit, or other document filed, maintained, or used for purposes of compliance with a permit issued under or a regulation adopted under AS 46.03.020(12); or
- 4.3.5 Renders inaccurate a monitoring device or method required to be maintained by a permit issued or under a regulation adopted under AS 46.03.020(12).

## **4.4 Other Fines**

Upon conviction of a violation of a regulation adopted under AS 46.03.020(12), a defendant who is not an organization may be sentenced to pay a fine of not more than \$10,000 for each separate violation (AS 46.03.790(g)). A defendant that is an organization may be sentenced to pay a fine not exceeding the greater of: (1) \$200,00; (2) three times the pecuniary gain realized by the defendant as a result of the offense; or (3) three times the pecuniary damage or loss caused by the defendant to another, or the property of another, as a result of the offense (AS 12.55.035(c)(B), (c)(2), and (c)(3)).

**Appendix B** Acronyms (for the purposes of this permit)

Abbreviations	
ADEC	Alaska Department of Environmental Conservation
ADF&G	Alaska Department of Fish & Game
AK-CESCL	Alaska Certified Erosion and Sediment Control Lead
APDES	Alaska Pollutant Discharge Elimination System
BMP	Best Management Practice
CESSWI	Certified Erosion, Sediment and Storm Water Inspector
CFR	Code of Federal Regulations
CGP	Construction General Permit
CISEC	Certified Inspector of Sediment and Erosion Control
CPESC	Certified Professional in Erosion and Sediment Control
CPISM	Certified Professional in Industrial Stormwater Management
CPSWQ	Certified Professional in Storm Water Quality
CWA	Clean Water Act
DWPA	Drinking Water Protection Areas
ELG	Effluent Limit Guideline
EPA	United States Environmental Protection Agency
ESA	Endangered Species Act
FWS	United States Fish and Wildlife Service
MS4	Municipal Separate Storm Sewer System
MSGP	Multi-Sector General Permit
NHPA	National Historic Preservation Act
NMFS	United States National Marine Fisheries Service
NOI	Notice of Intent
NOT	Notice of Termination
PAM	Polyacrylamides
POTW	Publicly Owned Treatment Works
PWS	Public Water Systems
SHPO	State Historic Preservation Office
SWPPP	Storm Water Pollution Prevention Plan
THPO	Tribal Historic Preservation Officer
TMDL	Total Maximum Daily Load
WQS	Water Quality Standard

## Appendix C Definitions

### Definitions

2-year, 24-hour storm event	Means the maximum 24-hour precipitation event with a probable recurrence interval of once in two (2) years, respectively.
Active Treatment System (ATS)	For the purposes of this permit, means a treatment system comprised of automated chemical dispensing, mechanical aeration, pumps, and/or mechanical filtration that employs chemical coagulation, chemical flocculation, or electrocoagulation in order to reduce turbidity caused by fine suspended sediment. The system may also use gravity separation, inert media filtration and absorptive media. It does not include the passive application of treatment chemicals through the use of pre-manufactured products (e.g. floc logs, floc blocks, etc).
Actively Staffed	Projects that employ a sufficient number of essential personnel to maintain day-to-day operations at a construction site. Examples of essential personnel usually include a project engineer, foreman, or inspectors.
Activity	Any “point source” or any other facility or activity (including land or appurtenances thereto) that is subject to regulation under the APDES program.
Alaska Climatic Regions	For the purposes of this permit, means the climatic region (Coastal, South-central, Western, Interior, and Arctic) that the construction activity is located.
Anionic Polyacrylamide	Means a negatively charged chemical agent that binds soil particles together, which promotes coagulation and rapid settling.
Arid Areas	Areas with an average total precipitation of 0 to 10 inches. See <a href="http://xmacis.rcc-acis.org/">xmacis.rcc-acis.org/</a> for precipitation data from the weather station closet to the construction project.
Best Management Practices (BMPs)	Schedules of activities, prohibitions of practices, maintenance procedures, and other management practices to prevent or reduce the discharge of pollutants to waters of the United States (U.S.). BMPs also include treatment requirements, operating procedures, and practice to control plant site runoff, spillage or leaks, sludge or waste disposal, or drainage from raw material storage.
Buffer	For the purposes of this permit, means a setback that establishes a no-disturbance vegetated zone along and around waters of the U.S.. The buffer consists of a dense turf or vegetation judiciously placed across the path of surface runoff in a way that promotes sheet flow that can reduce the velocity of flow, increase the likelihood of infiltration, and promote the trapping and settling of suspended matter. It may be used in combination with other control measures in a treatment train approach to promote erosion and sediment control.
Business Day (or work day)	A day on which work is performed on site. For State offices, typically, Monday thru Friday with the exception of state holidays. For state holidays, see <a href="http://doa.alaska.gov/calendar">http://doa.alaska.gov/calendar</a> .

Borrow Area	The areas where materials are dug for use as fill, either onsite or off-site.
Bypass	Defined in <a href="#">40 CFR §122.41</a> and incorporated here by reference. Bypass means the intentional diversion of waste streams from any portion of a treatment facility. See Appendix A, Part 2.6.
Cationic Treatment Chemical	For the purposes of this permit, means polymers, flocculants, or other chemicals that contain an overall positive charge. Among other things, they are used to reduce turbidity in storm water discharges by chemically bonding to the overall negative charge of suspended silts and other soil materials and causing them to bind together and settle out. Common examples of cationic treatment chemicals are chitosan and cationic PAM.
Clean Water Act (CWA)	Means the Clean Water Act or the Federal Water Pollution Control Act, 33 U.S.C. section 1251 et seq.
Clearing	For the purposes of this permit, means the cutting down and removal of trees and brush without the disturbance of soils and the root mass.
Coagulants	Are substances that cause clumping of particles in a discharge to settle out impurities, often induced by chemicals such as lime, alum, and iron salts.
Commencement of Construction Activities or Construction Activity	For the purposes of this permit, means the initial disturbance of soils associated with clearing that disturbs the vegetative mat/grubbing, grading, or excavating activities or other construction-related activities (e.g., stockpiling of fill material, establishment of staging areas, or development of project-specific material sources).
Common Plan of Development or Sale	<p>For the purposes of this permit, means a site where multiple separate and distinct construction activities may be taking place at different times on different schedules, but still under a single plan. Examples include:</p> <ol style="list-style-type: none"> <li>1) phased projects and projects with multiple filings or lots, even if the separate phases or filings/lots will be constructed under separate contract or by separate owners (e.g., a development where lots are sold to separate builders);</li> <li>2) a development plan for a rural infrastructure project that may be phased over multiple years and is under a consistent plan for long-term development (e.g., a project that is designed to be built over several years, however funding is available for those phases on a year-to-year basis). Projects that have multiple year development plans but have year-to-year funding shall file NOI and NOT at the beginning and end of each funded phase of the project; and</li> <li>3) projects in a contiguous area that may be unrelated but still under the same contract, such as construction of a building extension and a new parking lot at the same facility.</li> </ol> <p>If the project is part of a common plan of development or sale, the disturbed area of the entire plan shall be used in determining permit requirements. For land subdivided for residential lots, see the definition of ‘Residential Subdivision’ for further discussion of the requirements.</p>

Where discrete construction projects within a larger common plan of development or sale are located one-quarter mile or more apart and the area between the projects is not being disturbed, each individual project can be treated as a separate plan of development or sale provided any interconnecting road, pipeline or utility project that is part of the same “common plan” is not being disturbed. If a utility company is constructing new trunk lines off an existing transmission line to serve separate residential subdivisions located more than one-quarter mile apart, the two trunk line projects could be considered to be separate projects.

Control Measure	For the purposes of this permit, refers to any BMP or other method used to prevent or reduce the discharge of pollutants to waters of the U.S..
Construction and Development Rule (C&D Rule)	As published in 40 CFR §450 is the regulation requiring effluent limitations guidelines (ELG’s) and new source performance standards (NSPS) for controlling the discharge of pollutants from construction sites.
Disaster	Has the meaning in AS 26.23.900. As defined in AS 26.23.900 the term includes, but is not limited to, the occurrence or imminent threat of widespread or severe damage, injury, loss of life or property, or shortage of food, water, or fuel resulting from an incident such as storm, high water, wind-driven water, tidal wave, tsunami, earthquake, volcanic eruption, landslide, mudslide, avalanche, snowstorm, prolonged extreme cold, drought, fire, flood, epidemic, explosion, or riot; the release of oil or a hazardous substance if the release requires prompt action to avert environmental danger or mitigate environmental damage; and equipment failure if the failure is not a predictably frequent or recurring event or preventable by adequate equipment maintenance or operation.
Disaster Emergency	For the purposes of this permit, means the condition declared by proclamation of the governor or declared by the principal executive officer of a political subdivision to designate the imminence or occurrence of a disaster.
Department or DEC	Refers to the Alaska Department of Environmental Conservation
Discharge	When used without qualification means the “discharge of a pollutant”
Discharge of Storm Water Associated with Construction Activity	For the purposes of this permit, refers to a discharge of pollutants in storm water from areas where soil disturbing activities (e.g., clearing, grading, or excavation), construction materials or equipment storage or maintenance (e.g., fill piles, borrow area, concrete truck chute washdown, fueling), or other industrial storm water directly related to the construction process (e.g., concrete or asphalt batch plants) are located.
Discharge Point	Means the location where collected and concentrated storm water flows are discharged from the construction site.

Disturbed Area	Is a portion of any site that has been altered from pre-existing conditions, including but not limited to the following: providing access to a site, grubbing and clearing of vegetation (including the roots), grading, earth moving, altering land forms, and other construction-related activities (such as placement of project related stockpiles atop a soil surface).
Effluent	For the purposes of this permit, means any discharge of storm water and allowable non-storm water by a permittee either to the receiving water or beyond the property boundary controlled by the permittee.
Effluent Limit Guideline	Defined in 40 CFR §122.a as a regulation published by the Administrator under section 304(b) of the Clean Water Act to adopt or review effluent limitations.
Electronic Notice of Intent (eNOI)	For the purposes of this permit, means the ADEC online system for submitting electronic Construction General Permit forms.
Eligible	Qualified for authorization to discharge storm water under this general permit.
Equivalent Analysis Waiver	Means a waiver, available only to small construction activities which discharge to non-impaired waters only, based on the permittee performance of an equivalent analysis using existing instream concentrations, expected growth in pollutant concentrations from all sources, and a margin of safety
Erosion	Is the process of wearing away of the land surface by water, wind, ice, gravity, or other geologic agents.
Erosion Control Measures	Are control measures intended to minimize dislodging and mobilizing of sediment particles
Excavation Dewatering	The practice of dewatering excavation areas through the use of pumps placed within the excavation or well pumps in adjacent dewatering wells which lower the water table to provide a relative dry working condition.
Exceptional Recreational or Ecological Significance	For the purposes of this permit, means a waterbody that is important, unique, or sensitive ecologically and has been designated as an Outstanding Natural Resource Water or Tier 3 water.
Fall Freeze-up	For the purposes of this permit, means for planning purposes in the development of the SWPPP and initial planning of control measure maintenance the date in the fall that air temperatures will be predominately below freezing. It is the date in the fall that has an 80% probability that a minimum temperature below a threshold of 32.5 degrees Fahrenheit will occur on or after the given date. This date can be found by looking up the “Fall ‘Freeze’ Probabilities” for the weather station closest to the site on the website <a href="http://www.wrcc.dri.edu/summary/Climsmak.html">www.wrcc.dri.edu/summary/Climsmak.html</a> . Alternatively, the Fall Freeze-up can be estimated by using the 5-year moving average from the First/Last dates where the minimum temperature below a threshold of 32.5 degrees Fahrenheit will occur on or after the given date for the weather station closest to the site on the website <a href="http://xmacis.rcc-acis.org">xmacis.rcc-acis.org</a> . NOTE: this estimation of “Fall Freeze-up” is for planning purposes only. During construction the permittee will need to maintain control measures based on actual conditions.



Facility	See “activity.”
Federal Facility	Any buildings, installations, structures, land, public works, equipment, aircraft, vessels, and other vehicles and property, owned by, or constructed or manufactured for the purpose of leasing to, the Federal government.
Field Measurements	Are testing procedures performed in the field with portable field-testing kits or meters.
Fill-only projects	For the purposes of this permit, means projects where the road prism or gravel pad is constructed using low-erodible fill material placed over an undisturbed vegetative mat. Typically, there is not soil disturbance that may be subject to erosion.
Flocculants	Are substances that interact with suspended particles and bind them together to form flocs. These flocs more readily settle out compared to individual particles.
Frozen Ground	For the purposes of this permit, is characterized by soil temperature below freezing. Frozen ground by itself is not considered an acceptable stabilization control measure. It may be used in combination with control measures (e.g. track walking, downgradient control measures, etc.)
Good Housekeeping Measures	For the purposes of this permit, means storm water controls designed to reduce or eliminate the addition of pollutants to construction site discharges through analysis of pollutant sources, implementation of proper handling and/or disposal practices, employee education, and other actions.
Grubbing	For the purposes of this permit, means the stripping and removal of the root mass on or near the ground surface. This is considered soil disturbance activity and requires coverage under this permit.
Hazardous Materials or Hazardous Substances or Hazardous or Toxic Waste	For the purposes of this permit, any liquid, solid, or contained gas that contain properties that are dangerous or potentially harmful to human health or the environment. See also 40 CFR §261.2.
Immediately	No later than the end of the next <u>work day</u> , following the day when the earth-disturbing activities have temporarily or permanently ceased.
Impaired Water	(or “Water Quality Impaired Water” or “Water Quality Limited Segment”) is defined as a water that is impaired for purposes of this permit if it has been identified by the State of Alaska or EPA pursuant to Section 303(d) of the Clean Water Act as not meeting applicable State WQSs (These waters are called “water quality limited segments” under 40 CFR §30.2(j)). Impaired waters include both waters with approved or established TMDLs, and those for which a TMDL has not yet been approved or established. For more information and current listing of impaired waters, see <a href="http://dec.alaska.gov/water/water-quality/impaired-waters">http://dec.alaska.gov/water/water-quality/impaired-waters</a> .

Indian Country	Defined at 40 CFR §122.2 to mean: <ol style="list-style-type: none"><li>1. All land within the limits of any Indian reservation under the jurisdiction of the United States Government, notwithstanding the issuance of any patent, and including rights-of-way running through the reservation;</li><li>2. All dependent Indian communities with the borders of the United States whether within the originally or subsequently acquired territory thereof and whether within or without the limits of a state; and</li><li>3. All Indian allotments, the Indian titles to which have not been extinguished, including rights-of-ways running through the same.</li></ol>
Infeasible	Defined in <a href="#">40 CFR §450.11</a> and incorporated here by reference. Infeasible means not technologically possible, or not economically practicable and achievable in light of best industry practices.
Large Construction Activity	Defined at 40 CFR §122.26(b)(14)(x) and incorporated here by reference. A large construction activity includes clearing, grading, and excavating resulting in a land disturbance that will disturb equal to or greater than five acres of land or will disturb less than five acres of total land area but is part of a larger common plan of development or sale that will ultimately disturb equal to or greater than five acres. Large construction activity does not include routine maintenance that is performed to maintain the original line and grade, hydraulic capacity of conveyance channels, or original purpose of the site.
Linear Project	Is a land disturbing activity as conducted by an underground/overhead utility or highway department, including but not limited to any cable line or wire for the transmission of electrical energy; any conveyance pipeline for transportation of gaseous or liquid substance; any cable line for communications; or any other energy resource transmission right-of-way or utility infrastructure (e.g., roads and highways) along a long narrow area.
Maintenance	Activities performed to maintain the original line and grade, hydraulic capacity of conveyance channels, or original purpose of the site. For the purposes of this permit, means projects that repair, rehabilitate, or replace existing structures or facilities, provided that the maintenance activity does not change the original purpose of the structure or facility. Maintenance may include minor deviations in the configuration of the structure or facility due to changes in materials, construction methods, or current construction codes or safety standards.
Master Plan	For the purposes of this permit, means if the permittee has a long-range master plan of development (e.g. a rural infrastructure improvement project or military base construction) where some portions of the master plan are a conceptual rather than a specific plan of future development and the future construction activities would, if they occur at all, happen over an extended time period, the permittee may consider the “conceptual” phases of a master plan to be separate “common plans” provided the periods of construction for the physically interconnected phases do not overlap.

Mean Annual Precipitation	This is the average total precipitation based on weather records. This data is available on the website for the Western Regional Climate Center <a href="https://xmacis.rcc-acis.org/">https://xmacis.rcc-acis.org/</a> .
Minimize	To reduce and/or eliminate to the extent achievable using control measures and good housekeeping measures that are technologically available and economically practicable and achievable in light of best industry practices.
Minimize Pollutant Discharge	See 'Minimize'
Municipality	A home rule municipality is a municipal corporation and political subdivision. It is a city or a borough that has adopted a home rule charter, or it is a unified municipality. A home rule municipality has all legislative powers not prohibited by law or charter. (§ 3 ch 74 SLA 1985) A general law municipality is a municipal corporation and political subdivision and is an unchartered borough or city. It has legislative powers conferred by law. (§ 3 ch 74 SLA 1985)
Municipal Separate Storm Sewer System (MS4)	<p>Defined at 40 CFR §122.26(b)(8) to mean a conveyance or system of conveyances (including roads with drainage systems, municipal streets, catch basins, curbs, gutters, ditches, manmade channels, or storm drains):</p> <ol style="list-style-type: none"> <li>1. Owned and operated by a state, city, town, borough, county, parish, district, association, or other public body (created by or pursuant to State law) having jurisdiction over disposal of sewage, industrial wastes, storm water, or other wastes, including special districts under State law such as a sewer district, flood control district or drainage district, or similar entity, or an Indian tribe or an authorized Indian tribal organization, or a designated and approved management agency under Section 208 of the CWA that discharges to waters of the U.S.;</li> <li>2. Designed or used for collecting or conveying storm water;</li> <li>3. Which is not a combined sewer; and</li> <li>4. Which is not part of a Publicly Owned Treatment Works (POTW) as defined at 40 CFR §122.2.</li> </ol>
Nephelometric Turbidity Unit (NTU)	Is an expression of the optical property that causes light to be scattered and absorbed rather than transmitted in a straight line through the water.
New Project	The "commencement of construction" occurs after the effective date of this permit.
New Source	For the purpose of this permit, is any source whose discharges are defined in 40 CFR §122.26(b)(14)(x) and (b)(15), that commences construction activity after the effective date of the new Construction & Development rule.
New Source Performance Standards (NSPS)	Are technology-based standards for a construction site that qualifies as new source under 40 CFR §450.24.

Non-Storm Water Discharges	Are discharges that do not originate from storm events. They can include, but are not limited to, discharges of process water, air conditioner condensate, non-contact cooling water, vehicle wash water, sanitary wastes, concrete washout water, paint wash water, irrigation water, or pipe testing water.
Notice of Intent (NOI)	Is the form required to be submitted by an applicant to the Department to obtain authorization of coverage under the Alaska Construction General Permit.
Notice of Termination (NOT)	Is the form required for terminating coverage under the Alaska Construction General Permit.
Ongoing Project	The “commencement of construction” occurs before the effective date of this permit.
Operator	<p>For the purpose of this permit, and in the context of storm water associated with construction activity, means any person associated with a construction project that meets either of the following two criteria:</p> <ol style="list-style-type: none"> <li>1. The person has operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications; or</li> <li>2. The person has day-to-day operational control of those activities at a site which are necessary to ensure compliance with a SWPPP for the site or other permit conditions (e.g., the person is authorized to direct workers at a site to carry out activities required by the SWPPP or comply with other permit conditions). This definition is provided to inform permittees of the Department’s interpretation of how the regulatory definitions of “owner or operator” and “facility or activity” are applied to discharges of storm water associated with construction activity.</li> </ol> <p>Subcontractors generally are not considered operators for the purposes of this permit.</p>
Owner	For the purposes of this permit, means the owner of any “facility or activity” subject to regulation under the APDES program.
Outfall	See ‘Discharge Point.’
Permanent Storm Water Management Controls	For the purposes of this permit, refers to “Nondomestic wastewater treatment works” as described in 18 AAC 72.990. These controls include: dry extended detention ponds, constructed wetlands, wet ponds, sand filters, oil/grit separator, rotational flow separators, etc.
Permitted Ongoing Project	Is a construction project that commenced prior to the effective date of this permit, which has been covered by a prior general permit for storm water discharges.
Permittee	Is a person who is authorized to discharge pollutants to waters of the U.S. in accordance with the conditions and requirements of this permit.

Person	For the purposes of this permit, means any public or private entity including but not limited to an individual, trust, firm, joint stock company, corporation (including government corporation), partnership, association, federal agency, state agency, city, borough, municipality, commission, political subdivision of the State, any interstate body or tribe.
Point Source	Any discernible, confined, and discrete conveyance, including but not limited to, any pipe, ditch, channel, tunnel, conduit, well, discrete fissure, container, rolling stock concentrated animal feeding operation, landfill leachate collection system, vessel or other floating craft from which pollutants are or may be discharged. This term does not include return flows from irrigated agriculture or agricultural storm water runoff.
Pollutant	Defined at 40 CFR §122.2. A partial listing from this definition includes: dredged spoil, solid waste, sewage, garbage, sewage sludge, chemical wastes, biological materials, heat, wrecked or discarded equipment, rock, sand, cellar dirt, and industrial or municipal waste.
Pollution Prevention Measures	See “Good Housekeeping Measures.”
Polyacrylamide (PAM)	For the purposes of this permit, is a long-chain organic polymer developed to clarify drinking water that has many other beneficial uses including erosion control, enhanced infiltration, and nutrient removal. Some forms of PAM can be used to stabilize soils and remove fine suspended sediments from storm water runoff. In powder form PAM is easy to store, easy to transport, and is not a health concern when used as directed. PAM dissolved in nonaqueous emulsions are not recommended for use in this permit.
Polymers	For the purposes of this permit, means coagulants and flocculants used to enhance sediment removal capabilities of check dams, sediment traps, or basins. Common construction site polymers include polyacrylamide (PAM), chitosan, alum, polyaluminum chloride, and gypsum. A permittee using polymers should carefully consider the appropriateness of usage of these materials where there are sensitive or protected aquatic organisms in the receiving waters, including threatened or endangered species and their critical habitat.
Post-Construction Discharges	For the purposes of this permit, means the storm water discharges occurring after construction has been completed and final stabilization has been attained.
Practicable	For the purposes of this permit, means capable of being done after taking into consideration costs, existing technology, standards of construction practice, impacts to water quality, site conditions, and logistics in light of the overall project purpose.
Project Area	For the purposes of this permit, meant that

1. The areas on the construction site where storm water discharges originate and flow toward the point of discharge into the receiving waters (including areas where excavation, site development, or other ground disturbance activities occur) and the immediate vicinity. (Example: 1. Where bald eagles nest in a tree that is on or bordering a construction site and could be disturbed by the construction activity. 2. Where grading causes storm water to flow into a small wetland or other habitat that is on the site that contains listed species.)
2. The areas where storm water discharges flow from the construction site to the point of discharge into receiving waters. (Example: Where storm water flows into a ditch, swale, or gully that leads to receiving waters and where listed species (such as amphibians) are found in the ditch, swale, or gully.)
3. The areas where storm water from construction activities discharge into receiving waters and the areas in the immediate vicinity of the point of discharge. (Example: Where storm water from construction activities discharges into a stream segment that is known to harbor listed aquatic species.)
4. The areas where storm water BMPs will be constructed and operated, including any areas where storm water flows to and from BMPs. (Example: Where a storm water retention pond would be built.)
5. The areas upstream and /or downstream from construction activity that discharges into a stream segment that may be affected by the discharges. (Example: Where sediment discharged to a receiving stream settles downstream and impacts a breeding area of a listed aquatic species.)

## Qualified Person

Given the range in size and types of projects in Alaska the following is a description of the experience and skills of a “qualified person” for the different roles typically required at a site to ensure compliance with this permit. The recommended experience or educational requirements for each of these “roles” is described below. The required training is described in Table 4. For projects that disturb 1 to less than 5 acres, all the roles described below will or may be carried out by one person. For the larger projects there will or maybe the need to have one person for each role (that is a project-specific choice by the permittee).

### *Storm Water Lead/SWPPP Manager*

- A. A person knowledgeable in the principles and practice of erosion and sediment controls who possesses the skills to assess conditions at the construction site that could impact storm water quality and to assess the effectiveness of any erosion and sediment control measures selected to control the quality of storm water discharges from the construction activity.
- B. Such person shall have the authority to prepare the SWPPP, stop and/or modify construction activities as necessary to comply with the SWPPP and the terms and conditions of the permit, and modify the SWPPP.
- C. Such a person shall be responsible for inspections and recordkeeping.
- D. Such a person shall have the authority to supervise or initiate corrective actions identified by inspections, monitoring, or observation to fix control measures and minimize the discharge of pollutants.

Qualified Person  
(continued)

*SWPPP Preparer*

A person knowledgeable in the principles and practice of erosion and sediment controls who possesses the skills to assess conditions at the construction site that could impact storm water quality, the effectiveness of any erosion and sediment control measures selected to control the quality of storm water discharges from the construction activity, and is familiar with Part 5 as a means to implement this permit.

*Storm Water Inspector*

A person knowledgeable in the principles and practice of erosion and sediment controls who possesses the skills to assess conditions at the construction site that could impact storm water quality, the effectiveness of any erosion and sediment control measures selected to control the quality of storm water discharges from the construction activity, and is familiar with Part 6 as a means to ensure compliance with this permit. The person is familiar with the project specific inspection forms and how to fill them out, responsible for conducting inspections, and responsible for reporting the need for follow-up corrective action to the Storm Water Lead or site supervisor.

*Monitoring Person*

A person knowledgeable in the principles and practices of water quality monitoring who is familiar with Part 7 and the monitoring plan for the site and how to conduct water quality sampling, testing, and reporting.

*Active Treatment System Operator*

A person knowledgeable in the principles and practices of treatment systems that employs chemical coagulation, chemical flocculation, or electrocoagulation to aid in the treatment of storm water runoff who is familiar with Part 4.5 as a means to implement and comply with this permit.

(Table 4: Recommended Experience or Required Training for Specific Roles  
*is located on the following page.*)



Qualified Person  
(continued)

Table 4: Recommended Experience or Required Training for Specific Roles

<b>Storm Water Role</b>	<b>Total Project Disturbed Acreage</b>		
	<b>1 to &lt; 5 acres</b>	<b>5 acres to &lt;20 Acres</b>	<b>&gt; 20 Acres</b>
<i>Storm Water Lead/SWPPP Manager</i>	Recommend AK-CESCL training, but not required	Be AK-CESCL certified	Be AK-CESCL certified
<i>SWPPP Preparer</i>	Be familiar with permit.	Recommend taking a course in SWPPP preparation.	Be AK-CESCL certified, visit the site prior to writing the SWPPP or soon after project start and revised the SWPPP based on site conditions. Recommend taking a course in SWPPP preparation.
<i>Storm Water Inspector</i>	Be familiar with permit and SWPPP.	Be AK-CESCL certified	Be AK-CESCL certified
<i>Monitoring Person</i>	Not Required	Not Required	Be AK-CESCL certified
<i>Active Treatment System Operator</i>	Be AK-CESCL certified and have general experience and knowledge of storm water control measures. Have operational experience with the specific equipment used on-site.	Be AK-CESCL certified and have general experience and knowledge of storm water control measures. Have operational experience with the specific equipment used on-site.	Be AK-CESCL certified and have general experience and knowledge of storm water control measures. Have operational experience with the specific equipment used on-site.

Note: The following training and certifications may substitute for AK-CESCL training and certification: CPESC, CESSWI, CPISM or CPSWQ by EnviroCert International, Inc (ECI, <http://envirocertintl.org>) or CISEC by CISEC, Inc. (<http://cisecinc.org>).

Rain Gauge	For the purposes of this permit, means a type of instrument to gather and measure the amount of liquid precipitation occurring during a storm event for a set period of time.
Rainfall Erosivity Factor or R Factor	Means a measure of the erosive force and intensity of rain in a normal year. Two components of the factor are total energy and the maximum 30-minute intensity of storms. The R-Factor is the sum of the product of these two components for all major storms in the area during an average year.
Rainfall Erosivity Waiver	Means a waiver, available only to small construction activities, that is based on the rainfall erosivity factor for the project.
Reasonable	For purposes of this permit, means the permittee has selected, designed, installed, implemented and maintained control measures in light of manufacture's specifications and good engineering practices at the project to meet the control measures and good housekeeping measures established in Part 4.0 of the permit.
Reasonable Time(s)	For inspections it is time when inspections may occur, typically during normal business hours of 8:00 am to 5:00 pm Monday through Friday, except for those construction sites that are operational outside of these times. For information requests it is thirty (30) calendar days from the date of the receipt of a written request for information from the department, unless specified otherwise in this permit.
Receiving Water	The "Water of the United States" as defined in 40 CFR §122.2 into which the regulated storm water discharges
Residential Subdivision	For the purposes of this permit, means any parcel of land that is divided into smaller parcels with the intent of selling the smaller parcels for the development of residential homes for individual ownership.
Rural Infrastructure Improvement Project	For the purposes of this permit, means a project that is a rural water, wastewater, solid waste, or energy project that is funded, designed, or built by a third party such as the Alaska Native Tribal Health Consortium, DEC Village Safe Water Program, or the Alaska Energy Authority for a 2 <sup>nd</sup> class city, Tribe, Community Association, or statutory improvement district.
Rural Infrastructure Improvement Project Operators	For the purposes of this permit, means the agency or entity with "design control over plans and specifications" that acts as the operator rather than the ultimate owner of the rural infrastructure improvement project.
Sampling Point	For the purposes of this permit, means that point at which storm water samples are collected where the storm water or authorized non-storm water is discharged from the site.
Sediment	Is solid particulate matter, both mineral and organic, that is in suspension, is being transported, or has been moved from its site of origin by air, water, gravity, or ice and has come to rest on the earth's surface either above or below sea level.

Sedimentation	Is the process of deposition of suspended matter carried by water, wastewater, or other liquids by gravity. It is usually accomplished by reducing the velocity of the liquid below the point at which it can transport the suspended material.
Sediment Control Measures	Are control measures that serve to capture sediment particles that have mobilized and are entrained in storm water with the objective of removing sediment and other pollutants from the storm water discharge. Examples of sediment control measures include but not limited to berms, dikes, fiber rolls, silt fences, sandbags, or gravel bags.
Semi-Arid Areas	Areas with an average total precipitation of 10 to 20 inches. See <a href="http://xmacis.rcc-acis.org/">xmacis.rcc-acis.org/</a> for precipitation data from the weather station closest to the project.
Sensitive Area	For the purposes of this permit, means any lakes, ponds, perennial and intermittent streams, vernal pools, wetlands, floodplains, floodways and areas with highly erodible soils, which need special protection.
Sheet Flow	Is slow-velocity runoff that flows or is directed to flow across an overland area where there are no defined channels and the water spreads out over a large area at a uniform depth. Sometimes referred to as “sheetwash.”
Site	The land or water area where any “facility or activity” is physically located or conducted, including adjacent and off-site land used in connection with the facility or activity, including related areas for support activities.
Small Construction Activity	Defined at 40 CFR §122.26(b)(15) and incorporated here by reference. A small construction activity includes clearing, grading, and excavating resulting in a land disturbance that will disturb equal to or greater than one (1) acre and less than five (5) acres of land or will disturb less than one (1) acre of total land area but is part of a larger common plan of development or sale that will ultimately disturb equal to or greater than one (1) acre and less than five (5) acres. Small construction activity does not include routine maintenance that is performed to maintain the original line and grade, hydraulic capacity of conveyance channels, or original purpose of the site.
Snowmelt	The conversion of snow into water runoff that may infiltrate into the ground with the onset of warmer temperatures.

Spring Thaw	<p>For the purposes of this permit, means for planning purposes in the development of the SWPPP and initial planning of control measure maintenance the date in the spring that air temperatures will be predominately above freezing. It is the date in the spring that has a 20% probability that a minimum temperature below a threshold of 32.5 degrees Fahrenheit will occur on or after the given date. This date can be found by looking up the “Spring ‘Freeze’ Probabilities” for the weather station closest to the project on the website <a href="http://www.wrcc.dri.edu/summary/Climsmak.html">www.wrcc.dri.edu/summary/Climsmak.html</a>. Alternatively, the Spring Thaw can be estimated by using the 5-year moving average from the First/Last dates where the minimum temperature below a threshold of 32.5 degrees Fahrenheit will occur on or after the given date for the weather station closest to the project site on the website <a href="http://xmacis.rcc-acis.org">xmacis.rcc-acis.org</a>. NOTE: this estimation of “Spring Thaw” is for planning purposes only. During construction the permittee will need to maintain control measures based on actual conditions.</p>
Stabilization	<p>The use of vegetative and/or non-vegetative cover to prevent erosion and sediment loss in areas exposed by Construction Activities.</p>
Temporary Stabilization	<p>For the purposes of this permit, means protecting soils from erosion and sediment loss by rainfall, snow melt, runoff, or wind, with a temporary vegetative and/or non-vegetative protection cover. Temporary stabilization may include a combination of surface roughening (track walking), temporary seeding, geotextiles, mulches, surface tackifiers, rolled erosion control products, gravel or paving, and other techniques to reduce or eliminate erosion until either final stabilization can be achieved or until further construction activities take place to re-disturb this area.</p>
Final Stabilization	<p>For the purposes of this permit, means that:</p> <ol style="list-style-type: none"> <li>1. All soil disturbing activities at the site have been completed and either of the two following criteria shall be met: <ol style="list-style-type: none"> <li>a. a uniform (e.g., evenly distributed, without large bare areas) perennial vegetative cover with a density of 70 percent of the native background vegetative cover for the area has been established on all unpaved areas and areas not covered by permanent structures, or</li> <li>b. equivalent non vegetative permanent stabilization measures have been employed (such as the use of riprap, gabions, porous backfill (ADOT&amp;PF Specification 703-2.10), railroad ballast or subballast, ditch lining (ADOT&amp;PF Specification 610-2.01), geotextiles, or fill material with low erodibility as determined by an engineer familiar with the site and documented in the SWPPP).</li> </ol> </li> <li>2. When background native vegetation will cover less than 100 percent of the ground (e.g., arid areas, beaches), the 70 percent coverage criteria is adjusted as follows: if the native vegetation covers 50 percent of the ground, then 70 percent of 50 percent (<math>0.70 \times 0.50 = 0.35</math>) would require 35 percent total cover for final stabilization. On a beach with no natural vegetation, no stabilization is required.</li> </ol>

3. In arid and semi-arid areas only, all soil disturbing activities at the site have been completed and both of the following criteria have been met:
  - a. Temporary erosion control measures (e.g., degradable rolled erosion control product) are selected, designed, and installed along with an appropriate seed base to provide erosion control for at least three years without active maintenance by the permittee;
  - b. The temporary erosion control measures are selected, designed, and installed to achieve 70 percent vegetative coverage within three years.
4. For individual lots in residential construction, final stabilization means that either:
  - a. The homebuilder has completed final stabilization as specified above, or
  - b. The homebuilder has established temporary stabilization including perimeter controls for an individual lot prior to occupation of the home by the homeowner and informing the homeowner of the need for, and benefits of, final stabilization.
5. For construction projects on land used for agricultural purposes (e.g., pipelines across crop or range land, staging areas for highway construction, etc.), final stabilization may be accomplished by returning the disturbed land to its preconstruction agricultural use. Areas disturbed that were not previously used for agricultural activities, such as buffer strips immediately adjacent to “water of the United States,” and areas which are not being returned to their preconstruction agricultural use must meet the final stabilization criteria (1) or (2) or (3) above.

Steep Slope	For the purposes of this permit, mean any slope occurring on the construction site that is 20 percent or greater in grade for a length of the slope that exceeds 25 feet.
Storm Event	For the purposes of this permit, means a rainfall event that produces more than 0.5 inch of precipitation in 24 hours and that is separated from the previous storm event by at least 3 days of less than 0.1 inch of rain per day.
Storm Water	Storm water runoff, snow melt runoff, and surface runoff and drainage.
Storm Water Controls	See ‘Control Measure’
Storm Water Discharge-Related Activities	Activities that cause, contribute to, or result in storm water point source pollutant discharges, including but not limited to: excavation, site development; grading and other surface disturbance activities; and measures to control storm water including the siting, construction and operation of BMPs to control, reduce or prevent storm water pollution.
Storm Water Inlet	A structure placed below grade to conduct water used to collect storm water runoff for conveyance purposes.

Storm Water Pollution Prevention Plan (SWPPP)	Means a site-specific, written document that: (1) identifies potential sources of storm water pollution at the construction site; (2) describes practices to reduce or eliminate pollutants in storm water discharges from the construction site; and (3) identifies procedures the permittee will implement to comply with the terms and conditions of this general permit.
Support Activities	<p>For the purposes of this permit, means any concrete or asphalt batch plants, equipment staging yards, material storage areas, excavated material disposal areas, and borrow areas provided:</p> <ol style="list-style-type: none"> <li>1. The support activity is directly related to the construction project that is covered under this general permit,</li> <li>2. The support activity is not a commercial operation serving multiple unrelated construction projects by different permittees,</li> <li>3. The support activity does not operate beyond the completion of the construction activity at the project it supports, and</li> <li>4. Appropriate control measures are identified in the SWPPP covering the discharges from the support activity areas.</li> </ol> <p>Material borrow areas that are developed specific for the projects and are non-contiguous to the project site (e.g. the material is barged in from another area not nearby the project area) are considered “support activities” however, they would not need to be routinely inspected as part of the project. These areas would need to comply with other conditions of the permit to control storm water discharge as described in the SWPPP. The permit provides an exception for concrete or asphalt plants used for highway paving projects that may also, incidental to the main project contract, pave residential driveways. This additional paving is allowed under this permit provided those activities are covered under the SWPPP.</p> <p>For communities where equipment or materials are barged in, flown in, or shipped by Alaska Marine Highway, the support activities may serve more than one project if: (1) each project that qualifies for coverage under this permit files a project-specific NOI and includes an acknowledgement of the shared support activities; (2) identifies the operator responsible for maintaining those support activities in compliance with permit requirements; and (3) identifies the operator responsible for the support activities until an NOT is filed at the conclusion of use of the support activity.</p>
Tackifier and Soil Stabilizer (binder)	For the purposes of this permit, means hydraulically applied chemicals derived from natural and synthetic sources used for erosion control to promote adhesion among soil particles or mulch materials. In general soil stabilizers (also known as soil binders) are used to increase soil adhesion, which improves soil stabilization by reducing water and wind driven erosion. Tackifiers are used as “glue” to bind and immobilize straw, cellulose products, pine needles, or other mulch that has been applied to a seeded area. Common examples include polyacrylamide, guar, chloride compounds, psyllium, resins, enzymes, surfactants, and various polymers, starches, and other compounds.

Total Maximum Daily Load (TMDL)	The sum of the individual wasteload allocations (WLAs) for point sources and load allocations (LAs) for nonpoint sources and natural background. If receiving water has only one point source discharger, the TMDL is the sum of that point source WLA plus the LAs for any nonpoint sources of pollution and natural background sources, tributaries, or adjacent segments. TMDLs can be expressed in terms of either mass per time, toxicity, or other appropriate measure.
TMDL Waiver	Means a waiver, available only to small construction activities, based on an EPA established or approved TMDL.
Treatment Chemicals	For the purposes of this permit, means polymers, flocculants, or other chemicals used to reduce turbidity in storm water. Tackifiers and soil stabilizers (binders) are not considered treatment chemicals.
Turbidimeter	For the purposes of this permit, means an instrument that measures the amount of light scattered at right angles to an incident light beam by particles present in a storm water sample.
Turbidity	Means a condition of water quality characterized by the presence of suspended solids and/or organic material.
Upset	Defined in 40 CFR §122.41 and incorporated here by reference. Upset means an exceptional incident in which there is unintentional and temporary non-compliance with technology-based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. See Appendix A, Part 2.7.
Water Quality Impaired	See ‘Impaired Water.’
Water Quality Standard (WQS)	For the purposes of this permit, means the Alaska Water Quality Standards (18 AAC 70) as approved by U.S. EPA. As defined in 40 CFR § 131.3 water quality standards are provisions of State or Federal law which consist of a designated use or uses for the waters of the U.S. and water quality criteria for such waters based upon such uses. Water quality standards are to protect the public health or welfare, enhance the quality of water and serve the purposes of the Clean Water Act.
waters of the U.S. (WOUS)	Defined in 40 CFR §122.2 and incorporated here by reference.
Wetland	Those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions. Wetlands generally include swamps, marshes, bogs, and similar areas.
Winter Construction	For the purposes of this permit, means the commencement of construction specifically during frozen conditions to aid in construction. Typically, this period is from December to March and is approximately from after fall freeze-up to before spring thaw.

Winter Shutdown

For the purposes of this permit, means the cessation of soil disturbing or soil stabilizing construction activity for the winter. Typically this period is from October/November to April/May and is approximately from fall freeze-up to spring thaw.



## Appendix D Small Construction Waivers and Instructions

These waivers are only available to storm water discharges associated with small construction activities (i.e., 1-5 acres). As the operator of a small construction activity, the operator may be able to qualify for a waiver in lieu of needing to obtain coverage under this general permit based on: (A) a low rainfall erosivity factor, (B) a TMDL analysis, or (C) an equivalent analysis that determines allocations for small construction sites are not needed. Each applicant, otherwise needing permit coverage, must notify DEC of its intention for a waiver. It is the responsibility of that person wishing to obtain a waiver from coverage under this general permit to submit a complete and accurate waiver certification as described below. Where the operator changes or another is added during the construction project, the new operator must also submit a waiver certification to be waived.

### D.1 Rainfall Erosivity Waiver

Under this scenario the small construction project's rainfall erosivity factor calculation ("R" in the Revised Universal Soil Loss Equation) is less than 5 during the period of construction activity. The operator must certify to the Department that construction activity will occur only when the rainfall erosivity factor is less than 5. The period of construction activity begins at initial earth disturbance and ends with final stabilization. Where vegetation will be used for final stabilization, the date of installation of a stabilization practice that will provide temporary non-vegetative stabilization can be used for the end of the construction period, provided the operator commits (as a condition of waiver eligibility) to periodically inspect and properly maintain the area until the criteria for final stabilization as defined in the construction general permit have been met. If use of this temporary stabilization eligibility condition was relied on to qualify for the waiver, signature on the waiver with its certification statement constitutes acceptance of and commitment to complete the final stabilization process. The applicant must submit a waiver certification to the Department prior to commencing construction activities.

Note: The basis of the rainfall erosivity factor "R" was determined in accordance with Chapter 2 of Agriculture Handbook Number 703, Predicting Soil Erosion by Water: A Guide to Conservation Planning With the Revised Universal Soil Loss Equation (RUSLE), pages 21–64, dated January 1997; United States Department of Agriculture (USDA), Agricultural Research Service. R factor information for Alaska can be found in the Fact Sheet and were obtained from RUSLE2 Version 1.26.6.4 [http://fargo.nserl.purdue.edu/rusle2\\_dataweb/RUSLE2\\_Index.htm](http://fargo.nserl.purdue.edu/rusle2_dataweb/RUSLE2_Index.htm). (Database last modified on Feb, 28, 2008).

If the operator is eligible for a waiver based on low erosivity potential, the operator may submit a rainfall erosivity waiver to the address listed in Appendix A, Part 1.1.1 and provide the following information on the waiver certification form in order to be waived from permitting requirements:

1. Name, address and telephone number of the operator;
2. Name (or other identifier), address, county or similar governmental subdivision, and latitude/longitude of the construction project or site;
3. Estimated construction start and completion (i.e., final stabilization) dates, and total acreage (to the nearest quarter acre) to be disturbed;
4. The rainfall erosivity factor calculation that applies to the active construction phase at your project site; and
5. A statement, signed and dated by an authorized representative as provided in Appendix A, Part 1.12, which certifies that the construction activity will take place during a period when the value of the rainfall erosivity factor is less than five.

An applicant can access the waiver certification form from ADEC's website at: (<http://dec.alaska.gov/water/wastewater/stormwater/>). The form must be sent to the address listed in Appendix A, Part 1.1.1, Permitting Program of this permit.

Note: If the R factor is five or greater, you cannot apply for the rainfall erosivity waiver, and must apply for permit coverage as per Part 2.2 of the construction general permit, unless you qualify for the Water Quality Waiver as described below.

If the small construction project continues beyond the projected completion date given on the waiver certification, the applicant must recalculate the rainfall erosivity factor for the new project duration. If the R factor is below five, the owner or operator must update all applicable information on the waiver certification and retain a copy of the revised waiver as part of the site SWPPP. The new waiver certification must be submitted prior to the projected completion date listed on the original waiver form to assure exemption from permitting requirements is uninterrupted. If the new R factor is five or above, the applicant must submit an NOI, in accordance with Part 2.0 of the permit.

## **D.2 TMDL Waiver**

This waiver is available if DEC or EPA has established or approved a TMDL that addresses the pollutant(s) of concern and has determined that controls on storm water discharges from small construction activity are not needed to protect water quality. The pollutant(s) of concern include sediment (such as total suspended solids, turbidity, or siltation) and any other pollutant that has been identified as a cause of impairment of any water body that will receive a discharge from the construction activity. Information on TMDLs that have been established or approved by EPA is available from EPA online at <https://www.epa.gov/tmdl/impaired-waters-and-tmdls-region-10> and from DEC online at <http://dec.alaska.gov/water/water-quality/impaired-waters>.

If an applicant of the construction activity is eligible for a waiver based on compliance with a DEC or EPA established or approved TMDL, the operator must provide the following information on the Waiver Certification form in order to be waived from permitting requirements:

1. Name, address and telephone number of the operator;
2. Name (or other identifier), address, county or similar governmental subdivision, and latitude/longitude of the construction project or site;
3. Estimated construction start and completion (i.e., final stabilization) dates, and total acreage (to the nearest quarter acre) to be disturbed;
4. The name of the water body(s) that would be receiving storm water discharges from your construction project;
5. The name and approval date of the TMDL;
6. A statement, signed and dated by an authorized representative as provided in Appendix A, Part 1.12 that certifies that the construction activity will take place and that the storm water discharges will occur, within the drainage area addressed by the TMDL.

## **D.3 Equivalent Analysis Waiver**

This waiver is available for non-impaired waters only (see *2018 Approved Integrated Report*, or most current EPA-approved version: <http://dec.alaska.gov/water/water-quality/integrated-report/> and <http://dec.alaska.gov/water/water-quality/impaired-waters/> for list of impaired waters). The operator can develop an equivalent analysis that determines allocations for the small construction site for the pollutant(s) of concern or determines that such allocations are not needed to protect water quality. This waiver requires a small construction site to develop an equivalent analysis based on existing in-stream concentrations, expected growth in pollutant concentrations from all sources, and a margin of safety.

If an operator wants to use this waiver, the operator must develop an equivalent analysis and provide the following information to be waived from permitting requirements:

1. Name, address and telephone number of the operator;
2. Name (or other identifier), address, county or similar governmental subdivision, and latitude/longitude of the construction project or site;
3. Estimated construction start and completion (i.e., final stabilization) dates, and total acreage (to the nearest quarter acre) to be disturbed;
4. The name of the water bodies that would be receiving storm water discharges from your construction project;
5. The equivalent analysis;
6. A statement, signed and dated by an authorized representative as provided in Appendix A, Part 1.12, that certifies that the construction activity will take place and that the storm water discharges will occur, within the drainage area addressed by the equivalent analysis.

#### **D.4 Waiver Deadlines and Submissions**

1. Waiver certifications must be submitted prior to commencement of construction activities.
2. If an operator submits a TMDL or equivalent analysis waiver request, the operators request is not waived until the Department approves the request. As such, the operator may not commence construction activities until receipt of approval from the Department.
3. Late Notifications: operators are not prohibited from submitting waiver certifications after initiating clearing, grading, excavation activities, or other construction activities. The Department reserves the right to take enforcement for any unpermitted discharges that occur between the time construction commenced and waiver authorization is granted.

Submittal of a waiver certification is an optional alternative to obtaining permit coverage for discharges of storm water associated with small construction activity, provided the operator qualifies for the waiver. Any discharge of storm water associated with small construction activity not covered by either a permit or a waiver may be considered an unpermitted discharge under the CWA. As mentioned above, the Department reserves the right to take enforcement for any unpermitted discharges that occur between the time construction commenced and either discharge authorization is granted or a complete and accurate waiver certification is submitted. The Department may notify any operator covered by a waiver that they must apply for a permit. The Department may notify any construction project that has been in non-compliance with a waiver that they may no longer use the waiver for future projects. Any member of the public may petition the Department to take action under this provision by submitting written notice along with supporting justification.

## **Appendix E Forms**

- Notice of Intent (NOI)
- Notice of Termination (NOT)
- Notice of Intent Modification
- Low Erosivity Waiver
- Annual Report



## Notice of Intent (NOI) for Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

Submission of this Notice of Intent (NOI) constitutes notice that the party identified in Section II of this form requests authorization to discharge pursuant to the APDES Construction General Permit (CGP, AKR100000). Submission of this NOI also constitutes notice that the party identified in Section II of this form meets the eligibility requirements of the CGP for the project identified in Section III of this form. Permit authorization is required prior to commencement of construction activity until you are eligible to terminate coverage as detailed in the CGP. To obtain authorization, you must submit a complete and accurate NOI form. Refer to the instructions at the end of this form.

<b>I. Single/Multiple NOI Project</b>			
Is this NOI for a project with a single NOI?		<input type="checkbox"/> Yes	<input type="checkbox"/> No
If "No," then your project has multiple NOIs, will the fee be paid with this NOI?		<input type="checkbox"/> Yes	<input type="checkbox"/> No
If "No," then enter the name of the operator paying the fee:			
<b>II. Operator Information</b>			
Type of Operator/Responsibility per Permit Part 1.2.1:			
<input type="checkbox"/> Day-to-day operational control of on-site activities		<input type="checkbox"/> Construction Plans and Specifications	
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address: Street or PO Box:	City:	State:	Zip:
Primary SIC or NAICS Code:	SIC:	NAICS:	
<b>III. Project / Site Information</b>			
Project Name:		Estimated Start Date:	Estimated End Date:
Brief Description of Project:		Estimated Area to be Disturbed (nearest tenth acre):	
<b>Location Address:</b>			
Street:		Borough or similar government subdivision:	
City:		State:	Zip:
		Alaska	
Latitude <small>(decimal degree, 5 places):</small>	Longitude <small>(decimal degree, 5 places):</small>	Determined By: <input type="checkbox"/> GPS <input type="checkbox"/> Web, Source:	
		<input type="checkbox"/> USGS Topographic Map, scale:	
		<input type="checkbox"/> Other:	
<b>IV. SWPPP (Storm Water Pollution Prevention Plan)</b>			
Location of SWPPP for Viewing: <input type="checkbox"/> Address in Section II, <input type="checkbox"/> Address in Section III, <input type="checkbox"/> Other			
If other:	Street:	City:	State:   Zip:
Additional Info:			
<b>SWPPP Contact Information (if different than that in Section II):</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:	State:	Zip:

Has the SWPPP been prepared in advance of filing this NOI?	<input type="checkbox"/> Yes <input type="checkbox"/> No
For projects with 5 or more acres of disturbance, has a SWPPP been submitted to DEC?	<input type="checkbox"/> Yes <input type="checkbox"/> No, ≤ 5 acres
Is your project / site less than one-acre, but part of a common plan of development?	<input type="checkbox"/> Yes <input type="checkbox"/> No
If "Yes", provide the Permit Authorization Number and name of the common plan of development: _____	
Number: _____ Name: _____	
Have storm water discharges from your project / site been authorized previously by a DEC permit?	<input type="checkbox"/> Yes <input type="checkbox"/> No
If "Yes," provide the Permit Authorization Number for the previous DEC permit? _____	
If "Yes," have you updated your SWPPP according to the most recently issued CGP?	<input type="checkbox"/> Yes <input type="checkbox"/> No

<b>V. Permanent Storm Water Controls</b>	
Will you construct a permanent storm water management control measure at the project site (Part 4.11)? <input type="checkbox"/> Yes <input type="checkbox"/> No	
If "Yes", indicate the type of measure to be installed:	
<input type="checkbox"/> Pond	<input type="checkbox"/> Oil/Water/Grit Separator
<input type="checkbox"/> Other: _____	<input type="checkbox"/> Proprietary Storm Water Sedimentation Device

<b>VI. Discharge Information</b>	
Does your project discharge into a Municipal Separate Storm Sewer System (MS4)? <input type="checkbox"/> Yes <input type="checkbox"/> No	
If yes, name of the MS4 Operator: _____	

<b>Receiving Water and Wetlands Information:</b> (if additional space is needed for this question, attach separate sheet or annotate in Section XI.)							
<b>Impaired waters/303d Listed waters:</b> (see <a href="http://dec.alaska.gov/water/water-quality/impaired-waters">http://dec.alaska.gov/water/water-quality/impaired-waters</a> or <a href="#">GIS map of Impaired Waters</a> , and <a href="#">Integrated Water Quality and Monitoring and Assessment Reports Webpage</a> .)							
a. Identify the name(s) of waterbodies or wetlands to which you discharge.	b. Are any of your discharges directly into any segment of a 303d Listed Water, i.e. "Impaired" Water?		c. If you answered YES to question b, then answer the following three questions:			iii. Is the discharge consistent with the assumptions and requirements of applicable EPA approved or established Total Maximum Daily Load (TMDL(s))?	
			i. What pollutant(s) are causing the impairment?				
	Yes	No	Yes	No	Yes	No	No
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

<b>VII. Billing Contact Information</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:		
	State:	Zip:	

<b>VIII. NOI Preparer (Complete if NOI was prepared by someone other than the certifier.)</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:		
	State:	Zip:	

**IX. Certification Information**

An Alaska Pollutant Discharge Elimination System (APDES) permit application or report must be signed by an individual with the appropriate authority per 18 AAC 83.385. For additional information, please refer to 18 AAC 83.385 at the following link: <http://www.legis.state.ak.us/basis/aac.asp#18.83.385>.

Corporate Executive Officer 18 AAC 83.385 (a)(1)(A)	For a corporation, a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation.
Corporate Operations Manager 18 AAC 83.385 (a)(1)(B)	For a corporation, the manager of one or more manufacturing, production, or operating facilities, if (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations; (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
Sole Proprietor or General Partner 18 AAC 83.385 (a)(2)	For a partnership or sole proprietorship, the general partner or the proprietor respectively.
Public Agency, Chief Executive Officer 18 AAC 83.385 (a)(3)(A)	For a municipality, state, or other public agency, the chief executive officer of the agency.
Public Agency, Senior Executive Officer 18 AAC 83.385 (a)(3)(B)	For a municipality, state, or other public agency, a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
<i>*For Delegated Authority: the delegation must be made in writing and submitted to the DEC. An Example of written authorization delegating authority can be found at <a href="http://dec.alaska.gov/media/13316/delegation-of-signatory-authority.pdf">http://dec.alaska.gov/media/13316/delegation-of-signatory-authority.pdf</a></i>	
Operations Manager (Delegated Authority)* 18 AAC 83.385 (b)(2)(A)	For a duly authorized representative, an individual or a position having responsibility for the overall operation of the regulated facility or activity, including the position of plant manager, operator of a well or a well field, superintendent or position of equivalent responsibility.
Environmental Manager (Delegated Authority)* 18 AAC 83.385 (b)(2)(B)	For a duly authorized representative, an individual or position having overall responsibility for environmental matters for the company.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Organization:	Name:	Title:
Phone:	Fax (optional):	Email:
Mailing Address:	Street (PO Box):	
<input type="checkbox"/> Check if same as Operator Information	City:	State:   Zip:
<hr/>		
Signature		Date

**X. Document Attachments and Supplemental Information**

Documents attached with this application:

- Copy of SWPPP if ≥ 5 acres of disturbance.
- Delegation of Signatory Authority.
- Other:

## Instructions for Completing a Notice of Intent (NOI) Form for Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

### Who Must File an NOI Form:

Operators of construction sites where one or more acres are disturbed, smaller sites that are part of a larger common plan of development or sale where there is a cumulative disturbance of at least one acre, or any other site specifically designated by the Director, must submit an NOI to obtain coverage under an APDES construction general permit. Each person, firm, public organization, or any other entity that meets either of the following criteria must file this form: (1) they have operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications; or (2) they have day-to-day operational control of those activities at the project necessary to ensure compliance with SWPPP requirements or other permit conditions.

### Completing the Form:

Obtain and read a copy of the APDES Construction General Permit. Type or print, in the appropriate areas only. "NA" can be entered in areas that are not applicable. If you have any questions about how or when to use this form, contact the DEC Storm Water Program at (907) 269-6285 or online at <http://dec.alaska.gov/water/wastewater/stormwater/>.

### Section I. Single/Multiple NOI Project:

Indicate whether or not this is a single NOI project. If not, indicate if the fee will be paid with this NOI or another associated with this project. Provide the name of the operator that will be paying the fee.

### Section II. Operator Information:

Provide the name of the contact person, title, and the legal name of the firm, public organization, or any other entity that operates the project described in this application. (An operator of a project is a legal entity that controls at least a portion of site operations and is not necessarily the site manager.) Also provide the operator's mailing address, telephone number, fax number (optional) and e-mail address (to be notified via e-mail of NOI approval when available). Correspondence for the NOI will be sent to this address.

### Section III. Project/Site Information:

Enter the official or legal name, a brief description of the project or site, and complete street address, including city, state, zip code, and county or similar government subdivision of the project or site. If the project or site lacks a street address, indicate the general location of the site (e.g., Intersection of State Highways 61 and 34). Complete site information must be provided for permit authorization to be granted.

Provide the latitude and longitude of the facility in decimal degrees format with up to 5 digit accuracy. The latitude and longitude of your facility can be determined in several different ways, including through the use of global positioning system (GPS) receivers, U.S. Geological Survey (U.S.G.S.) topographic or quadrangle maps, Google Earth, Bing Maps, and EPA's web-

based siting tools, among others. For consistency, DEC requests that measurements be taken from the approximate center of the construction site. Applicants must specify which method they used to determine latitude and longitude. If a U.S.G.S. topographic map is used, applicants are required to specify the scale of the map used. Enter the estimated construction start and completion dates using four digits for the year (i.e., 05/27/2021).

Enter the estimated area (acres) to be disturbed including but not limited to grubbing, excavation, grading, and utilities and infrastructure installation. Indicate to the nearest tenth of an acre. Note: 1 acre = 43,560 sq. ft.

Indicate whether or not the project/site has been previously covered by an EPA or DEC permit. If "Yes" provide the permit authorization number that the project/site was covered under. If this is a project that was covered under a previous DEC construction general permit indicate whether or not the SWPPP has been updated in accordance with the most recently issued Alaska Construction General Permit.

If the project or site is less than one-acre, but part of a common plan of development, provide the permit authorization number and name of the common plan of development.

### Section IV. SWPPP (Storm Water Pollution Prevention Plan) Information:

Note the SWPPP should be prepared in advance of filing the NOI form. For projects with 5 acres or more of disturbance, the initial SWPPP will need to be submitted to DEC with the NOI. Check the appropriate box for the location where the SWPPP may be viewed. Provide the name, fax number (optional), and e-mail address of the contact person if different than that listed in Section II of the NOI form.

### Section V. Permanent Storm Water Controls

A permittee must comply with applicable APDES MS4 permit requirements, local requirements, and the applicable requirements under 18 AAC 72.600 (i.e., Nondomestic Wastewater System Plan Review) regarding the design and installation of permanent storm water management controls. Annotate the type of measure to be installed and see Permit Part 4.11 for additional requirements regarding plan submittal deadlines.

### Section VI. Discharge Information:

Identify the receiving water bodies or wetlands to which the project's storm water will discharge. These should be the first bodies of water that the discharge will reach. (Note: If you discharge to more than one water body, please indicate all such waters in the space provided and attach a separate sheet if necessary.) For example, if the discharge leaves your site and travels through a roadside swale or a storm sewer and then enters a stream that flows to a river, the stream would be the receiving water body. Waters of the U.S. include lakes, streams, creeks, rivers, wetlands, impoundments, estuaries, bays, oceans, and other surface bodies of water within the confines of the U.S. and U.S. coastal waters. (Waters of the U.S. do not



include man-made structures created solely for the purpose of wastewater treatment.) U.S.G.S. topographical maps may be used to make this determination. If the map does not provide a name, use a format such as “unnamed tributary to Cross Creek”. If you discharge into a municipal separate storm sewer system (MS4), you must identify the water body into which that portion of the storm sewer discharges. That information should be readily available from the operator of the MS4.

Indicate if any of your storm water discharges from construction activities will be reach a 303d listed water (i.e., impaired water body)?

For a listing of impaired waters and an interactive map, see <http://dec.alaska.gov/water/water-quality/impaired-waters>.

Indicate whether your storm water discharges from construction activities will be consistent with the assumptions and requirements of applicable EPA approved or established total maximum daily load(s)(TMDL(s)). To answer this question, refer to <http://dec.alaska.gov/water/water-quality/impaired-waters/>. You may also have to contact DEC. If there are no applicable TMDLs or no related requirements, please check the “yes” box in the NOI form.

### Section VII. Billing Contact Information

Provide the name of the contact person, title, and the legal name of the firm, public organization, or any other entity that is responsible for accounts payable for this project. Also provide the billing contact’s mailing address, telephone number, fax number (optional), and email address. Correspondence for billing purposes will be sent to this address. If the billing contact is that same as the operator, check the box.

### Section VIII. NOI Preparer Information.

If the NOI was prepared by someone other than the certifier (for example, if the NOI was prepared by the project SWPPP contact or a consultant for the certifier’s signature), include the name, title, organization, address, telephone number, and email address of the NOI preparer.

### Section IX. Certification Information:

The NOI must be signed as follows:

- (1) For a corporation, a responsible corporate officer shall sign the NOI, a responsible corporate officer means:
  - (A) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy - or decision-making functions for the corporation; or
  - (B) the manager of one or more manufacturing, production, or operating facilities, if
    - (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations;

- (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
    - (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.

- (2) For a partnership or sole proprietorship, the general partner or the proprietor, respectively; or
- (3) for a municipality, state, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means
  - (A) the chief executive officer of the agency; or
  - (B) a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
- (4) Include the name, title, organization, address, telephone number, and email address of the person signing the form and the date of signing. An unsigned or undated NOI form will not be considered valid application for permit coverage.

### Section X. Document Attachments and Supplemental Information

Include a copy of the SWPPP if  $\geq 5$  acres of disturbance. Indicate documents attached and supplemental information.

### Where to File NOI form

Select one of three options:

- 1) **Preferred Option:** DEC encourages you to complete the NOI form electronically via DEC’s Online Application System (OASys):  
<https://myalaska.state.ak.us/dec/water/OASys/Login.aspx>.  
Filing electronically is the fastest way to obtain permit coverage and help ensure that your NOI is complete.
- 2) If you file by mail please submit the original form with a signature in ink. Remember to retain a copy for your records.  
NOIs sent by mail:  
Alaska Dept. of Environmental Conservation  
Division of Water  
Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, AK 99501  
Phone: (907) 269-6285
- 3) Submit all pages of scanned original form via Email:  
[DEC.WQPermit@alaska.gov](mailto:DEC.WQPermit@alaska.gov). (Note, 20MB limit).



## Notice of Termination (NOT) for Storm Water Discharges Associated with Construction Activity filed under an APDES General Permit

Submission of this Notice of Termination (NOT) constitutes notice that the operator identified in Section II of this form is no longer authorized discharge pursuant to the APDES Construction General Permit (CGP) from the site identified in Section III of this form. All necessary information must be included on this form.

Coverage under the APDES CGP is terminated at midnight of the day the NOT is signed. The NOT must be submitted within 30 calendar days of one of the conditions in Section 10.2 of the CGP being met. Refer to the instructions at the end of this form for information on submitting a NOT.

Note: As per 18 AAC 83.130(k), a permittee subject to pending state or federal enforcement actions, including citizen suits brought under state or federal law, may not submit a NOT.

### I. Permit Information

Permit Tracking Number: \_\_\_\_\_

#### Reason for Termination (Check only one):

- Final stabilization has been achieved on all portions of the site for which you are responsible, all ground disturbing construction activity or use of support activities has been completed and all temporary BMP's have been removed.
- Another operator has assumed control, according to Appendix A, Part 2.3, over all areas of the site that have not been finally stabilized. Provide the other operator's permit authorization number: \_\_\_\_\_
- Coverage under an individual permit or alternative APDES general permit has been obtained.
- For residential construction only, temporary stabilization has been completed and the residence has been transferred to the homeowner.
- The planned construction activity identified on the original NOI was never initiated (e.g., no grading or earthwork was ever started) and plans for the construction have been permanently abandoned or indefinitely postponed.

### II. Operator Information (as it appears on your NOI):

Organization:	Name:	Title:
Phone:	Fax (optional):	Email:
Mailing Address: Street or PO Box:	City:	State: Zip:

### III. Project / Site Information (as it appears on your NOI):

Project / Site Name:			
Street:			
Location			
Address:	City:	State:	Zip: Borough or similar government subdivision:
Alaska			

### IV. Certification Information

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I certify that I am not subject to any pending state or federal enforcement actions, including citizen suits brought under state or federal law.

Organization	Name	Title
Phone	Fax (Optional)	Email
Mailing Address:	Street (PO Box)	City State Zip
<input type="checkbox"/> check if same as Operator Information		
_____ Signature		_____ Date

## Instructions for Completing a Notice of Termination (NOT) Form for APDES Construction General Permit

### Who May File an NOT Form

Permittees presently covered under the Alaska Pollutant Discharge Elimination System (APDES) General Permit for Storm Water Discharges Associated with Construction Activity may submit an NOT form when:

- *final stabilization has been achieved on all portions of the site for which you are responsible;*
- *another operator has assumed control, in accordance with Appendix A, Part 2.3 of the General Permit, over all areas of the site that have not been finally stabilized;*
- *coverage under individual permit or an alternative APDES permit has been obtained;*
- *for residential construction only, temporary stabilization has been completed and the residence has been transferred to the homeowner; or*
- *the planned construction activity identified on the original NOI was never initiated (e.g., no grading or earthwork was ever started) and plans for the construction have been permanently abandoned or indefinitely postponed.*

“Final stabilization” means that all soil disturbing activities at the site have been completed and that a uniform perennial vegetative cover with a density of at least 70% of the native background vegetative cover for the area has been established on all unpaved areas and areas not covered by permanent structures, or equivalent permanent stabilization measures (such as the use of riprap, gabions, or geotextiles) have been employed. See “final stabilization” definition in Appendix A of the Construction General Permit for further guidance where background native vegetation covers less than 100 percent of the ground, in arid or semi-arid areas, for individual lots in residential construction, and for construction projects on land used for agricultural purposes.

### Completing the Form:

Type or print, in the appropriate areas only. “NA” can be entered in areas that are not applicable. If you have any questions about how or when to use this form, contact the DEC Storm Water Program at (907) 269-6285 or online at <http://dec.alaska.gov/water/wastewater/stormwater/>.

### Section I. Permit Number:

Enter the existing APDES Construction General Permit authorization number assigned to the project by ADEC’s Storm Water Program. If you do not know the tracking number, you can find the tracking number assigned to your project/facility on DEC’s Water Permit Search: <http://dec.alaska.gov/Applications/Water/WaterPermitSearch/Search.aspx?number=akr10>.

Indicate your reason for submitting this Notice of Termination by checking the appropriate box. Check only one.

### Section II. Operator Information:

Provide the name of the contact person, and the legal name of the firm, public organization, or any other entity that operates the project described in this application. (An operator of a project is a legal entity that controls at least a portion of site operations and is not necessarily the site manager.)

Also provide the operator’s mailing address, telephone number, fax number (optional) and e-mail address.

### Section III. Project/Site Information:

Enter the official or legal name, and complete street address, including city, state, zip code, and county or similar government subdivision of the project or site. If the project or site lacks a street address, indicate the general location of the site (e.g., Intersection of State Highways 61 and 34). Complete site information must be provided for termination of permit authorization to be valid.

### Section IV. Certification Information:

The NOT must be signed as follows:

- (1) For a corporation, a responsible corporate officer shall sign the NOT, a responsible corporate officer means:
  - (A) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy - or decision-making functions for the corporation; or
  - (B) the manager of one or more manufacturing, production, or operating facilities, if
    - (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations;
    - (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
    - (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
- (2) For a partnership or sole proprietorship, the general partner or the proprietor, respectively; or
- (3) for a municipality, state, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means
  - (A) the chief executive officer of the agency; or
  - (B) a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
- (4) Include the name, title, and email address of the person signing the form and the date of signing. An unsigned or undated NOT form will not be considered valid termination for permit coverage.

As per 18 AAC 83.130(k) A permittee subject to pending state or federal enforcement actions, including citizen suits brought under state or federal law, may not proceed under expedited termination procedures. A permittee requesting expedited permit termination procedures must certify that it is not subject to any pending state or federal enforcement actions, including citizen suits brought under state or federal law.

### Where to File NOT form

DEC encourages you to complete the NOT form electronically via DEC’s Online Application System (OASys) can be found at <https://myalaska.state.ak.us/dec/water/OASys/Login.aspx>. Filing electronically is the fastest way to terminate permit coverage and help ensure that your NOT is complete. If you choose not to file electronically, you must send the NOT to the address listed below.

If you file by mail, please submit the original form with a signature in ink. Remember to retain a copy for your records.

NOTs sent by mail:

Alaska Dept. of Environmental Conservation  
Division of Water, Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, AK 99501  
Phone: (907) 269-6285  
Email: [DEC.WQPermit@alaska.gov](mailto:DEC.WQPermit@alaska.gov)



## Notice of Intent (NOI) Modification for Storm Water Discharges Associated with Construction Activity filed under an APDES General Permit

*(Please copy content exactly from your NOI. Indicate changes on the next page.)*

<b>I. Current NOI Information</b>
I. Permit Authorization Number:

<b>II. Operator Information</b> <i>(as it appears on your NOI)</i>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address: Street or PO Box:	City:	State:	Zip:

<b>III. Project / Site Information</b>			
Project Name:			
Brief Description of Project:			
<b>Location Address:</b>	Borough or similar government subdivision:		
Street:	City:	State:	Zip:
		Alaska	

<b>Instructions for Completing a Modification to an APDES Notice of Intent (NOI)</b>
Use the form on the subsequent pages to indicate the items for which you are submitting this modification. Only enter the information you wish to change. You may use this form to modify an NOI that you submitted to ADEC for coverage under the Construction General Permit (CGP). If you have any questions about modifying your NOI, call the DEC Storm Water Program at (907) 269-6285.
<p><b>When Should You Modify Your Notice of Intent (NOI)?</b></p> <ul style="list-style-type: none"> <li>• You can use this form to update or correct information on your NOI, including:</li> <li>• Owner/Operator address and contact information</li> <li>• Site Information</li> <li>• Start or End dates <i>(if estimated start or end dates differ greater than 30 days)</i></li> <li>• Number of acres to be disturbed <i>(Note, if the original project disturbance was between 1 and &lt; 5 acres, and now will disturb five acres or more, a SWPPP must also be submitted with the NOI modification. Please note the CGP has different provisions for small and large construction projects.)</i></li> <li>• Storm Water Pollution Prevention Plan (SWPPP) location and contact information</li> <li>• Continuation of expired permit in accordance with Part 2.6.</li> </ul>
<p><b>When must you Submit a Notice of Termination (NOT) Instead of a Modification Form?</b></p> <ul style="list-style-type: none"> <li>• The owner/operator has changed: You must submit a NOT when you transfer control of a site to a new owner/operator. The new owner/operator must then file a new NOI to obtain coverage under DEC's CGP. Coverage is not transferable.</li> </ul>



## Notice of Intent (NOI) for Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

Submission of this Notice of Intent (NOI) constitutes notice that the party identified in Section II of this form requests authorization to discharge pursuant to the APDES Construction General Permit (CGP, AKR100000). Submission of this NOI also constitutes notice that the party identified in Section II of this form meets the eligibility requirements of the CGP for the project identified in Section III of this form. Permit authorization is required prior to commencement of construction activity until you are eligible to terminate coverage as detailed in the CGP. To obtain authorization, you must submit a complete and accurate NOI form. Refer to the instructions at the end of this form.

<b>I. Single/Multiple NOI Project</b>			
Is this NOI for a project with a single NOI?		<input type="checkbox"/> Yes	<input type="checkbox"/> No
If "No," then your project has multiple NOIs, will the fee be paid with this NOI?		<input type="checkbox"/> Yes	<input type="checkbox"/> No
If "No," then enter the name of the operator paying the fee:			
<b>II. Operator Information</b>			
Type of Operator/Responsibility per Permit Part 1.2.1:			
<input type="checkbox"/> Day-to-day operational control of on-site activities		<input type="checkbox"/> Construction Plans and Specifications	
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address: Street or PO Box:	City:	State:	Zip:
Primary SIC or NAICS Code:	SIC:	NAICS:	
<b>III. Project / Site Information</b>			
Project Name:		Estimated Start Date:	Estimated End Date:
Brief Description of Project:		Estimated Area to be Disturbed ( <i>nearest tenth acre</i> ):	
<b>Location Address:</b>		Borough or similar government subdivision:	
Street:	City:	State:	Zip:
		Alaska	
Latitude <small>(decimal degree, 5 places):</small>	Longitude <small>(decimal degree, 5 places):</small>	Determined By: <input type="checkbox"/> GPS <input type="checkbox"/> Web, Source:	
		<input type="checkbox"/> USGS Topographic Map, scale:	
		<input type="checkbox"/> Other:	
<b>IV. SWPPP (Storm Water Pollution Prevention Plan)</b>			
Location of SWPPP for Viewing: <input type="checkbox"/> Address in Section II, <input type="checkbox"/> Address in Section III, <input type="checkbox"/> Other			
If other:	Street:	City:	State:   Zip:
Additional Info:			
<b>SWPPP Contact Information (if different than that in Section II):</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:	State:	Zip:

Has the SWPPP been prepared in advance of filing this NOI?	<input type="checkbox"/> Yes <input type="checkbox"/> No
For projects with 5 or more acres of disturbance, has a SWPPP been submitted to DEC?	<input type="checkbox"/> Yes <input type="checkbox"/> No, ≤ 5 acres
Is your project / site less than one-acre, but part of a common plan of development?	<input type="checkbox"/> Yes <input type="checkbox"/> No
If "Yes", provide the Permit Authorization Number and _____ name of the common plan of development: _____	
Number: _____ Name: _____	
Have storm water discharges from your project / site been authorized previously by a DEC permit?	<input type="checkbox"/> Yes <input type="checkbox"/> No
If "Yes," provide the Permit Authorization Number for the previous DEC permit? _____	
If "Yes," have you updated your SWPPP according to the most recently issued CGP?	<input type="checkbox"/> Yes <input type="checkbox"/> No

<b>V. Permanent Storm Water Controls</b>	
Will you construct a permanent storm water management control measure at the project site (Part 4.11)? <input type="checkbox"/> Yes <input type="checkbox"/> No	
If "Yes", indicate the type of measure to be installed:	
<input type="checkbox"/> Pond	<input type="checkbox"/> Oil/Water/Grit Separator
<input type="checkbox"/> Other: _____	<input type="checkbox"/> Proprietary Storm Water Sedimentation Device

<b>VI. Discharge Information</b>	
Does your project discharge into a Municipal Separate Storm Sewer System (MS4)? <input type="checkbox"/> Yes <input type="checkbox"/> No	
If yes, name of the MS4 Operator: _____	

<b>Receiving Water and Wetlands Information:</b> (if additional space is needed for this question, attach separate sheet or annotate in Section XI.)								
<b>Impaired waters/303d Listed waters:</b> (see <a href="http://dec.alaska.gov/water/water-quality/impaired-waters">http://dec.alaska.gov/water/water-quality/impaired-waters</a> or <a href="#">GIS map of Impaired Waters</a> , and <a href="#">Integrated Water Quality and Monitoring and Assessment Reports Webpage</a> .)								
a. Identify the name(s) of waterbodies or wetlands to which you discharge.	b. Are any of your discharges directly into any segment of a 303d Listed Water, i.e. "Impaired" Water?		c. If you answered YES to question b, then answer the following three questions:			iii. Is the discharge consistent with the assumptions and requirements of applicable EPA approved or established Total Maximum Daily Load (TMDL(s))?		
	Yes	No	i. What pollutant(s) are causing the impairment?	ii. Are the pollutant(s) causing the impairment present in your discharge?	Yes	No	Yes	No
	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

<b>VII. Billing Contact Information</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:		
	State:	Zip:	

<b>VIII. NOI Preparer (Complete if NOI was prepared by someone other than the certifier.)</b>			
Organization:	Name:	Title:	
Phone:	Fax (optional):	Email:	
Mailing Address:	Street (PO Box):		
<input type="checkbox"/> Check if same as Operator Information	City:		
	State:	Zip:	

**IX. Certification Information**

An Alaska Pollutant Discharge Elimination System (APDES) permit application or report must be signed by an individual with the appropriate authority per 18 AAC 83.385. For additional information, please refer to 18 AAC 83.385 at the following link: <http://www.legis.state.ak.us/basis/aac.asp#18.83.385>.

Corporate Executive Officer 18 AAC 83.385 (a)(1)(A)	For a corporation, a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation.
Corporate Operations Manager 18 AAC 83.385 (a)(1)(B)	For a corporation, the manager of one or more manufacturing, production, or operating facilities, if (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations; (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
Sole Proprietor or General Partner 18 AAC 83.385 (a)(2)	For a partnership or sole proprietorship, the general partner or the proprietor respectively.
Public Agency, Chief Executive Officer 18 AAC 83.385 (a)(3)(A)	For a municipality, state, or other public agency, the chief executive officer of the agency.
Public Agency, Senior Executive Officer 18 AAC 83.385 (a)(3)(B)	For a municipality, state, or other public agency, a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
<i>*For Delegated Authority: the delegation must be made in writing and submitted to the DEC. An Example of written authorization delegating authority can be found at <a href="http://dec.alaska.gov/media/13316/delegation-of-signatory-authority.pdf">http://dec.alaska.gov/media/13316/delegation-of-signatory-authority.pdf</a></i>	
Operations Manager (Delegated Authority)* 18 AAC 83.385 (b)(2)(A)	For a duly authorized representative, an individual or a position having responsibility for the overall operation of the regulated facility or activity, including the position of plant manager, operator of a well or a well field, superintendent or position of equivalent responsibility.
Environmental Manager (Delegated Authority)* 18 AAC 83.385 (b)(2)(B)	For a duly authorized representative, an individual or position having overall responsibility for environmental matters for the company.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Organization:	Name:	Title:
Phone:	Fax (optional):	Email:
Mailing Address:	Street (PO Box):	
<input type="checkbox"/> Check if same as Operator Information	City:	State:   Zip:
<hr/>		
Signature		Date

**X. Document Attachments and Supplemental Information**

Documents attached with this application:

- Copy of SWPPP if ≥ 5 acres of disturbance.
- Delegation of Signatory Authority.
- Other:

## Instructions for Completing a Notice of Intent (NOI) Form for Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

### Who Must File an NOI Form:

Operators of construction sites where one or more acres are disturbed, smaller sites that are part of a larger common plan of development or sale where there is a cumulative disturbance of at least one acre, or any other site specifically designated by the Director, must submit an NOI to obtain coverage under an APDES construction general permit. Each person, firm, public organization, or any other entity that meets either of the following criteria must file this form: (1) they have operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications; or (2) they have day-to-day operational control of those activities at the project necessary to ensure compliance with SWPPP requirements or other permit conditions.

### Completing the Form:

Obtain and read a copy of the APDES Construction General Permit. Type or print, in the appropriate areas only. "NA" can be entered in areas that are not applicable. If you have any questions about how or when to use this form, contact the DEC Storm Water Program at (907) 269-6285 or online at <http://dec.alaska.gov/water/wastewater/stormwater/>.

### Section I. Single/Multiple NOI Project:

Indicate whether or not this is a single NOI project. If not, indicate if the fee will be paid with this NOI or another associated with this project. Provide the name of the operator that will be paying the fee.

### Section II. Operator Information:

Provide the name of the contact person, title, and the legal name of the firm, public organization, or any other entity that operates the project described in this application. (An operator of a project is a legal entity that controls at least a portion of site operations and is not necessarily the site manager.) Also provide the operator's mailing address, telephone number, fax number (optional) and e-mail address (to be notified via e-mail of NOI approval when available). Correspondence for the NOI will be sent to this address.

### Section III. Project/Site Information:

Enter the official or legal name, a brief description of the project or site, and complete street address, including city, state, zip code, and county or similar government subdivision of the project or site. If the project or site lacks a street address, indicate the general location of the site (e.g., Intersection of State Highways 61 and 34). Complete site information must be provided for permit authorization to be granted.

Provide the latitude and longitude of the facility in decimal degrees format with up to 5 digit accuracy. The latitude and longitude of your facility can be determined in several different ways, including through the use of global positioning system (GPS) receivers, U.S. Geological Survey (U.S.G.S.) topographic or quadrangle maps, Google Earth, Bing Maps, and EPA's web-

based siting tools, among others. For consistency, DEC requests that measurements be taken from the approximate center of the construction site. Applicants must specify which method they used to determine latitude and longitude. If a U.S.G.S. topographic map is used, applicants are required to specify the scale of the map used. Enter the estimated construction start and completion dates using four digits for the year (i.e., 05/27/2021).

Enter the estimated area (acres) to be disturbed including but not limited to grubbing, excavation, grading, and utilities and infrastructure installation. Indicate to the nearest tenth of an acre. Note: 1 acre = 43,560 sq. ft.

Indicate whether or not the project/site has been previously covered by an EPA or DEC permit. If "Yes" provide the permit authorization number that the project/site was covered under. If this is a project that was covered under a previous DEC construction general permit indicate whether or not the SWPPP has been updated in accordance with the most recently issued Alaska Construction General Permit.

If the project or site is less than one-acre, but part of a common plan of development, provide the permit authorization number and name of the common plan of development.

### Section IV. SWPPP (Storm Water Pollution Prevention Plan) Information:

Note the SWPPP should be prepared in advance of filing the NOI form. For projects with 5 acres or more of disturbance, the initial SWPPP will need to be submitted to DEC with the NOI. Check the appropriate box for the location where the SWPPP may be viewed. Provide the name, fax number (optional), and e-mail address of the contact person if different than that listed in Section II of the NOI form.

### Section V. Permanent Storm Water Controls

A permittee must comply with applicable APDES MS4 permit requirements, local requirements, and the applicable requirements under 18 AAC 72.600 (i.e., Nondomestic Wastewater System Plan Review) regarding the design and installation of permanent storm water management controls. Annotate the type of measure to be installed and see Permit Part 4.11 for additional requirements regarding plan submittal deadlines.

### Section VI. Discharge Information:

Identify the receiving water bodies or wetlands to which the project's storm water will discharge. These should be the first bodies of water that the discharge will reach. (Note: If you discharge to more than one water body, please indicate all such waters in the space provided and attach a separate sheet if necessary.) For example, if the discharge leaves your site and travels through a roadside swale or a storm sewer and then enters a stream that flows to a river, the stream would be the receiving water body. Waters of the U.S. include lakes, streams, creeks, rivers, wetlands, impoundments, estuaries, bays, oceans, and other surface bodies of water within the confines of the U.S. and U.S. coastal waters. (Waters of the U.S. do not



include man-made structures created solely for the purpose of wastewater treatment.) U.S.G.S. topographical maps may be used to make this determination. If the map does not provide a name, use a format such as “unnamed tributary to Cross Creek”. If you discharge into a municipal separate storm sewer system (MS4), you must identify the water body into which that portion of the storm sewer discharges. That information should be readily available from the operator of the MS4.

Indicate if any of your storm water discharges from construction activities will be reach a 303d listed water (i.e., impaired water body)?

For a listing of impaired waters and an interactive map, see <http://dec.alaska.gov/water/water-quality/impaired-waters>.

Indicate whether your storm water discharges from construction activities will be consistent with the assumptions and requirements of applicable EPA approved or established total maximum daily load(s)(TMDL(s)). To answer this question, refer to <http://dec.alaska.gov/water/water-quality/impaired-waters/>. You may also have to contact DEC. If there are no applicable TMDLs or no related requirements, please check the “yes” box in the NOI form.

### Section VII. Billing Contact Information

Provide the name of the contact person, title, and the legal name of the firm, public organization, or any other entity that is responsible for accounts payable for this project. Also provide the billing contact’s mailing address, telephone number, fax number (optional), and email address. Correspondence for billing purposes will be sent to this address. If the billing contact is that same as the operator, check the box.

### Section VIII. NOI Preparer Information.

If the NOI was prepared by someone other than the certifier (for example, if the NOI was prepared by the project SWPPP contact or a consultant for the certifier’s signature), include the name, title, organization, address, telephone number, and email address of the NOI preparer.

### Section IX. Certification Information:

The NOI must be signed as follows:

- (1) For a corporation, a responsible corporate officer shall sign the NOI, a responsible corporate officer means:
  - (A) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy - or decision-making functions for the corporation; or
  - (B) the manager of one or more manufacturing, production, or operating facilities, if
    - (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations;

- (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
    - (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.

- (2) For a partnership or sole proprietorship, the general partner or the proprietor, respectively; or
- (3) for a municipality, state, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means
  - (A) the chief executive officer of the agency; or
  - (B) a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
- (4) Include the name, title, organization, address, telephone number, and email address of the person signing the form and the date of signing. An unsigned or undated NOI form will not be considered valid application for permit coverage.

### Section X. Document Attachments and Supplemental Information

Include a copy of the SWPPP if  $\geq 5$  acres of disturbance. Indicate documents attached and supplemental information.

### Where to File NOI form

Select one of three options:

- 1) **Preferred Option:** DEC encourages you to complete the NOI form electronically via DEC’s Online Application System (OASys):  
<https://myalaska.state.ak.us/dec/water/OASys/Login.aspx>.  
Filing electronically is the fastest way to obtain permit coverage and help ensure that your NOI is complete.
- 2) If you file by mail please submit the original form with a signature in ink. Remember to retain a copy for your records.  
NOIs sent by mail:  
Alaska Dept. of Environmental Conservation  
Division of Water  
Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, AK 99501  
Phone: (907) 269-6285
- 3) Submit all pages of scanned original form via Email:  
[DEC.Water.WQPermit@alaska.gov](mailto:DEC.Water.WQPermit@alaska.gov). (Note, 20MB limit).



# Low Erosivity Waiver Certification Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

This form provides notice to DEC that the project operator identified in Section I of this form are certifying that construction activity at the project site identified in Section II, will take place during a period when the rainfall erosivity factor is less than five [40 CFR 122.26(b)(15)(i)(A) adopted by reference at 18 AAC 83.010(b)(3)]. By submitting a complete and accurate form, the otherwise applicable APDES permitting requirements for stormwater discharges associated with construction activity, are waived. Based on your certification, a waiver is granted for the period beginning on the date this Low Erosivity Waiver Form is mailed to DEC (i.e., postmark date), or the project start date specified in Part III of this form, whichever shall occur last, and ending on the project completion date specified in Part III. Refer to the instructions at the end of this form for more details.

Note this waiver is only available to storm water discharges associated with small construction activities (i.e., 1-5 acres). See 2021 CGP, Appendix D.

<b>I. Operator Information</b>						
Organization:		Name:		Title:		
Phone:		Fax (optional):		Email:		
Mailing Address: Street or PO Box:		City:		State:	Zip:	
Primary SIC or NAICS Code:		SIC:		NAICS:		
<b>II. Project / Site Information</b>						
Project / Site Name:				Estimated Start Date:	Estimated End Date:	
Brief Description of the Project / Site:				Estimated Area to be Disturbed ( <i>nearest tenth acre</i> ):		
Location Address:	Street:		City:		State:	
					Alaska	
	Latitude (decimal degree, 5 places):		Longitude (decimal degree, 5 places):		Borough or similar government subdivision:	
					Determined By: <input type="checkbox"/> GPS <input type="checkbox"/> USGS Topographic Map <input type="checkbox"/> Other	
If you used a USGS Topographic map, what was the scale? _____						
<b>III. Rainfall Erosivity Factor Calculation Data</b>						
Are interim non-vegetative site stabilization measures used to establish the project completion date for purposes of obtaining this waiver? <span style="float: right;"><input type="checkbox"/> Yes   <input type="checkbox"/> No</span>						
Rainfall erosivity factor (R factor): _____						
<b>Note:</b> To qualify for this waiver, the construction activity must take place during a period when the R factor is less than five.						
Rainfall erosivity factor was calculated by using: <input type="checkbox"/> Online calculator, <input type="checkbox"/> Table 4-3 of 2016 CGP Fact Sheet, <input type="checkbox"/> USDA Handbook 703						
<b>IV. Certification Information</b>						
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.						
Organization		Name		Title		
Phone		Fax (Optional)		Email		
Mailing Address: Street (PO Box)		City		State	Zip	
<input type="checkbox"/> check if same as Operator Information						
_____ Signature			_____ Date			

# Instructions for Completing a Notice of Intent (NOI) Form for Storm Water Discharges Associated with Construction Activity under an APDES Construction General Permit

## Who May Qualify for a Low Erosivity Waiver

Under the Alaska Pollutant Discharge Elimination System (APDES) Program, operators of construction projects that result in land disturbances equal to or greater than one acre, including sites that are less than one acre but are part of a larger common plan of development or sale where there is a cumulative disturbance of at least one acre, are required to obtain coverage under an APDES permit for stormwater discharges associated with construction activity.

DEC may waive the otherwise applicable permit requirements for stormwater discharges from construction activities that disturb less than five acres if the construction activity will take place during a period when the rainfall erosivity factor (R factor) is less than five. More information on the low erosivity waiver is available in the 2021 CGP Fact Sheet Appendix D. For questions related to completion of this form, you may contact DEC's Stormwater Program at (907) 269-6285.

## Completing the Form:

You must type or print in appropriate areas only. One form must be completed for each facility or site for which you are seeking to obtain a Low Erosivity Waiver. Additional guidance on completing this form can be accessed at DEC's Storm Water Program website:

<http://dec.alaska.gov/water/wastewater/stormwater>.

Please make sure you have addressed all applicable questions and have made a photocopy for your records before sending the completed form to DEC.

## Section I. Operator Information:

Each legal entity that meets DEC's definition of "operator" (see definitions in Appendix C of DEC's APDES Construction General Permit) and that meets the eligibility conditions for the low erosivity waiver must file this form to have the permit requirements waived. The operator is the legal entity that either (1) has operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications, or (2) has day-to-day operational control of some or all of those activities.

It is possible that there will be more than one operator at a site and, in such cases, each entity that meets the operator definition must complete a Low Erosivity Waiver Certification.

Provide the legal name of your firm, public organization, or other entity that operates the project described in this waiver certification. Usually this will be a company or organization's name but for construction activities undertaken by you as an individual, this should be your name. Enter the operator's complete mailing address and name of contact person, telephone number, fax number (optional) and email who can answer questions about the site (e.g., a project or site manager).

## Section II. Project/Site Information:

Enter the official or legal name, a brief description of the project or site, and complete street address, including city, state, zip code, and county or similar government subdivision of the project or site. If the project or site lacks a street address, indicate the general location of the site (e.g., Intersection of State Highways 61 and 34). Complete site information must be provided for permit authorization to be granted.

Provide the latitude and longitude of the facility in , decimal degrees format with up to 5 digit accuracy. The latitude and longitude of your facility can be determined in several different ways, including through the use of global positioning system (GPS) receivers, U.S. Geological Survey (U.S.G.S.) topographic or quadrangle maps, Google Earth, Bing Maps, and EPA's web-based siting tools, among others. Refer to <https://www.epa.gov/npdes/construction-general-permit-resources-tools-and-templates> for further guidance on the use of these methodologies. For consistency, DEC requests that measurements be taken from the approximate center of the construction site. Applicants must specify which method they used to determine latitude and longitude. If a U.S.G.S. topographic map is used, applicants are required to specify the scale of the map used. Enter the estimated construction start and completion dates using four digits for the year (i.e., 05/27/2015).

Enter the estimated area (acres) to be disturbed including but not limited to: grubbing, excavation, grading, and utilities and infrastructure installation. Indicate to the nearest tenth of an acre. Note: 1 acre = 43,560 sq. ft.

## Section III. Rainfall Erosivity Factor Calculation Data

The construction period begins with the initial earth disturbance and ends with final site stabilization. To qualify for this waiver, the rainfall erosivity factor for the project must be less than five during the entire construction period. Specify the construction period by entering the project start date (date of initial earth disturbance) and project completion date (date of final site stabilization). For example, a grading contractor that is operating on-site for only one week during a nine month construction project, must enter the start date and completion date of the entire nine month construction period.

DEC believes, where the environmental threat is low (i.e., in arid and semi-arid climates), that "final stabilization" can include techniques that employ re-vegetation combined with other stabilization measures, consisting of temporary degradable rolled erosion control products, also known as "erosion control blankets (ECBs). With proper selection, design, and installation of the combination re-vegetation/ECB technique in arid or semi-arid areas, an operator can be considered to have achieved final stabilization upon completion of the installation process. Note that if more than three years is required to establish 70 percent of the natural

vegetative cover, this technique cannot be used or cited for fulfillment of the final stabilization requirement. If your waiver is based on use of interim non-vegetative stabilization measures, such as erosion control blankets, to establish the end of the construction period, you must indicate so on this form. In doing so, you must commit and certify (as a condition of waiver eligibility) to periodically inspect and properly maintain the area until the criteria for final stabilization, as defined in the Construction General Permit, have been met.

The rainfall erosivity factor "R" is determined in accordance with the U.S. Department of Agriculture *Agriculture Handbook Number 703, Predicting Soil Erosion by Water: A Guide to Conservation Planning with the Revised Universal Soil Loss Equation (RUSLE)*, Chapter 2 pages 21-64, dated January 1997.

If the R factor is five or greater during the project's construction period, you must have or obtain coverage under an APDES stormwater permit. If the project was eligible for the waiver during the original construction period, but the construction activity will extend past the project completion date specified in the Low Erosivity Waiver Certification, the operator must recalculate the R factor using the original start date and a new project completion date. If the recalculated R factor is still less than five, a new waiver certification form must be submitted before the end of the original construction period. If the new R factor is five or greater, the operator must submit a Notice of Intent to be covered by the Construction General Permit before the original project completion date. The Notice of Intent (NOI) form may be submitted electronically using DEC's Online Application System (OASys). OASys can be accessed at <http://dec.alaska.gov/water/oasys.aspx>. If you choose to fill out an NOI and mail it to DEC you can obtain a copy at <http://dec.alaska.gov/water/wastewater/stormwater/forms/#tab-CGP>.

#### Section IV. Certification Information:

The Low Erosivity Waiver must be signed as follows:

- (1) For a corporation, a responsible corporate officer shall sign the Low Erosivity Waiver, a responsible corporate officer means:
  - (A) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy - or decision-making functions for the corporation; or
  - (B) the manager of one or more manufacturing, production, or operating facilities, if
    - (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental

compliance with environmental statutes and regulations;

- (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
  - (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
- (2) For a partnership or sole proprietorship, the general partner or the proprietor, respectively; or
  - (3) for a municipality, state, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means
    - (A) the chief executive officer of the agency; or
    - (B) a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
  - (4) Include the name, title, and email address of the person signing the form and the date of signing. An unsigned or undated waiver form will not be considered valid application for exclusion from permit coverage.

#### Where to File Low Erosivity Certification Form

Please submit the original form with a signature in ink. Remember to retain a copy for your records.

NOIs sent by mail:

Alaska Dept. of Environmental Conservation  
Division of Water  
Wastewater Discharge Authorization Program  
555 Cordova Street  
Anchorage, AK 99501  
Phone: (907) 269-6285  
Email: [DEC.WQPermit@alaska.gov](mailto:DEC.WQPermit@alaska.gov)



# Alaska Department of Environmental Conservation

## CGP Annual Reporting Form

Complete one set of tables for each storm event (rainfall or snowmelt) that resulted in a discharge from the site. At a minimum per part 7.3.2.2 of the CGP two samples per discharge point shall be collected and averaged. Attach additional tables as necessary. See instructions on the next page for more information.

### I. Project Information

Permit Tracking Number:	Project Name:	Project Location:						
Project Operator Name		<b>Nature of Discharge</b>						
		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;">Rainfall Amount (inches)</td> <td style="width: 20%;">Rainfall</td> <td style="width: 20%;">Snowmelt</td> </tr> <tr> <td> </td> <td style="text-align: center;"><input type="checkbox"/></td> <td style="text-align: center;"><input type="checkbox"/></td> </tr> </table>	Rainfall Amount (inches)	Rainfall	Snowmelt		<input type="checkbox"/>	<input type="checkbox"/>
Rainfall Amount (inches)	Rainfall	Snowmelt						
	<input type="checkbox"/>	<input type="checkbox"/>						
Do you have substantially identical discharge points on a linear project as described in Part 7.3.4 of the ACGP? <input type="checkbox"/> Yes <input type="checkbox"/> No		<b>Measurement Method</b>						
List identical discharge point names or ID numbers which are identified in your SWPPP that are not sampled but visually monitored.		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">On Site Gauge:</td> <td style="width: 50%;">At Nearest National Weather Service Precipitation Gauge</td> </tr> <tr> <td style="text-align: center;"><input type="checkbox"/></td> <td style="text-align: center;"><input type="checkbox"/></td> </tr> <tr> <td>Date Samples Collected (mm/dd/yyyy):</td> <td> </td> </tr> </table>	On Site Gauge:	At Nearest National Weather Service Precipitation Gauge	<input type="checkbox"/>	<input type="checkbox"/>	Date Samples Collected (mm/dd/yyyy):	
On Site Gauge:	At Nearest National Weather Service Precipitation Gauge							
<input type="checkbox"/>	<input type="checkbox"/>							
Date Samples Collected (mm/dd/yyyy):								

### II. Monitoring Results

*All discharge points on your site subject to monitoring shall have two turbidity samples collected, averaged, and reported as average downstream turbidity. Compliance is determined based upon the difference between the individual upstream sample for that specific discharge point and the average downstream turbidity result.*

<b>Upstream location ID</b> <i>(used in the SWPPP)</i>							
Latitude/Longitude <i>(Decimal Degrees)</i>							
Time Sample collected:							
Turbidity (NTUs):							
<b>Downstream location ID</b>							
Latitude/Longitude <i>(Decimal Degrees)</i>							
Time Samples collected:							
Turbidity (NTUs):							
Average Downstream Turbidity (NTUs):							
<b>Difference</b>							
Difference in Turbidity (NTUs):							

### III. Certification

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

<b>Title</b>	<b>Printed Name</b>	<b>Signature</b>	<b>Date</b>

# Instructions for Completing the CGP Annual Report

## Who Must Submit an Annual Report to DEC?

The operator of a construction site must submit an Annual Report if their site meets the requirements of Section 3.2 (Discharge to Impaired Water Body) of the 2021 APDES Construction General Permit (CGP).

## Completing the Form

Obtain and read a copy of the CGP. Type or print in the appropriate areas only. "NA" can be entered in areas that are not applicable. If you have questions about how or when to use this form contact the DEC Storm Water Program at 907-269-6285 or online at <http://dec.alaska.gov/water/wastewater/stormwater/construction>.

For each storm event sampled, collect a minimum of two representative samples of each discharge point. To meet the requirements of Part 9.1 of the CGP, all completed forms must be submitted to DEC by December 31<sup>st</sup> of each year during construction and with the NOT upon submittal. The form must be submitted to the appropriate address in Appendix A, Part 1.1.2 of the CGP.

## Section I. Project Information

Provide the APDES permit tracking number assigned by DEC to the project. If you do not know the tracking number, you can find the tracking number assigned to your project on DEC's Water Permit Search

<http://dec.alaska.gov/Applications/Water/WaterPermitSearch/search.aspx?number=akr10>

Provide the project name, location and project operator. Use the same name provided on your NOI. Enter the outfall name or number identified in the SWPPP for all discharge points subject to monitoring. If no discharge occurs at some outfalls simply state "No Discharge". Also indicate any discharge points that are considered substantially identical and list on the form pursuant to Section 7.3.4 of the CGP.

Indicate if the discharge was a result of a rain event or snowmelt. If the discharge was the result of rainfall provide the total amount of rain for the storm event in inches. Indicate if the measurement of rainfall was taken using an onsite gauge or a National Weather Service precipitation gauge.

## Section II. Monitoring Results

Provide the date and time the samples were collected. Enter the measured turbidity for each sample in Nephelometric Turbidity Units (NTUs). Provide the average of the two samples collected from each discharge point.

Provide the difference between the upstream and average downstream sampling results from each discharge point sampled to determine compliance with Part 3.2 of the CGP.

Per Part 3.2.1 upstream monitoring must take place at a representative location (upgradient) from the point of discharge or outside the area of influence.

Downstream monitoring must take place at a representative location inside the area of influence or at the point the storm water discharge leaves the construction site.

## Section III. Certification Information:

The Annual Report must be signed as follows:

- (1) For a corporation, a responsible corporate officer shall sign the Annual Report, a responsible corporate officer means:
  - (A) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy - or decision-making functions for the corporation; or
  - (B) the manager of one or more manufacturing, production, or operating facilities, if
    - (i) the manager is authorized to make management decisions that govern the operation of the regulated facility, including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental statutes and regulations;
    - (ii) the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and
    - (iii) authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
- (2) For a partnership or sole proprietorship, the general partner or the proprietor, respectively; or
- (3) for a municipality, state, or other public agency, either a principal executive officer or ranking elected official shall sign the application; in this subsection, a principal executive officer of an agency means
  - (A) the chief executive officer of the agency; or
  - (B) a senior executive officer having responsibility for the overall operations of a principal geographic unit or division of the agency.
- (4) Include the name, title, and email address of the person signing the form and the date of signing. An unsigned or undated form will not be considered valid submittal.

## Where to File Annual Report form

Please submit the original form with a signature in ink. Remember to retain a copy for your records.

Annual Reports sent by mail:

State of Alaska  
Department of Environmental Conservation  
Division of Water  
Compliance and Enforcement Program  
555 Cordova Street  
Anchorage, Alaska 99501  
Telephone Nationwide (877) 569-4114  
Anchorage Area / International (907) 269-4114  
Fax (907) 269-4604  
Email: [dec-wgreporting@alaska.gov](mailto:dec-wgreporting@alaska.gov)

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX G – GRADING AND STABILIZATION RECORDS

CITY OF HOMER  
 DEPARTMENT OF PUBLIC WORKS  
**SWPPP GRADING & STABILIZATION ACTIVITIES LOG**

PAGE \_\_\_\_\_

**Project Number:**

**Project Name: Main Street Sidewalk Improvement**

**Project Area (if applicable):**

*Detailed instructions for completing this form can be found on the Alaska Construction Forms website: [http://dot.alaska.gov/stwddes/dcsconst/pop\\_constforms.shtml](http://dot.alaska.gov/stwddes/dcsconst/pop_constforms.shtml)*

Date Grading Activity Initiated/ Initials	Description of Grading Activity and Location	Date Grading Activity Ceased (Temporary or Permanent) and Initials	Date Stabilization Measures Initiated (Temporary or Permanent) and Initials	Date Stabilization Measure Complete	Description of Stabilization Measure
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		
		T <input type="checkbox"/> P <input type="checkbox"/>	T <input type="checkbox"/> P <input type="checkbox"/>		



## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX H – MONITORING PLAN (IF APPLICABLE) AND REPORTS

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX I – TRAINING RECORDS

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP TRAINING LOG**

Project name: Main Street Sidewalk Improvement

Project Number: \_\_\_\_\_

Project Location: \_\_\_\_\_

Instructor's Name(s): \_\_\_\_\_

Instructor's Titles(s): \_\_\_\_\_

Course Location: \_\_\_\_\_

Course Date: \_\_\_\_\_

Course Length (hours): \_\_\_\_\_

Storm Water Training Topic: (check as appropriate)

- |  |   |
|--|---|
| <input type="checkbox"/> Erosion Control BMPs  | <input type="checkbox"/> Emergency Procedures   |
| <input type="checkbox"/> Sediment Control BMPs | <input type="checkbox"/> Good Housekeeping BMPs |
| <input type="checkbox"/> Non-Storm Water BMPs  | <input type="checkbox"/> Treatment Chemicals    |

Specific Training Objective: \_\_\_\_\_

Attendee Roster: (attach additional pages as necessary)

No.	Name of Attendee	Company	Attendee Initials
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX J – CORRECTIVE ACTION LOG

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP CORRECTIVE ACTION LOG**

PAGE \_\_\_\_

**Project Number:**

**Project Name: Main Street Sidewalk Improvement**

*Use this form to track completion of all corrective actions. Note that corrective actions can be identified during and outside of inspections. Detailed instructions for completing this form can be found on the Alaska Construction Forms website: [http://dot.alaska.gov/stwddes/dcsconst/pop\\_constforms.shtml](http://dot.alaska.gov/stwddes/dcsconst/pop_constforms.shtml)*

Corrective Action Number	Date Identified (check box if outside inspection)	Description of corrective action, including the following as applicable: <ul style="list-style-type: none"> <li>• Related SWPPP Amendment #</li> <li>• Note if a &gt;2-yr., 24-hr. storm event occurred (see instructions)</li> <li>• All corrective actions require a complete by date and description</li> </ul>	Complete-by Date	Date Complete	Name of Person Documenting Completion
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				
	<input type="checkbox"/>				

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX K – INSPECTION RECORDS

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP CONSTRUCTION SITE INSPECTION REPORT**

*Detailed instructions for completing this form can be found on the Alaska Construction Forms website:  
[http://www.dot.state.ak.us/stwddes/dcsconst/pop\\_constforms.shtml](http://www.dot.state.ak.us/stwddes/dcsconst/pop_constforms.shtml)*

**1.0 General Information**

<b>1.1 Project Name</b>	Main Street Sidewalk Improvement		
<b>1.2 Project Number</b>		<b>1.3 Location</b>	Homer, AK, Main Street
<b>1.4 NOI Tracking No.</b>	<b>Contractor's:</b>	<b>DOT&amp;PF's:</b>	
<b>1.5a Date of Inspection</b>		<b>1.5b Start/End Times:</b>	
<b>1.6 Inspectors' Names</b>	<b>Contractor:</b>	<b>DOT&amp;PF:</b>	
<b>1.7 Inspectors' Titles</b>	<b>Contractor:</b>	<b>DOT&amp;PF:</b>	
<b>1.8 Inspectors' Contact Information</b>	<b>Contractor:</b>	<b>DOT&amp;PF:</b>	
<b>1.9a AK-CESCL Cert. No.</b>	<b>Contractor:</b>	<b>DOT&amp;PF:</b>	
<b>1.9b AK-CESCL Exp. Date</b>	<b>Contractor:</b>	<b>DOT&amp;PF:</b>	
<b>1.10 Describe construction activities</b>			
<b>1.11 Type of Inspection:</b> <input type="checkbox"/> Regular <input type="checkbox"/> Post-storm Event <input type="checkbox"/> Reduced Inspection Frequency Period			

**2.0 Weather Information**

**2.1 Describe the weather since the last inspection, or start of construction activities if first inspection.**

Check all appropriate boxes.

Clear    Cloudy    Rain    Sleet    Fog    Snow    High Winds    Other:

**2.2 Storm events. Complete storm event information if there were any storm events since the last inspection.**

*Storm event:* a rainfall event that produces more than 0.5 inch of precipitation in 24 hours and that is separated from the previous storm event by at least 3 days of less than 0.1 inch of rain per day, CGP C16.

<b>Estimated Start Date:</b>					
<b>Estimated Duration (#days):</b>					
<b>Approximate Amount of Precipitation (in):</b>					

**2.3 Weather at time of this inspection?**    Clear    Cloudy    Rain    Sleet    Fog    Snow    High Winds    Other:  
Temperature:

### 3.0 Overall Site Issues

**For complete instructions, please see instructions on Constructions Forms web page, by separate form**

- **Overall Site Issue** -- These are general site issues that must be assessed during inspections.
- **Implemented?** – If a BMP should be installed at the time of the inspection and you marked “No” in the “BMP Installed” column, then you must check “Yes” in the “BMP Action Required?” column. If there is good reason to mark “no” in the “BMP Installed” column (such as the BMP is no longer needed and was removed) then you can mark “no” in the “BMP Action Required?” column and explain in the “Comments” column.
- **Corrective Action Required?** - When maintenance or some other corrective action is required, check “Yes” in this column.
- **Corrective Action Required, Complete by Date** - When a corrective action is required, before certifying the report, fill in the date when the corrective action can reasonably be expected to be completed. When a corrective action is NOT required, leave the “Complete by Date” blank.
- **If Corrective Action is required, describe Action and Location** – Anytime you check “Yes” in the “Corrective Action Required?” column, you must fill in the “Describe Corrective Action and Location” column as well.
- **Corrective Action Log** - When a Corrective Action is required as noted in this report, you must also enter all the information for this action in the Corrective Action Log and document on the Log the actual date of completed correction.

	Overall Site Issue	Response	Corrective Action Required?	If Corrective Action is required, describe Action and Location	Comments
3.1	Have stabilization measures been initiated on slopes and disturbed areas not actively being worked?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.2	Are natural resource areas (e.g., streams, wetlands, mature trees, etc.) required by the SWPPP to be delineated in the field, identified with barriers or markings?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.3	Are perimeter controls and sediment barriers adequately installed (keyed into substrate) and maintained?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.4	Are storm drain inlets properly protected?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.5	Are the construction exits preventing sediment from being tracked into the street?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.6	Is trash/litter from work areas collected and disposed of properly?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		



	Overall Site Issue	Response	Corrective Action Required?	If Corrective Action is required, describe Action and Location	Comments
3.7	Are washout facilities (e.g., paint, concrete) available, clearly marked, and maintained?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.8	Are vehicle and equipment fueling, cleaning, and maintenance areas free of spills, leaks, or any other potential pollutants?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.9	Are materials that are potential stormwater contaminants stored inside or under cover?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.10	Are non-stormwater discharges (e.g., wash water, dewatering) properly controlled?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.11	Has Spill Response kit been used since the last inspection?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.12	Is the SWPPP Main Entrance Signage legible and does it contain the correct information?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.13	Are erodible stockpiles properly covered and have a perimeter control?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.14	Are any additional BMPs needed?	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
3.15	(Other)	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		

#### 4.0 Discharge Points

	Overall Site Issue	Response	Corrective Action Required?	If Response is No, describe Location. If Corrective Action is required, describe Action and Location	Comments
4.1	At the time of inspection, are the discharge points and receiving waters free of pollutant discharges (sediment deposits, sediment plume or oil sheen)? (See Section 4.3 for list of discharge points)	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		
4.2	Since the last inspection, are the discharge points and receiving waters free of evidence that pollutants had left the project site (for example, sediment deposits, oily residue)? (See Section 4.3 for list of discharge points)	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No Complete by Date:		

#### 4.3 Location of Discharge Points

List the project discharge point locations	Inspected? Circle
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No
	Yes No

List the project discharge point locations	Inspected? Circle

**5.0 Site-specific BMPs**

- **BMP Identifier** -- This column is a mandatory entry used to help correspond BMPs with the site map. Number the structural and non-structural BMPs identified in your SWPPP on your site map and list them below (add as many BMPs as necessary on the continuation sheets).
- **BMP and Location** - Describe and give the location of the structural and non-structural BMPs identified in your SWPPP in the BMP column below (Include areas that are required to be inspected by the CGP, such as material storage areas that are exposed to precipitation.)
- **BMP Installed?** – If a BMP should be installed at the time of the inspection and you marked “No” in the “BMP Installed” column, then you must check “Yes” in the “BMP Action Required?” column. If there is good reason to mark “no” in the “BMP Installed” column (such as the BMP is no longer needed and was removed) then you can mark “no” in the “BMP Action Required?” column and explain in the “Comments” column.
- **BMP Action Required?** - If a BMP needs repair, modification, replacement, maintenance or a new BMP is needed or a SWPPP amendment is needed, then a BMP Action is required.
- **BMP Action Required, Complete by Date** - Before certifying the report, fill in the date when the BMP Action can reasonably be expected to be completed. When a BMP Action is NOT required, leave the “Complete by Date” blank.
- **If BMP Action is required, describe Action and Location** – Anytime you check “Yes” for “BMP Action Required,” then you must also fill in the “Describe BMP Action and Location” column.
- **Corrective Action Log** - When a BMP Action is required as noted in this report, you must also enter all the information for this action in the Corrective Action Log, and document on the Log the actual date of completing correction.

BMP Identifier	BMP & Location	BMP Installed?	BMP Action Required?	If BMP Action is required, describe Action and Location	Comments
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		

BMP Identifier	BMP & Location	BMP Installed?	BMP Action Required?	If BMP Action is required, describe Action and Location	Comments
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		
		__Yes __No	__Yes __No Complete by Date:		

**6.0 Inspection Certification**

**6.1 Areas of Inspection**

Did you inspect all areas of the project that are required to be inspected by the CGP including areas disturbed by construction activity, areas used for storage of materials that are exposed to precipitation, areas where control measures are installed, areas where sediment or other pollutants have accumulated or been deposited and may have the potential for or are entering a stormwater conveyance system, locations where vehicles enter or exit the site, areas where storm water typically flows, points of discharge from the site, and portions of the site where temporary or permanent stabilization has been initiated?

- Yes  
 No

If you did not inspect any required areas, list those locations here and explain why they weren't inspected.

**6.2 Project Compliance**

- *If there are incidences of non-compliance identified in this inspection report then you must summarize below the incidence(s) of non-compliance.*
- *If there is an Action Item described in the non-compliance box below that does not already have a "Complete by Date" assigned elsewhere in this report, then add a Complete by Date within the box.*

<p style="text-align: center;">Non-Compliance</p> <p><b>Incidence(s) of Non-compliance:</b></p>  <p><b>Action Item(s) and Complete by Date(s):</b></p>
--

- *Check the box below if there are no incidences of non-compliance with the CGP:*

**I certify that on the date of this inspection, this project was found to be in compliance with the terms of the applicable Construction General Permit.**

---

**CERTIFICATION STATEMENT**

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

**Contractor's Duly Authorized Representative**

~~**DOT&PF's Duly Authorized Representative**~~

**Print name:** \_\_\_\_\_

~~**Print Name:** \_\_\_\_\_~~

**Title:** Superintendent

~~**Title:** Project Engineer~~

**Signature** \_\_\_\_\_

~~**Signature** \_\_\_\_\_~~

**Date** \_\_\_\_\_

~~**Date** \_\_\_\_\_~~

## Storm Water Pollution Prevention Plan (SWPPP)

PROJECT NAME: [Main Street Sidewalk Improvement](#)

DATE: [Click here to enter a date.](#)

---

### APPENDIX L – SWPPP AMENDMENT LOG

CITY OF HOMER  
DEPARTMENT OF PUBLIC WORKS

**SWPPP AMENDMENT LOG** PAGE \_\_\_\_\_

**AKSAS Number:**

**Project Name:** Main Street Sidewalk Improvement

*All amendments must be approved by the Engineer per 641.3.03, therefore the Project Engineer's approval of each amendment must be documented.  
Detailed instructions for completing this form can be found on the Alaska Construction Forms website:*

[http://dot.alaska.gov/stwddes/dcsconst/pop\\_constforms.shtml](http://dot.alaska.gov/stwddes/dcsconst/pop_constforms.shtml)

Amendment Number	Description of the Amendment and Related Corrective Action Number (if applicable)	Page or Sheet Number	Date of Amendment	Amendment Authorized by (Sign Full Name)	PE Initials
