


REVISIONS			
REV	DATE	DESCRIPTION	BY

FIBER OPTIC LINE  
KEY MAP

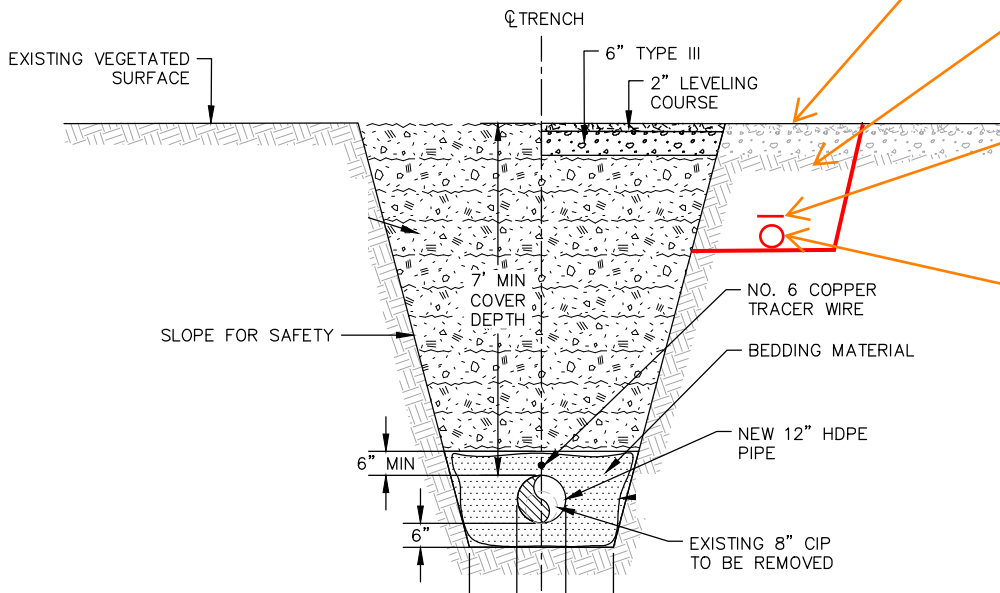

TRENCH DIMENSIONS AS REQ. TO CONSTRUCT FIBER OPTIC CABLE AND VAULTS.

STOCKPILE EXCAVATED MATERIAL AND REUSE ALL TO BACKFILL TRENCH

WARNING TAPE OVER CONDUIT FULL LENGTH

SM6 TUBE 12 FIBER OPTIC CABLE IN 2" HDPE CONDUIT. 36 INCHES MINIMUM BURY.



TYPICAL 3' X 3' X 3' COMMUNICATIONS VAULT (OLDCASTLE INFRASTRUCTURE OR SIMILIAR)

FIBER OPTIC LINE  
TRENCH DETAIL  
NTS

REVISIONS			
REV	DATE	DESCRIPTION	BY